


# **OIL ANALYSIS REPORT**

Sample Rating Trend

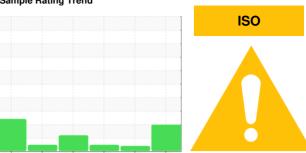

Machine Id

# KAESER AS 30 1431270 (S/N 323274)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

### **DIAGNOSIS**

#### Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

## Contamination

There is a high amount of particulates present in the oil.


#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		May2017	Jun2018 Nov2019	Aug <sup>2</sup> 020 Aug <sup>2</sup> 021	Jul2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA015721	KCP36940	KCP10131
Sample Date		Client Info		08 Jul 2024	16 Aug 2021	11 Aug 2020
Machine Age	hrs	Client Info		65765	61957	59549
Oil Age	hrs	Client Info		0	2408	4690
Oil Changed		Client Info		Changed	Not Changd	N/A
Sample Status				ABNORMAL	ABNORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1	1	1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	0	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	13	6	9
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m			0	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	0	<1
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m	90	4	25	13
Calcium	ppm	ASTM D5185m	2	0	0	<1
Phosphorus	ppm	ASTM D5185m		0	7	2
Zinc	ppm	ASTM D5185m		0	1	0
Sulfur	ppm	ASTM D5185m		20632	16676	16132
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	<1
Sodium	ppm	ASTM D5185m		2	6	3
Potassium	ppm	ASTM D5185m	>20	0	<1	<1
Water	%	ASTM D6304	>0.05	0.010	0.012	0.011
ppm Water	ppm	ASTM D6304	>500	100	128.4	111.1
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		36037		2359
Particles >6µm		ASTM D7647		<u>12469</u>		466
Particles >14μm		ASTM D7647	>80	<u> </u>		59
Particles >21μm		ASTM D7647	>20	<u>^</u> 233		19
Particles >38μm		ASTM D7647	>4	<u>^</u> 7		1
Particles >71μm		ASTM D7647		1		0
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>22/21/17</u>		16/13
FLUID DEGRADA	TION	method	limit/base	current	history1	history2



## **OIL ANALYSIS REPORT**

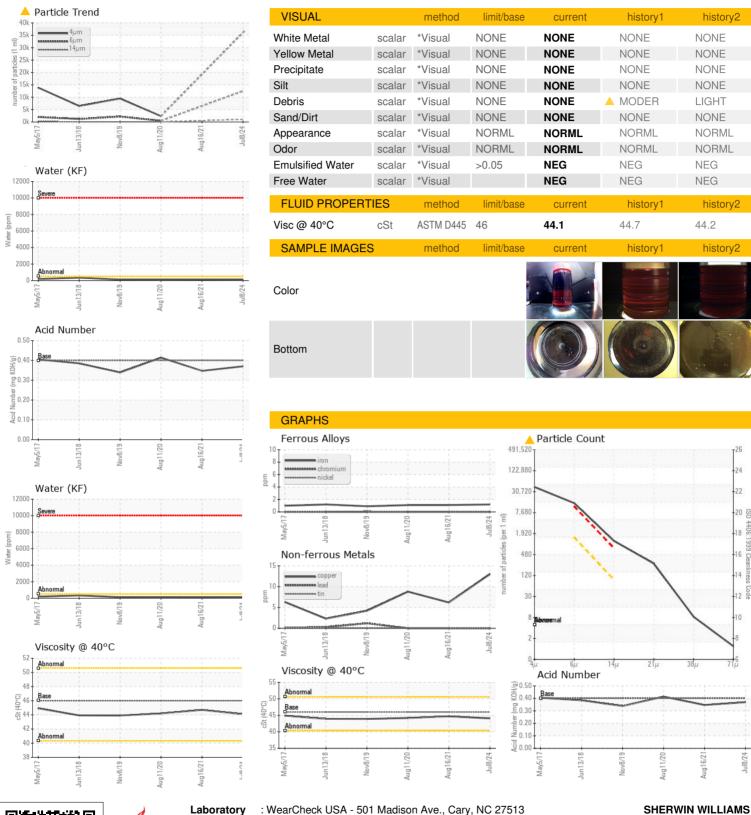





Certificate 12367

Laboratory Sample No.

: KCPA015721 Lab Number : 06238377 Unique Number : 11127211

Received **Tested** Diagnosed

: 17 Jul 2024 Test Package : IND 2 ( Additional Tests: KF, PrtCount )

: 16 Jul 2024

: 18 Jul 2024 - Don Baldridge

US 06109 Contact: DAVID COUTURE david.j.couture@sherwin.com

984 SILAS DEANE HWY

WETHERSFIELD, CT

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: