


# **OIL ANALYSIS REPORT**

Sample Rating Trend



**NORMAL** 



Machine Id

# 6685631 (S/N 1007)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Sep 202	) Sep2021	Jan 2023 Ju	12024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA020110	KCP46580	KCP37034
Sample Date		Client Info		03 Jul 2024	20 Jan 2023	30 Sep 2021
Machine Age	hrs	Client Info		12464	8061	5814
Oil Age	hrs	Client Info		4403	4400	4297
Oil Changed		Client Info		Changed	Changed	Changed
Sample Status				NORMAL	ATTENTION	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	<1	<1	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	<1	<1	1
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	90	0	16	12
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m	100	75	82	78
Calcium	ppm	ASTM D5185m	0	0	2	0
Phosphorus	ppm	ASTM D5185m	0	0	4	<1
Zinc	ppm	ASTM D5185m	0	0	5	1
Sulfur	ppm	ASTM D5185m	23500	22664	20249	17718
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	0
Sodium	ppm	ASTM D5185m		17	16	17
Potassium	ppm	ASTM D5185m	>20	2	2	0
Water	%	ASTM D6304	>0.05	0.026	0.016	0.027
ppm Water	ppm	ASTM D6304	>500	268	161.5	270.2
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2336	8831	3839
Particles >6µm		ASTM D7647	>1300	739	2283	630
Particles >14μm		ASTM D7647	>80	56	72	8
Particles >21µm		ASTM D7647	>20	12	11	3
Particles >38μm		ASTM D7647	>4	1	0	1
Particles >71μm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/17/13	0 20/18/13	16/10
FLUID DEGRADA	TION	method	limit/base	current	history1	history2



## **OIL ANALYSIS REPORT**

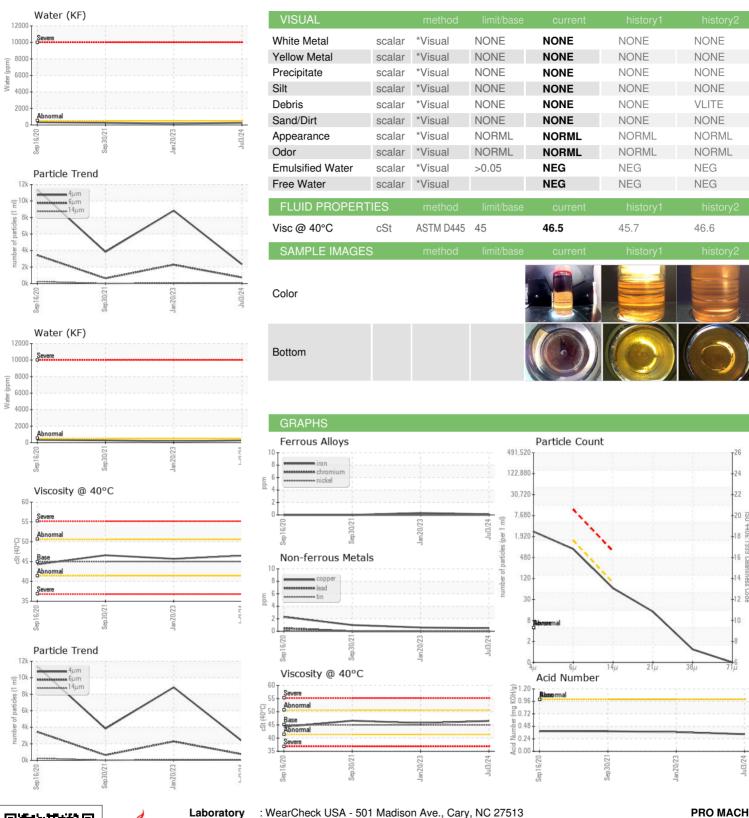





Certificate 12367

Lab Number

Laboratory Sample No.

: KCPA020110

Received **Tested** : 06238379 Unique Number : 11127213

: 17 Jul 2024 Diagnosed

: 18 Jul 2024 - Don Baldridge Test Package : IND 2 ( Additional Tests: KF, PrtCount )

: 16 Jul 2024

Contact: SHAWN CHELTON shawn.chelton@promachbuilt.com T:

1145 E WELLSPRING RD

NEW FREEDOM, PA

To discuss this sample report, contact Customer Service at 1-800-237-1369.  $^st$  - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

US 17349

F: