




# OIL ANALYSIS REPORT

## Sample Rating Trend

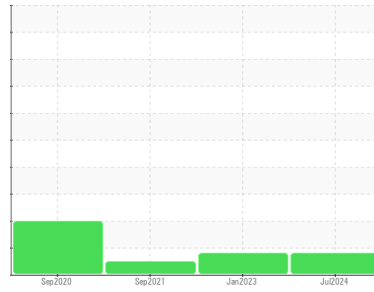

ISO



Machine Id  
**KAESER 6349289 (S/N 1003)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

### DIAGNOSIS

#### Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA020113</b>	KCP54922	KCP36508
Sample Date	Client Info			<b>03 Jul 2024</b>	20 Jan 2023	30 Sep 2021
Machine Age	hrs	Client Info		<b>13632</b>	9281	3623
Oil Age	hrs	Client Info		<b>4349</b>	5600	2180
Oil Changed		Client Info		<b>Changed</b>	Changed	Changed
Sample Status				<b>ATTENTION</b>	ATTENTION	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	4	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	<1	0	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	2	2	1
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m		---	---	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	<1
Barium	ppm	ASTM D5185m	90	0	6	4
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m	100	65	62	67
Calcium	ppm	ASTM D5185m	0	0	1	0
Phosphorus	ppm	ASTM D5185m	0	0	5	0
Zinc	ppm	ASTM D5185m	0	0	6	5
Sulfur	ppm	ASTM D5185m	23500	23241	17322	17158

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	<1
Sodium	ppm	ASTM D5185m		16	15	14
Potassium	ppm	ASTM D5185m	>20	2	2	0
Water	%	ASTM D6304	>0.05	0.027	0.012	0.029
ppm Water	ppm	ASTM D6304	>500	280	127.9	294.5

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		6053	4998	2169
Particles >6µm		ASTM D7647	>1300	1830	1131	659
Particles >14µm		ASTM D7647	>80	67	125	32
Particles >21µm		ASTM D7647	>20	15	26	9
Particles >38µm		ASTM D7647	>4	1	2	0
Particles >71µm		ASTM D7647	>3	1	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	20/18/13	19/17/14	17/12

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.33	0.36	0.308


# OIL ANALYSIS REPORT

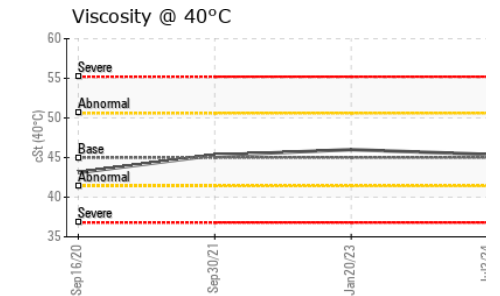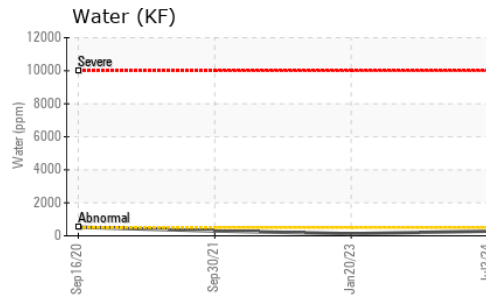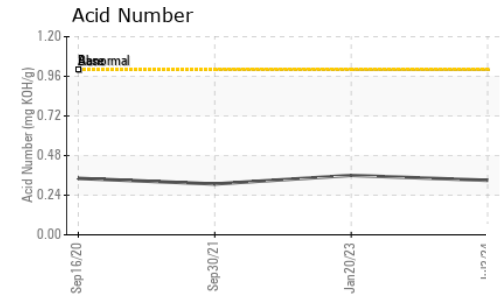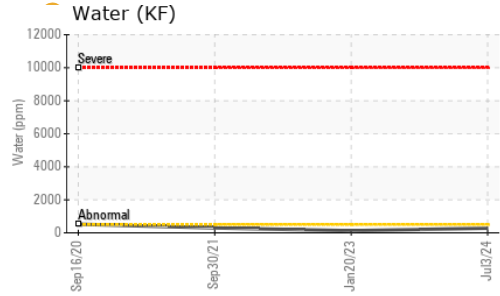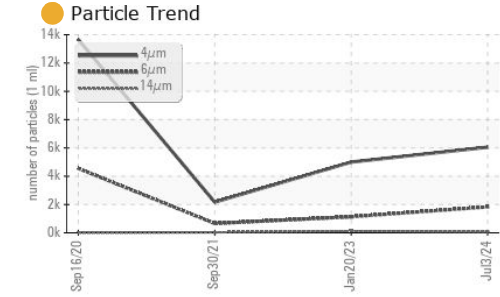





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	45.4	46.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

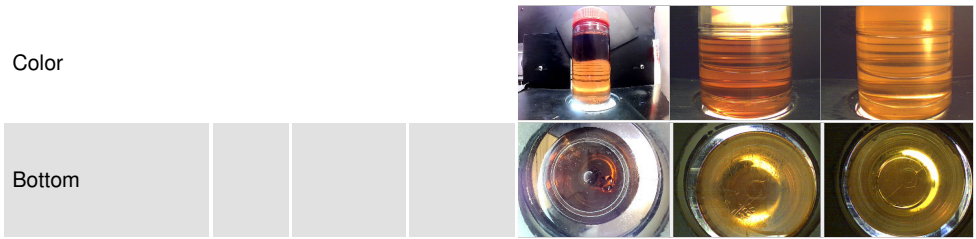

## GRAPHS

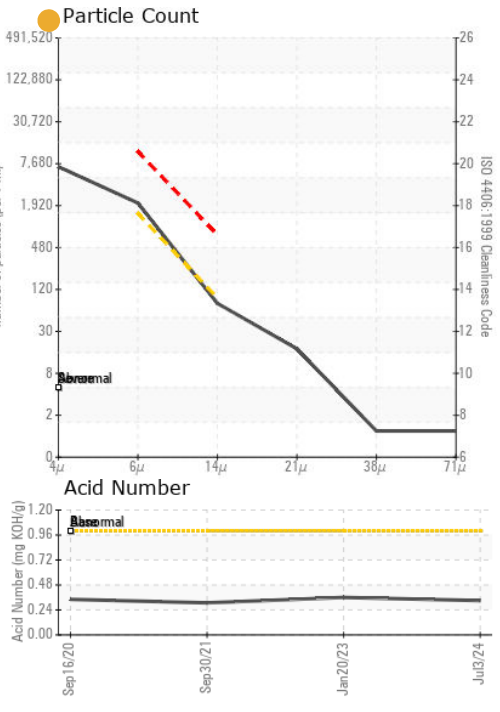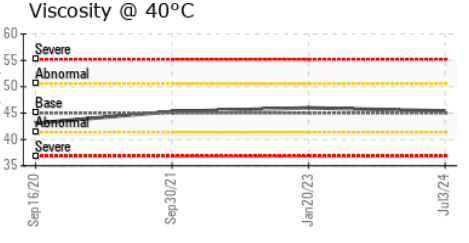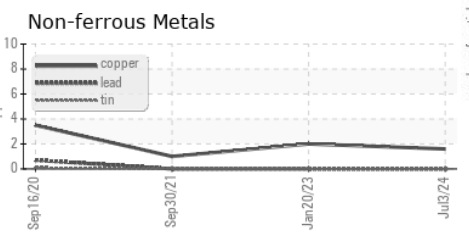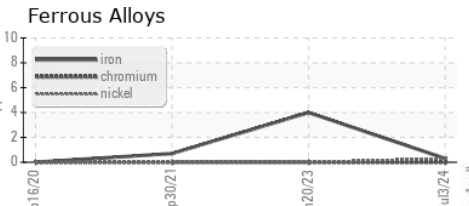

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA020113 **Received** : 16 Jul 2024  
**Lab Number** : 06238381 **Tested** : 17 Jul 2024  
**Unique Number** : 11127215 **Diagnosed** : 18 Jul 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**PRO MACH**  
 1145 E WELLSRING RD  
 NEW FREEDOM, PA  
 US 17349  
 Contact: SHAWN CHELTON  
 shawn.chelton@promachbuilt.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)