




OIL ANALYSIS REPORT

Sample Rating Trend

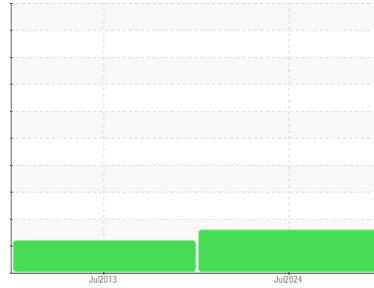

ISO



Machine Id

KAESER AS20T 2324131 (S/N 1013)

Component

Compressor

Fluid

KAESER SIGMA (OEM) M-460 (--- QTS)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA020771	KCP29720	---
Sample Date	Client Info			09 Jul 2024	08 Jul 2013	---
Machine Age	hrs	Client Info		71299	48704	---
Oil Age	hrs	Client Info		2144	930	---
Oil Changed	Client Info			Changed	N/A	---
Sample Status				ABNORMAL	MARGINAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	5	<1	---
Chromium	ppm	ASTM D5185m	>10	0	0	---
Nickel	ppm	ASTM D5185m		0	0	---
Titanium	ppm	ASTM D5185m		0	0	---
Silver	ppm	ASTM D5185m		0	0	---
Aluminum	ppm	ASTM D5185m	>25	<1	0	---
Lead	ppm	ASTM D5185m	>25	0	0	---
Copper	ppm	ASTM D5185m	>50	3	16	---
Tin	ppm	ASTM D5185m	>15	0	0	---
Antimony	ppm	ASTM D5185m		---	0	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	<1	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	---
Barium	ppm	ASTM D5185m	90	0	0	---
Molybdenum	ppm	ASTM D5185m	0	0	0	---
Manganese	ppm	ASTM D5185m		0	0	---
Magnesium	ppm	ASTM D5185m	100	31	0	---
Calcium	ppm	ASTM D5185m	0	0	0	---
Phosphorus	ppm	ASTM D5185m	0	0	0	---
Zinc	ppm	ASTM D5185m	0	52	39	---
Sulfur	ppm	ASTM D5185m	23500	23990	20590	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	4	4	---
Sodium	ppm	ASTM D5185m		6	<1	---
Potassium	ppm	ASTM D5185m	>20	<1	6	---
Water	%	ASTM D6304	>0.1	0.014	0.001	---
ppm Water	ppm	ASTM D6304	>1000	146	10	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		63850	1102	---
Particles >6µm		ASTM D7647	>1300	▲ 19581	600	---
Particles >14µm		ASTM D7647	>80	▲ 536	▲ 102	---
Particles >21µm		ASTM D7647	>20	▲ 72	▲ 34	---
Particles >38µm		ASTM D7647	>4	1	▲ 5	---
Particles >71µm		ASTM D7647	>3	0	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 23/21/16	▲ 16/14	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.43	0.509	---

OIL ANALYSIS REPORT

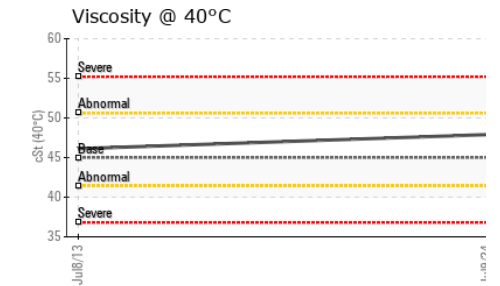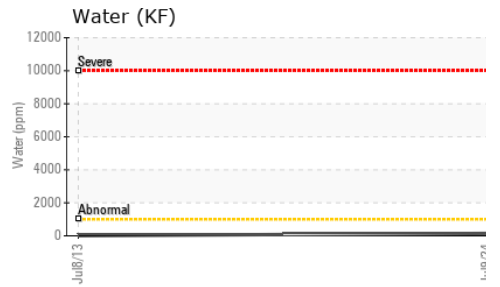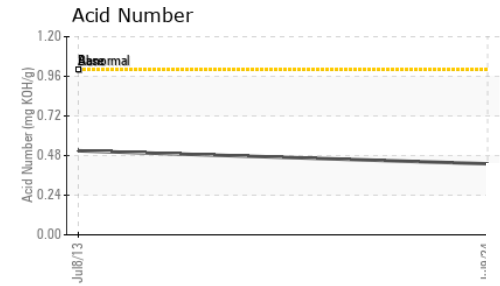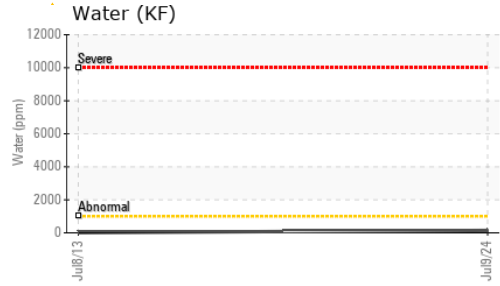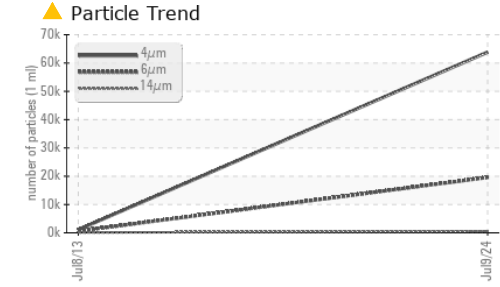





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	VLITE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	47.9	46.12

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

GRAPHS

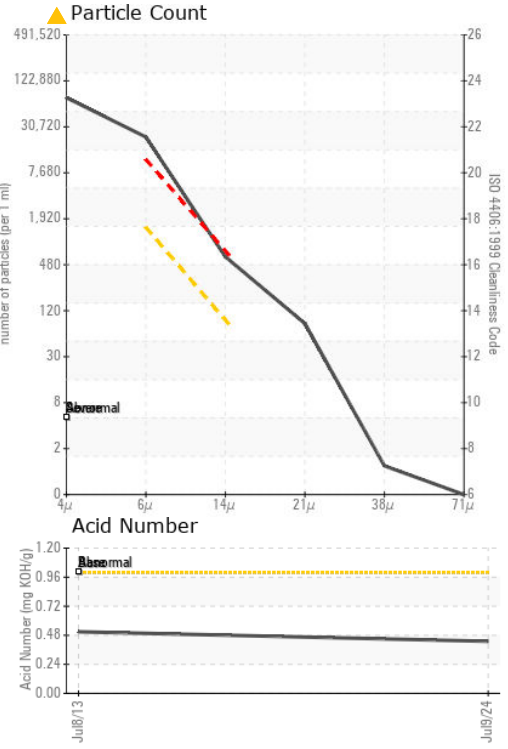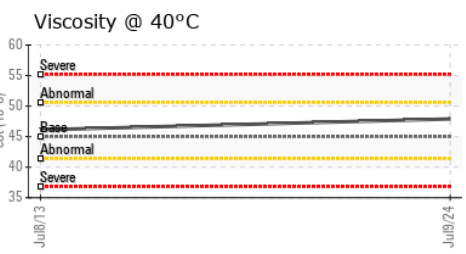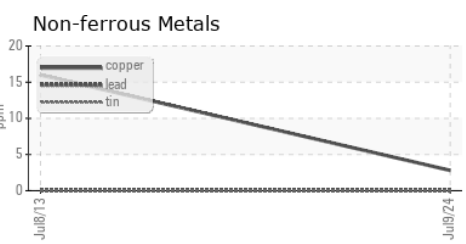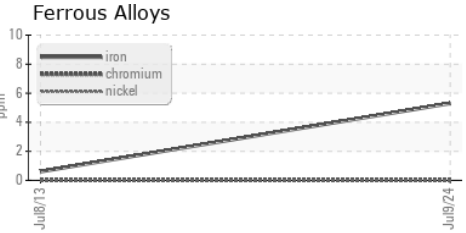

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA020771 **Received** : 16 Jul 2024
Lab Number : 06238397 **Tested** : 17 Jul 2024
Unique Number : 11127231 **Diagnosed** : 18 Jul 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

PRECISE CAST PROTOTYPES
 7501 DAHLIA ST
 COMMERCE CITY, CO
 US 80022
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)