



# OIL ANALYSIS REPORT

Sample Rating Trend



ISO



Machine Id

**9105849 (S/N 1638)**

Component

**Compressor**

Fluid

**KAESER SIGMA (OEM) FG-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA020591</b>	---	---
Sample Date	Client Info		<b>09 Jul 2024</b>	---	---
Machine Age	hrs	Client Info	<b>4513</b>	---	---
Oil Age	hrs	Client Info	<b>4513</b>	---	---
Oil Changed	Client Info		<b>Changed</b>	---	---
Sample Status			<b>ABNORMAL</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>18</b>	---	---
Chromium	ppm	ASTM D5185m >10	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m >3	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m >3	<b>0</b>	---	---
Silver	ppm	ASTM D5185m >2	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >10	<b>3</b>	---	---
Lead	ppm	ASTM D5185m >10	<b>0</b>	---	---
Copper	ppm	ASTM D5185m >50	<b>17</b>	---	---
Tin	ppm	ASTM D5185m >10	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	---	---
Barium	ppm	ASTM D5185m	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m	<b>3</b>	---	---
Calcium	ppm	ASTM D5185m	<b>0</b>	---	---
Phosphorus	ppm	ASTM D5185m 500	<b>213</b>	---	---
Zinc	ppm	ASTM D5185m	<b>93</b>	---	---
Sulfur	ppm	ASTM D5185m	<b>1516</b>	---	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	---	---
Sodium	ppm	ASTM D5185m	<b>2</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	---	---
Water	%	ASTM D6304 >0.05	<b>0.003</b>	---	---
ppm Water	ppm	ASTM D6304 >500	<b>28</b>	---	---






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>10919</b>	---	---
Particles >6µm	ASTM D7647	>1300	<b>▲ 3769</b>	---	---
Particles >14µm	ASTM D7647	>80	<b>▲ 382</b>	---	---
Particles >21µm	ASTM D7647	>20	<b>▲ 112</b>	---	---
Particles >38µm	ASTM D7647	>4	<b>▲ 8</b>	---	---
Particles >71µm	ASTM D7647	>3	<b>1</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	<b>▲ 21/19/16</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.5	<b>0.70</b>	---	---

# OIL ANALYSIS REPORT

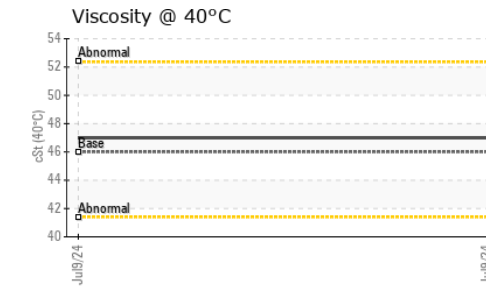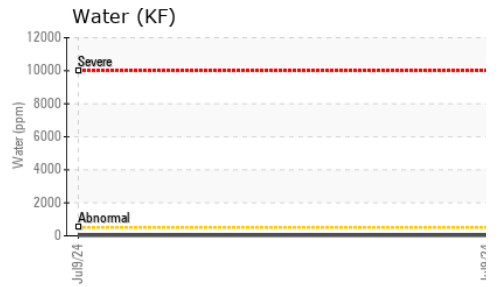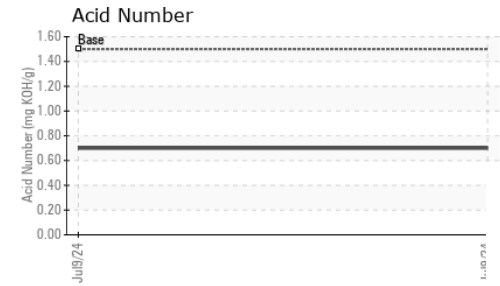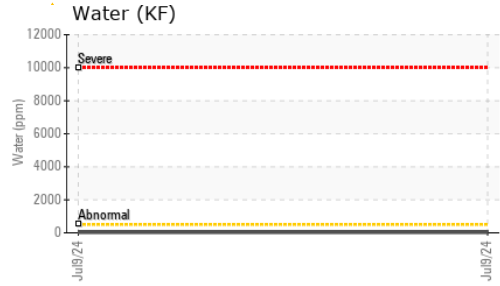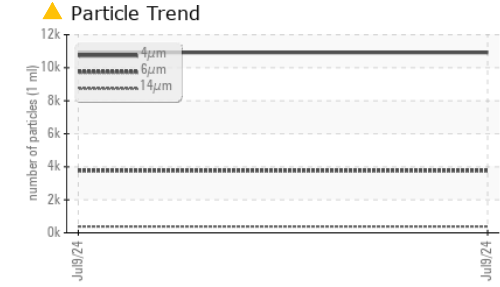





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	46	47.0	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

## GRAPHS

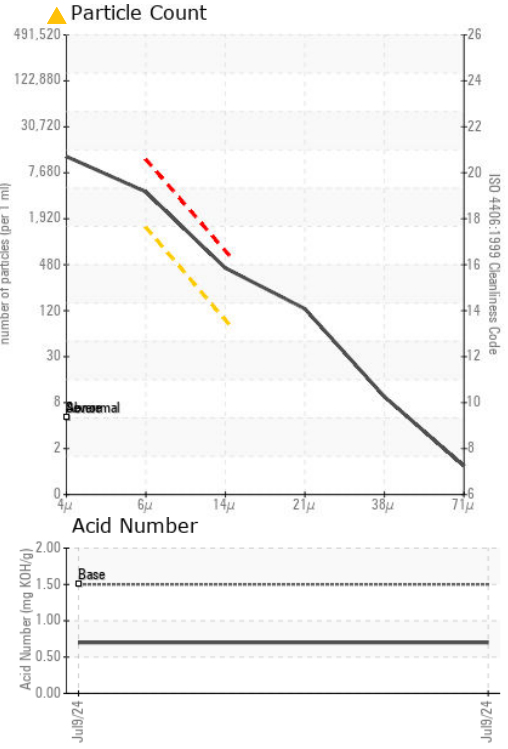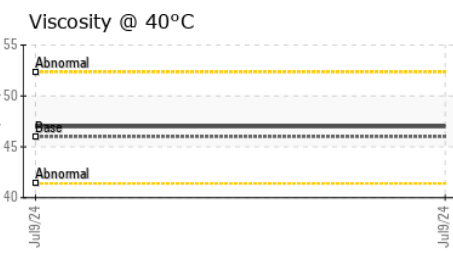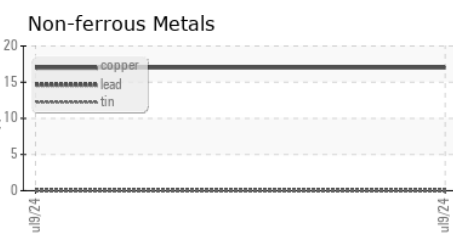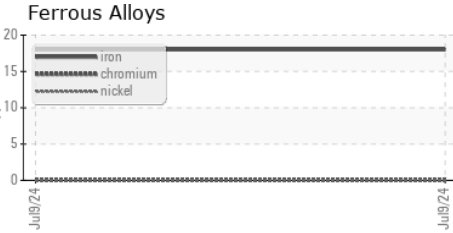

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA020591 **Received** : 16 Jul 2024  
**Lab Number** : 06238400 **Tested** : 17 Jul 2024  
**Unique Number** : 11127234 **Diagnosed** : 18 Jul 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**DART CONTAINER CORP - BUILDING 1**  
 432 HOGSBACK RD  
 MASON, MI  
 US 48854  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: