

OIL ANALYSIS REPORT

Machine Id

KAESER CSD 100 8862403 (S/N 1244)

Component Compressor

Fluid KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

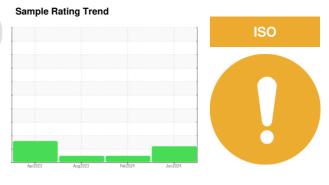

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC128726	KC127556	KC05927836
Sample Date		Client Info		26 Jun 2024	15 Feb 2024	08 Aug 2023
Machine Age	hrs	Client Info		11362	8194	3972
Oil Age	hrs	Client Info		3168	0	0
Oil Changed		Client Info		Not Changd	N/A	N/A
Sample Status				ATTENTION	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	<1
Chromium	ppm	ASTM D5185m	>10	0	<1	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>3	0	<1	0
Silver	ppm	ASTM D5185m	>2	<1	0	0
Aluminum	ppm	ASTM D5185m	>10	1	2	5
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	8	15	9
Tin	ppm	ASTM D5185m	>10	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	<1
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	90	7	<1	7
Calcium	ppm	ASTM D5185m	2	0	3	1
Phosphorus	ppm	ASTM D5185m		3	12	23
Zinc	ppm	ASTM D5185m		0	0	2
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	3
Sodium	ppm	ASTM D5185m		2	0	2
Potassium	ppm	ASTM D5185m	>20	1	1	2
Water	%	ASTM D6304	>0.05	0.007	0.002	0.007
ppm Water	ppm	ASTM D6304	>500	79	17	74.0
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1984	916	497
Particles >6µm		ASTM D7647	>1300	1030	242	113
Particles >14µm		ASTM D7647	>80	<u> </u>	17	8
Particles >21µm		ASTM D7647		<mark> </mark> 26	3	3
Particles >38µm		ASTM D7647	>4	2	0	0
Particles >71µm		ASTM D7647		0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	e 18/17/14	17/15/11	16/14/10
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.34	0.24	0.28



OIL ANALYSIS REPORT

*Visual

*Visual

*Visua

*Visual

*Visual

*Visual

*Visual

*Visual

scalar

scalar

scalar

scalar

scalar

scalar

scalar

scalar

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

White Metal

Yellow Metal

Precipitate


Silt

Debris

Odor


Sand/Dirt

Appearance

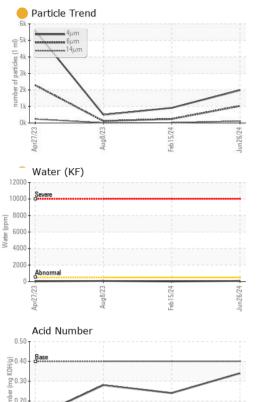

eb15/24

ua8/23

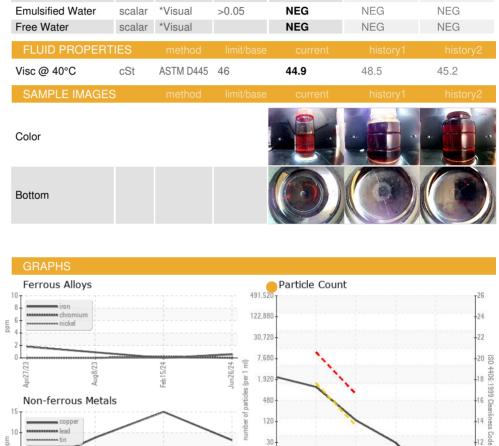

NONE

NONE

NONE

NONE

LIGHT

NONE

NORML

NORML

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

NONE

NONE

NONE


NONE


NONE

NONE

NORML

NORML



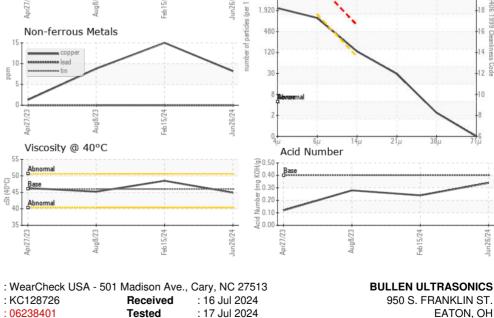

: 18 Jul 2024 - Don Baldridge



Pio 0.1

0.00

1000

600 Water (

4000

200

muu

Water (KF)

Abnormal

Sample No. : KC128726 Lab Number : 06238401 Unique Number : 11127235 Test Package : IND 2 Certificate 12367

Laboratory

To discuss this sample report, contact Customer Service at 1-800-237-1369.

Vnr77/7

Bas

Apr27/23

Abnorma

Viscosity @ 40°C

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Aug8/23 -

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Diagnosed

Contact/Location: SERVICE MANAGER - BULEAT

US 45320

T:

F:

Contact: SERVICE MANAGER