


OIL ANALYSIS REPORT

Sample Rating Trend

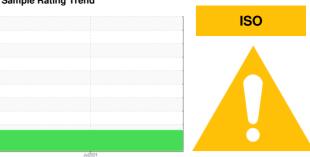

Machine Id

8445813 (S/N 1193)Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jul2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA016037		
Sample Date		Client Info		10 Jul 2024		
Machine Age	hrs	Client Info		7073		
Oil Age	hrs	Client Info		4000		
Oil Changed		Client Info		Changed		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	<1		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	0		
Copper		ASTM D5185m	>50	9		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium		ASTM D5185m	>10	0		
Cadmium	ppm	ASTM D5185m		0		
	ppm					
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	100	4		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	0		
Zinc	ppm	ASTM D5185m	0	31		
Sulfur	ppm	ASTM D5185m	23500	22539		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		<1		
Potassium	ppm	ASTM D5185m	>20	<1		
Water	%	ASTM D6304	>0.05	800.0		
ppm Water	ppm	ASTM D6304	>500	85		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		3535		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14μm		ASTM D7647	>80	<u>^</u> 265		
Particles >21μm		ASTM D7647	>20	<u></u> 91		
Particles >38μm		ASTM D7647	>4	4		
Particles >71μm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/18/15		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.37		



OIL ANALYSIS REPORT

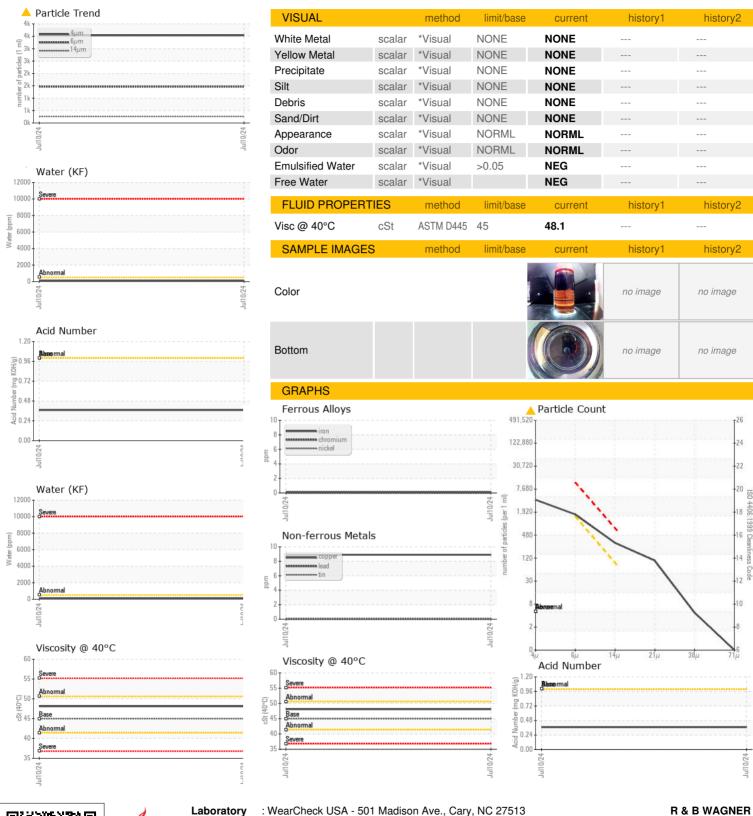





Certificate 12367

Laboratory Sample No.

Lab Number

: KCPA016037 : 06238402

Unique Number : 11127236

Received **Tested**

: 17 Jul 2024 Diagnosed

: 18 Jul 2024 - Don Baldridge

: 16 Jul 2024

Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

10600 W BROWN DEER RD

MILWAUKEE, WI US 53224

Contact: J. WISSBROECKER jwissbroecker@mailwagner.com

T: F: