


# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**

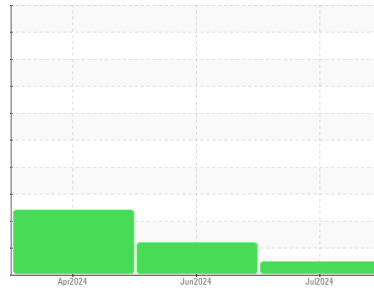

Machine Id  
**NK 112332 (S/N SC348831)**  
 Component  
**Compressor**  
 Fluid  
**CIMARRON HB-150 (--- GAL)**

**DIAGNOSIS**

**Recommendation**  
 Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>TO90004473</b>	TO90004126	TO90003965
Sample Date	Client Info			<b>15 Jul 2024</b>	05 Jun 2024	11 Apr 2024
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	ATTENTION	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>2</b>	0	4
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Titanium	ppm	ASTM D5185m		<b>0</b>	0	<1
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	2
Lead	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	0
Copper	ppm	ASTM D5185m	>50	<b>0</b>	0	<1
Tin	ppm	ASTM D5185m	>15	<b>1</b>	2	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	<1	<1
Cadmium	ppm	ASTM D5185m		<b>0</b>	<1	<1






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	2	0
Barium	ppm	ASTM D5185m	0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	<1
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m	0	<b>2</b>	2	<1
Calcium	ppm	ASTM D5185m	0	<b>0</b>	2	1
Phosphorus	ppm	ASTM D5185m	0	<b>11</b>	20	47
Zinc	ppm	ASTM D5185m	0	<b>0</b>	10	37
Sulfur	ppm	ASTM D5185m	0	<b>296</b>	378	524

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	1
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	8
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	5	1
Water	%	ASTM D6304	>2.26	<b>0.526</b>	1.30	▲ 0.402
ppm Water	ppm	ASTM D6304	>22600	<b>5260</b>	13000	▲ 4026

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	<b>7412</b>	● 13820	● 10830
Particles >6µm		ASTM D7647	>2500	<b>2121</b>	● 2971	2438
Particles >14µm		ASTM D7647	>320	<b>199</b>	111	160
Particles >21µm		ASTM D7647	>80	<b>80</b>	20	37
Particles >38µm		ASTM D7647	>20	<b>12</b>	2	1
Particles >71µm		ASTM D7647	>4	<b>3</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	<b>20/18/15</b>	● 21/19/14	● 21/18/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.18</b>	0.25	0.29

# OIL ANALYSIS REPORT

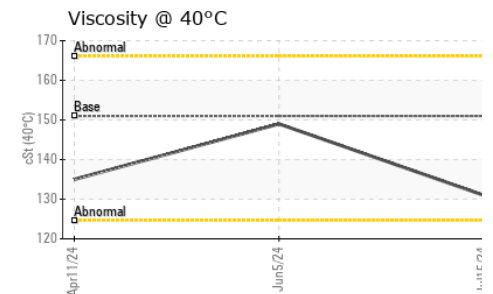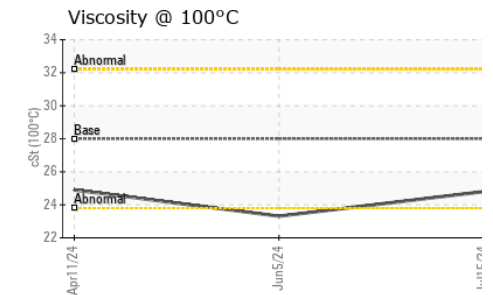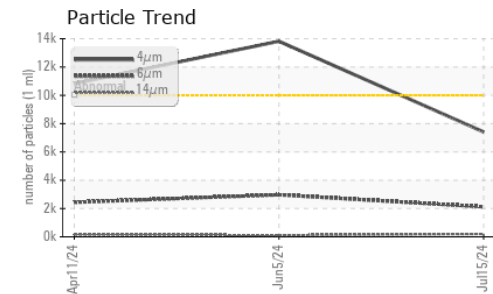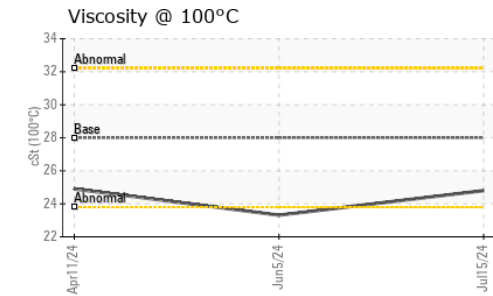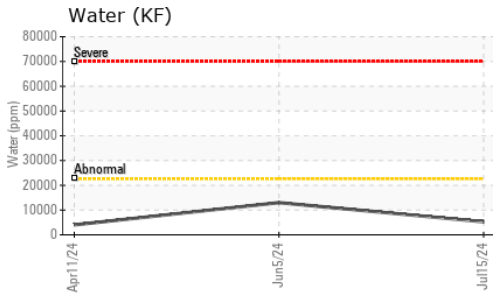

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	<b>LIGHT</b>	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML
Emulsified Water	scalar	*Visual	>2.26	<b>NEG</b>	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	151	<b>131</b>	149
Visc @ 100°C	cSt	ASTM D445	28	<b>24.8</b>	23.31
Viscosity Index (VI)	Scale	ASTM D2270	224	<b>223</b>	187

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS
<p><b>Ferrous Alloys</b></p> <p><b>Non-ferrous Metals</b></p> <p><b>Viscosity @ 40°C</b></p> <p><b>Particle Count</b></p> <p><b>Acid Number</b></p>



Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513

**Sample No.** : TO90004473

**Lab Number** : 06238432

**Unique Number** : 11127266

**Test Package** : IND 2 ( Additional Tests: KF, KV100, PrtCount, VI )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**Received** : 16 Jul 2024

**Tested** : 18 Jul 2024

**Diagnosed** : 18 Jul 2024 - Don Baldrige

**CIMARRON ENERGY - CARLSBAD**

4425 GRANDI RD, UNIT F

CARLSBAD, NM

UM 88220-8923

Contact: CARLOS LEAL

cleal@cimarron.com

T:

F: