

## **OIL ANALYSIS REPORT**

Sample Rating Trend

### NORMAL

### ATLAS COPCO ATLAS COPCO 100HP (S/N API671075) Component Air Compressor

Fluid USPI AIR 46 (--- GAL)

#### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


#### Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USPM37053	USPM36676	USPM30608
Sample Date		Client Info		08 Jul 2024	05 Apr 2024	04 Jan 2024
Machine Age	hrs	Client Info		45922	43921	41846
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>70	1	2	0
Chromium	ppm	ASTM D5185m	>15	0	<1	<1
Nickel	ppm	ASTM D5185m	>6	<1	<1	<1
Titanium	ppm	ASTM D5185m		0	<1	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>10	<1	1	0
Lead	ppm	ASTM D5185m	>20	0	1	0
Copper	ppm	ASTM D5185m	>80	0	<1	0
Tin	ppm	ASTM D5185m	>15	<1	1	0
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	ppm	ASTM D5185m		0	1	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	0	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	<1	0
Manganese	ppm	ASTM D5185m		1	<1	0
Magnesium	ppm	ASTM D5185m	0	0	<1	0
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	1	0	0	0
Zinc	ppm	ASTM D5185m	0	0	<1	0
Sulfur	ppm	ASTM D5185m	0	<1	0	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>12	<1	<1	<1
Sodium	ppm	ASTM D5185m		3	0	4
Potassium	ppm	ASTM D5185m	>20	3	<1	0
Water	%	ASTM D6304	>0.2	0.121	0.055	0.049
ppm Water	ppm	ASTM D6304	>2000	1218	557	499
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	97	162	432
Particles >6µm		ASTM D7647	>2500	39	45	146
Particles >14µm		ASTM D7647	>320	6	8	14
Particles >21µm		ASTM D7647	>80	1	2	3
Particles >38µm		ASTM D7647	>20	0	0	0
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	14/12/10	15/13/10	16/14/11
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.05	0.34	0.27	0.13





# **OIL ANALYSIS REPORT**












VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	49.7	50.5	53.6	53.2
SAMPLE IMAGES	3	method	limit/base	current	history1	history2
Color						

Bottom

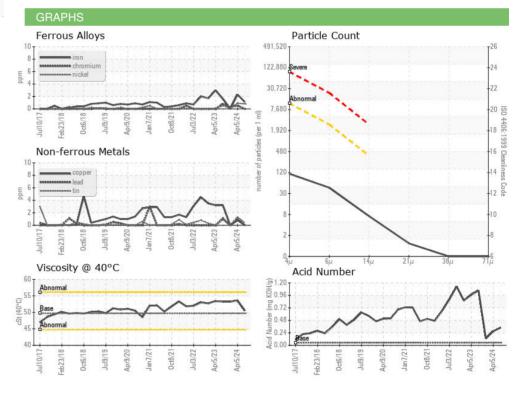

: 16 Jul 2024

: 18 Jul 2024

: 18 Jul 2024 - Doug Bogart





Test Package : IND 2 To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

: USPM37053

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

: WearCheck USA - 501 Madison Ave., Cary, NC 27513

Received

Diagnosed

Tested

Report Id: TYSROGG [WUSCAR] 06238487 (Generated: 07/18/2024 13:17:38) Rev: 1

Certificate 12367

Laboratory

Sample No.

Lab Number : 06238487

Unique Number : 11127321

Contact/Location: SERVICE MANAGER - TYSROGG

T:

F: