


# **OIL ANALYSIS REPORT**

Sample Rating Trend



**NORMAL** 



Machine Id

# 8804449 (S/N 1081)

Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Jun <sup>2</sup> 023 Jun <sup>2</sup> 024 Jul <sup>2</sup> 024						
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC128619	KC126698	KC107732
Sample Date		Client Info		10 Jul 2024	05 Jan 2024	13 Jun 2023
Machine Age	hrs	Client Info		11068	7475	3578
Oil Age	hrs	Client Info		7490	0	3578
Oil Changed		Client Info		Changed	N/A	Changed
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	2	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	7	3	3
Tin	ppm	ASTM D5185m	>10	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	0	56
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	90	1	39	48
Calcium	ppm	ASTM D5185m	2	0	0	2
Phosphorus	ppm	ASTM D5185m		0	27	<1
Zinc	ppm	ASTM D5185m		0	0	5
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	6	6	0
Sodium	ppm	ASTM D5185m		<1	8	8
Potassium	ppm	ASTM D5185m	>20	0	6	7
Water	%	ASTM D6304	>0.05	0.004	0.010	0.014
ppm Water	ppm	ASTM D6304	>500	50	105	145.5
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1074	2484	1530
Particles >6μm		ASTM D7647	>1300	341	518	506
Particles >14μm		ASTM D7647	>80	21	17	55
Particles >21μm		ASTM D7647		3	3	19
Particles >38μm		ASTM D7647	>4	0	0	0
Particles >71μm		ASTM D7647		0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/16/12	18/16/11	18/16/13
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.42	0.38	0.41



## **OIL ANALYSIS REPORT**

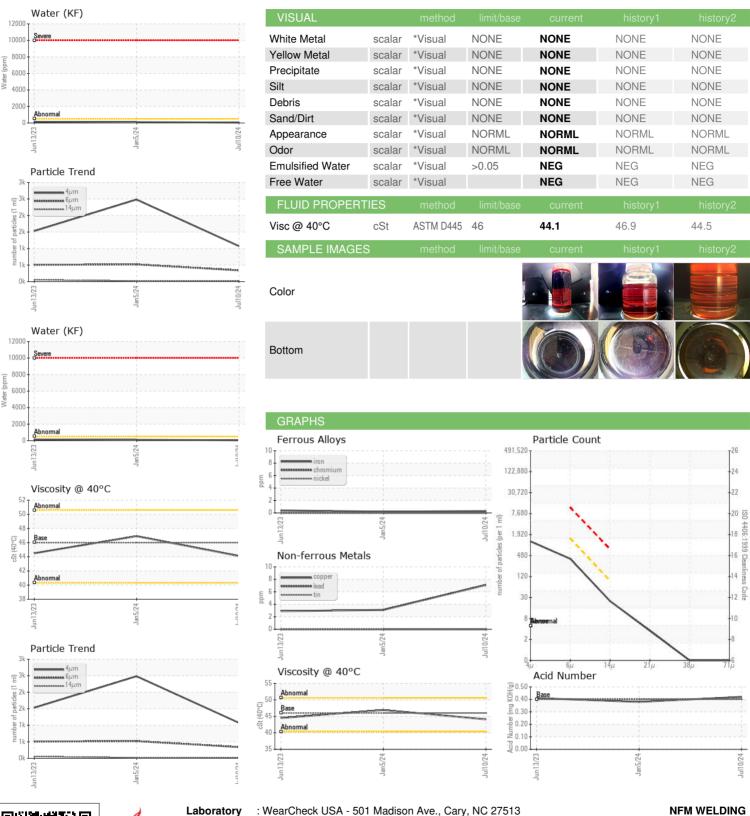





Certificate 12367

Laboratory Sample No. Lab Number

: KC128619 : 06239157 Unique Number : 11127991 Test Package : IND 2

Received : 17 Jul 2024 **Tested** : 18 Jul 2024 Diagnosed

: 19 Jul 2024 - Don Baldridge

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F:

577 OBERLIN RD SW

Contact: Service Manager

MASSILLON, OH

US 44647

T: