


# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**

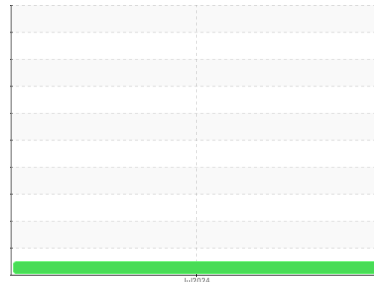

Machine Id  
**JBS-WORTHINGTON HSV 5**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**FRICK COMPRESSOR OIL #9 (--- GAL)**

**DIAGNOSIS**

**Recommendation**  
 Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 The water content is negligible. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

**SAMPLE INFORMATION**    method    limit/base    current    history1    history2

Sample Number	Client Info		<b>Y2K0001790</b>	---	---
Sample Date	Client Info		<b>08 Jul 2024</b>	---	---
Machine Age	hrs	Client Info	<b>0</b>	---	---
Oil Age	hrs	Client Info	<b>0</b>	---	---
Oil Changed		Client Info	<b>N/A</b>	---	---
Sample Status			<b>NORMAL</b>	---	---

**WEAR METALS**    method    limit/base    current    history1    history2

Iron	ppm	ASTM D5185m	>8	<b>0</b>	---	---
Chromium	ppm	ASTM D5185m	>2	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m		<b>0</b>	---	---
Titanium	ppm	ASTM D5185m		<b>0</b>	---	---
Silver	ppm	ASTM D5185m	>2	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>3	<b>0</b>	---	---
Lead	ppm	ASTM D5185m	>2	<b>0</b>	---	---
Copper	ppm	ASTM D5185m	>8	<b>0</b>	---	---
Tin	ppm	ASTM D5185m	>4	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---

**ADDITIVES**    method    limit/base    current    history1    history2

Boron	ppm	ASTM D5185m		<b>0</b>	---	---
Barium	ppm	ASTM D5185m		<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	---	---
Manganese	ppm	ASTM D5185m		<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m		<b>0</b>	---	---
Calcium	ppm	ASTM D5185m		<b>0</b>	---	---
Phosphorus	ppm	ASTM D5185m		<b>0</b>	---	---
Zinc	ppm	ASTM D5185m		<b>0</b>	---	---
Sulfur	ppm	ASTM D5185m		<b>2</b>	---	---

**CONTAMINANTS**    method    limit/base    current    history1    history2

Silicon	ppm	ASTM D5185m	>15	<b>&lt;1</b>	---	---
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	---	---
Water	%	ASTM D6304	>0.01	<b>0.003</b>	---	---
ppm Water	ppm	ASTM D6304	>100	<b>31</b>	---	---






**FLUID CLEANLINESS**    method    limit/base    current    history1    history2

Particles >4µm		ASTM D7647	>10000	<b>6831</b>	---	---
Particles >6µm		ASTM D7647	>2500	<b>1760</b>	---	---
Particles >14µm		ASTM D7647	>320	<b>34</b>	---	---
Particles >21µm		ASTM D7647	>80	<b>2</b>	---	---
Particles >38µm		ASTM D7647	>20	<b>0</b>	---	---
Particles >71µm		ASTM D7647	>4	<b>0</b>	---	---
Oil Cleanliness		ISO 4406 (c)	>20/18/15	<b>20/18/12</b>	---	---

**FLUID DEGRADATION**    method    limit/base    current    history1    history2

Acid Number (AN)	mg KOH/g	ASTM D974		<b>0.014</b>	---	---
------------------	----------	-----------	--	--------------	-----	-----


# OIL ANALYSIS REPORT

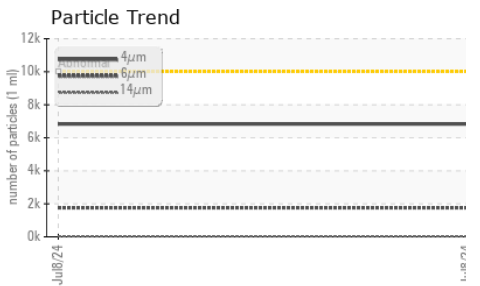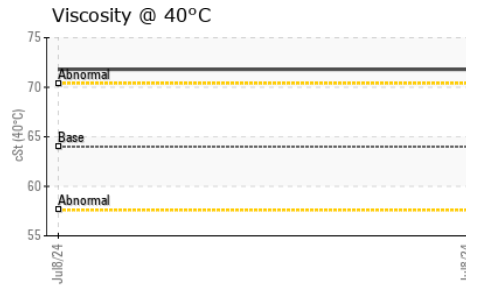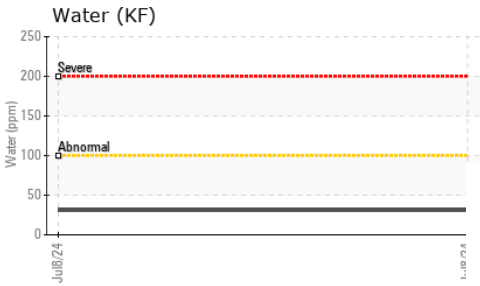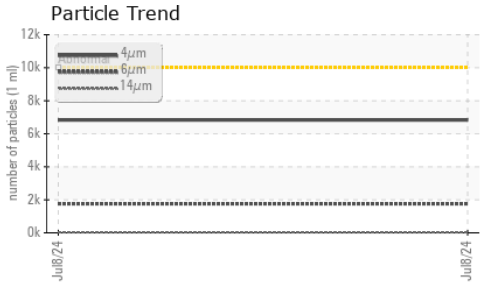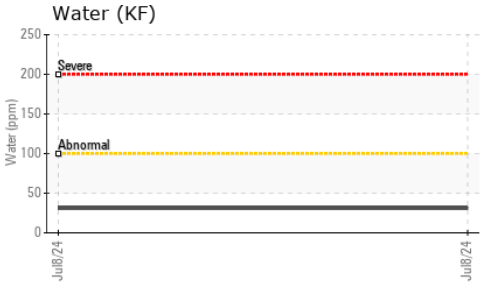






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	LIGHT	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.01	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	64.0	71.8	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

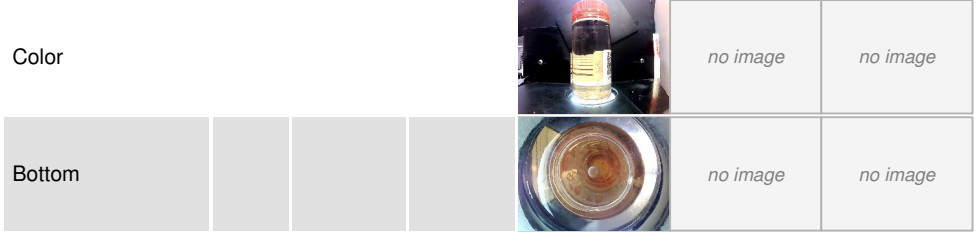

## GRAPHS

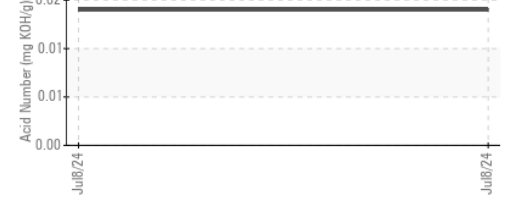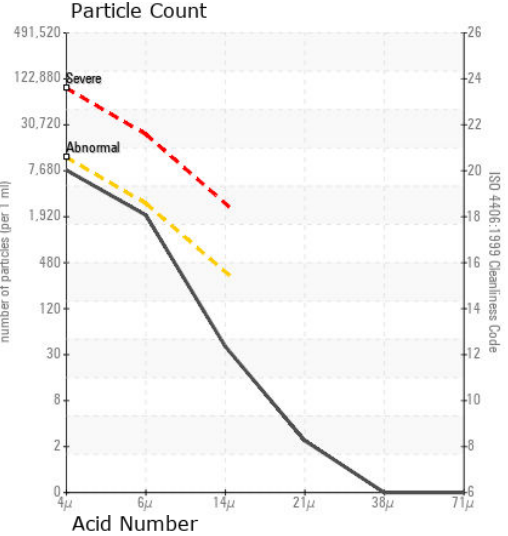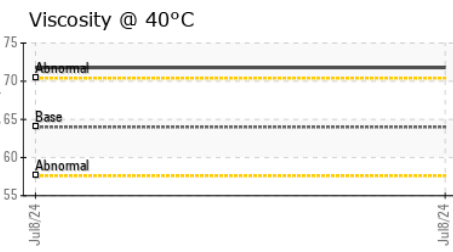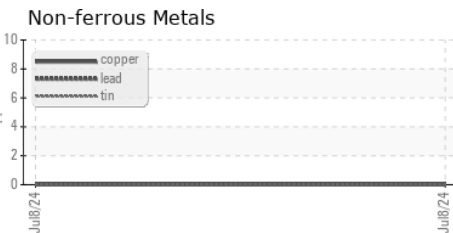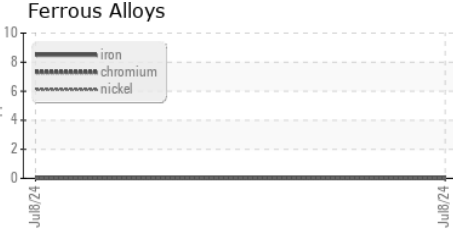

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : Y2K0001790      **Received** : 17 Jul 2024  
**Lab Number** : 06239190      **Tested** : 19 Jul 2024  
**Unique Number** : 11128024      **Diagnosed** : 19 Jul 2024 - Jonathan Hester  
**Test Package** : MOB 2 ( Additional Tests: KF, PrtCount )

**Y2K FLUID POWER**  
 3620 N LEWIS AVE  
 SIOUX FALLS, SD  
 US 57104

Contact: SERVICE MANAGER  
 sales@y2kfiltration.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (605)332-0988