




# OIL ANALYSIS REPORT

Sample Rating Trend

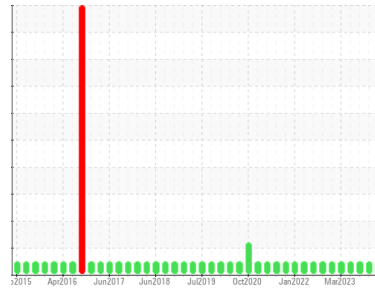

**NORMAL**



Machine Id  
**BC-16 (S/N 0039)**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**CAMCO 717 HT (150 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The water content is negligible. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0897705</b>	WC0914841	WC0857541
Sample Date	Client Info			<b>10 Jul 2024</b>	24 Mar 2024	25 Oct 2023
Machine Age	hrs	Client Info		<b>97672</b>	95841	93994
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed		Client Info		<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL




WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	<b>5</b>	2	9
Chromium	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m		<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	<1
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>3	<b>0</b>	0	1
Lead	ppm	ASTM D5185m	>2	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m	>8	<b>0</b>	0	<1
Tin	ppm	ASTM D5185m	>4	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	<1

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m		<b>0</b>	0	0
Calcium	ppm	ASTM D5185m		<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m		<b>0</b>	0	4
Zinc	ppm	ASTM D5185m		<b>0</b>	0	3
Sulfur	ppm	ASTM D5185m		<b>38</b>	28	137

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>0</b>	0	<1
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	1	0
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	<1
Water	%	ASTM D6304	>0.01	<b>0.009</b>	0.001	0.001
ppm Water	ppm	ASTM D6304	>100	<b>97</b>	14	8.0

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.007	<b>0.013</b>	0.042	0.015

# OIL ANALYSIS REPORT

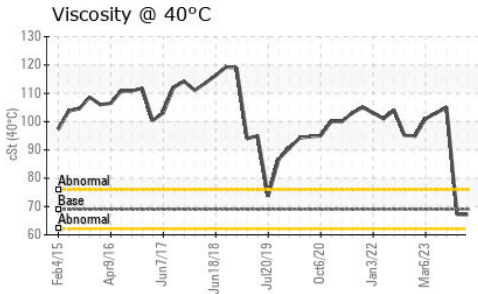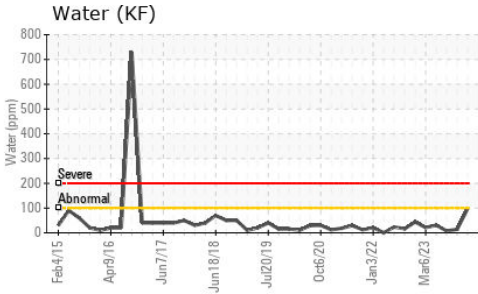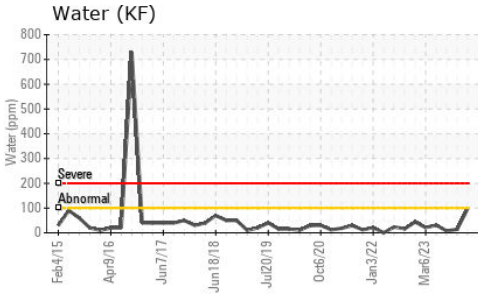





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 69	<b>67.1</b>	67.2	105

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------



## GRAPHS

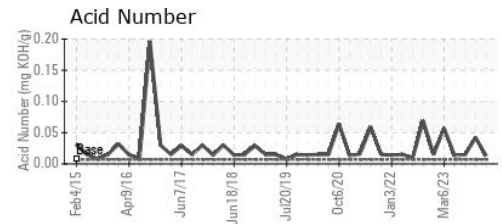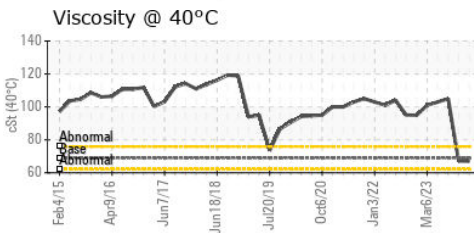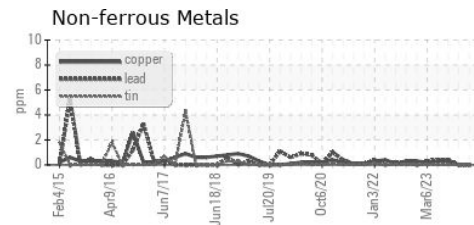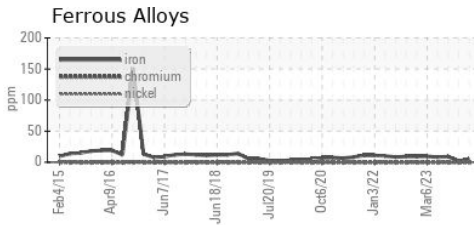

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0897705  
**Lab Number** : **06239193**  
**Unique Number** : 11128027  
**Test Package** : IND 2  
**Received** : 17 Jul 2024  
**Tested** : 18 Jul 2024  
**Diagnosed** : 19 Jul 2024 - Don Baldrige

**LAMB WESTON/RDO**  
 PO BOX 552  
 PARK RAPIDS, MN  
 US 56470

Contact: MICHAEL GRUIS  
 michael.gruis@lambweston.com

T: (218)732-2188

F: (218)732-2175

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)