


OIL ANALYSIS REPORT

Area S-460 **KAESER 2764 - DARWILL** Component Compressor

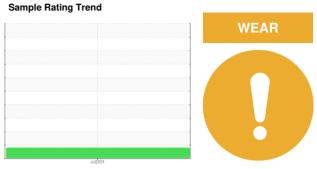

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

The aluminum level is abnormal. All other component wear rates are normal.

Contamination

Moderate concentration of visible dirt/debris present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UDI0000440		
Sample Date		Client Info		08 Jul 2024		
Machine Age	hrs	Client Info		3168		
Oil Age	hrs	Client Info		3168		
Oil Changed		Client Info		Changed		
Sample Status				ATTENTION		
CONTAMINATION	V	method	limit/base	current	history1	history2
Water		WC Method	>0.05	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	2		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	<u> </u>		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	<1		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	90	<1		
Calcium	ppm	ASTM D5185m	2	0		
Phosphorus	ppm	ASTM D5185m		46		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m		464		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1		
Sodium	ppm	ASTM D5185m		2		
Potassium	ppm	ASTM D5185m	>20	1		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.08		



OIL ANALYSIS REPORT

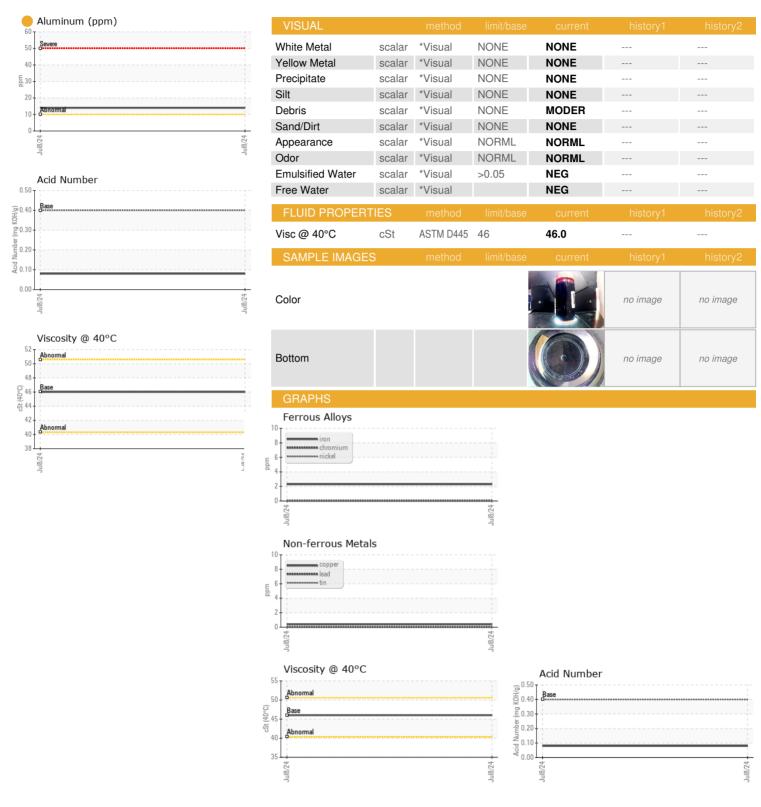





Certificate 12367

Laboratory Sample No.

Lab Number : 06239211 Unique Number : 11128045

: UDI0000440 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 17 Jul 2024

> **Tested** : 18 Jul 2024 Diagnosed : 19 Jul 2024 - Don Baldridge

DELTA INDUSTRIES - DOWNERS GROVE

2201 CURTISS STREET DOWNERS GROVE, IL US 60515

Contact: MICHAEL FERRIS

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (630)960-3931