




# OIL ANALYSIS REPORT

Area  
**KAESER S-460**  
 Machine Id  
**KAESER 1016 - MOREY CORP**  
 Component  
**Compressor**

## Sample Rating Trend

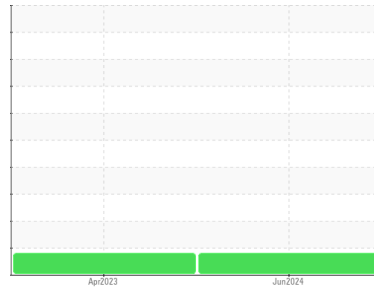

## DIAGNOSIS

### Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

The copper level is abnormal. All other component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UDI0000444</b>	UCH05824478	---
Sample Date	Client Info		<b>28 Jun 2024</b>	07 Apr 2023	---
Machine Age	hrs	Client Info	<b>112359</b>	102276	---
Oil Age	hrs	Client Info	<b>2325</b>	9083	---
Oil Changed	Client Info		<b>Changed</b>	Changed	---
Sample Status			<b>ABNORMAL</b>	ABNORMAL	---

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.05	<b>NEG</b>	NEG	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>2</b>	0	---
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m >3	<b>&lt;1</b>	0	---
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	---
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	0	---
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	---
Copper	ppm	ASTM D5185m >50	<b>▲ 112</b>	<b>▲ 65</b>	---
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	<1	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	---
Barium	ppm	ASTM D5185m 90	<b>122</b>	102	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	---
Magnesium	ppm	ASTM D5185m 90	<b>118</b>	106	---
Calcium	ppm	ASTM D5185m 2	<b>3</b>	0	---
Phosphorus	ppm	ASTM D5185m	<b>4</b>	0	---
Zinc	ppm	ASTM D5185m	<b>0</b>	0	---
Sulfur	ppm	ASTM D5185m	<b>10318</b>	16362	---

## CONTAMINANTS


	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	0	---
Sodium	ppm	ASTM D5185m	<b>25</b>	12	---
Potassium	ppm	ASTM D5185m >20	<b>3</b>	0	---

## FLUID DEGRADATION


	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.51</b>	0.39	---

# OIL ANALYSIS REPORT


### ▲ Non-ferrous Metals

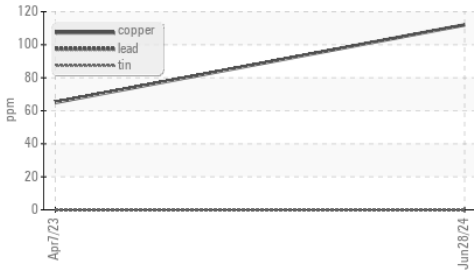

### Acid Number

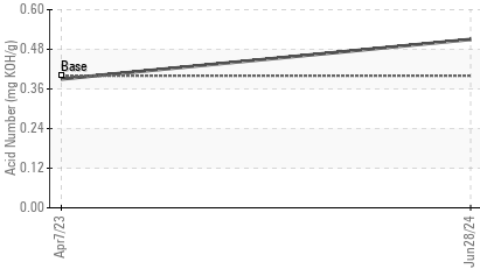


### Viscosity @ 40°C

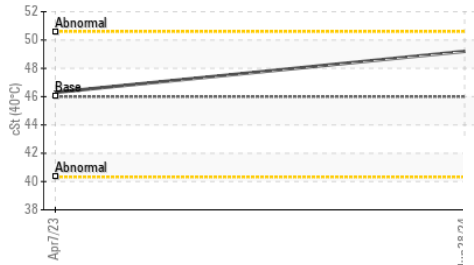





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	LIGHT	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	LIGHT	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	<b>49.2</b>	46.3	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

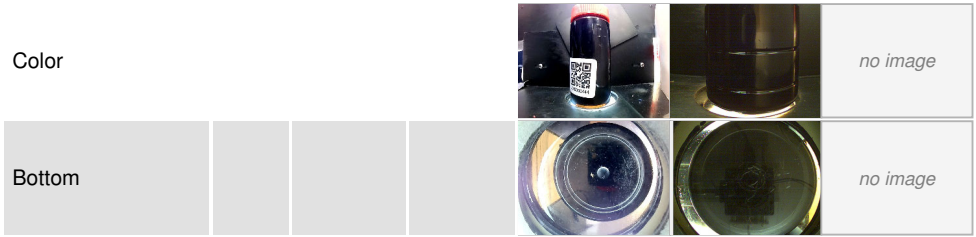

### GRAPHS

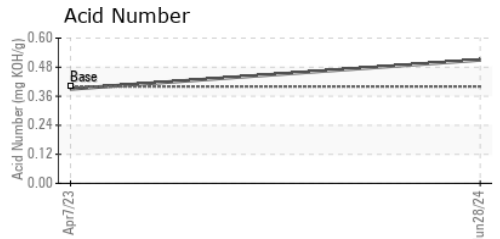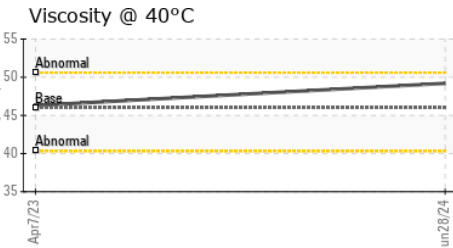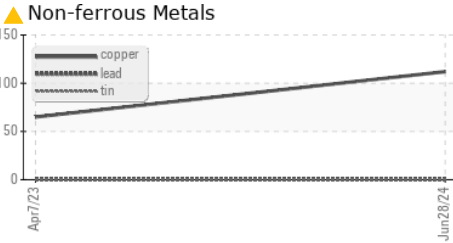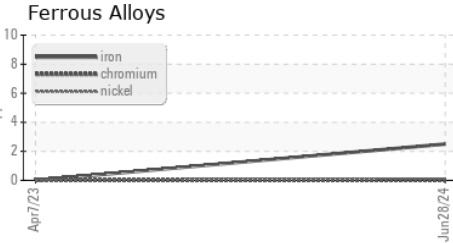

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UDI0000444      **Received** : 17 Jul 2024  
**Lab Number** : **06239221**      **Tested** : 18 Jul 2024  
**Unique Number** : 11128055      **Diagnosed** : 19 Jul 2024 - Sean Felton  
**Test Package** : IND 2

**DELTA INDUSTRIES - DOWNERS GROVE**  
 2201 CURTISS STREET  
 DOWNERS GROVE, IL  
 US 60515  
 Contact: MICHAEL FERRIS

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (630)960-3931