


# **OIL ANALYSIS REPORT**

Area **S-460** [10532]

**KAESER 1054 - AJ ANTONES & CO** 

Component Compressor





## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the


## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


| SAMPLE INFORM    | MATION   | method      | limit/base | current     | history1    | history2    |
|------------------|----------|-------------|------------|-------------|-------------|-------------|
| Sample Number    |          | Client Info |            | UDI0000463  | UCH05907750 | UCH05225809 |
| Sample Date      |          | Client Info |            | 10 Jul 2024 | 17 Jul 2023 | 29 Mar 2021 |
| Machine Age      | hrs      | Client Info |            | 36540       | 30160       | 19952       |
| Oil Age          | hrs      | Client Info |            | 8041        | 4872        | 7125        |
| Oil Changed      |          | Client Info |            | Changed     | Changed     | Changed     |
| Sample Status    |          |             |            | NORMAL      | ATTENTION   | NORMAL      |
| CONTAMINATIO     | N        | method      | limit/base | current     | history1    | history2    |
| Water            |          | WC Method   | >0.05      | NEG         | NEG         | NEG         |
| WEAR METALS      |          | method      | limit/base | current     | history1    | history2    |
| Iron             | ppm      | ASTM D5185m | >50        | 1           | 0           | <1          |
| Chromium         | ppm      | ASTM D5185m | >10        | <1          | 0           | <1          |
| Nickel           | ppm      | ASTM D5185m | >3         | <1          | 0           | <1          |
| Titanium         | ppm      | ASTM D5185m | >3         | <1          | <1          | 0           |
| Silver           | ppm      | ASTM D5185m | >2         | 0           | 0           | 0           |
| Aluminum         | ppm      | ASTM D5185m | >10        | 3           | <1          | 1           |
| Lead             | ppm      | ASTM D5185m | >10        | <1          | 0           | 0           |
| Copper           | ppm      | ASTM D5185m | >50        | 3           | 3           | 6           |
| Tin              | ppm      | ASTM D5185m | >10        | <1          | 0           | <1          |
| Antimony         | ppm      | ASTM D5185m |            |             |             | 1           |
| Vanadium         | ppm      | ASTM D5185m |            | 0           | 0           | 0           |
| Cadmium          | ppm      | ASTM D5185m |            | <1          | 0           | 0           |
| ADDITIVES        |          | method      | limit/base | current     | history1    | history2    |
| Boron            | ppm      | ASTM D5185m |            | 0           | 0           | <1          |
| Barium           | ppm      | ASTM D5185m | 90         | 1           | 4           | <1          |
| Molybdenum       | ppm      | ASTM D5185m |            | <1          | 0           | 0           |
| Manganese        | ppm      | ASTM D5185m |            | <1          | 0           | <1          |
| Magnesium        | ppm      | ASTM D5185m | 90         | 40          | 43          | 23          |
| Calcium          | ppm      | ASTM D5185m | 2          | 0           | 0           | <1          |
| Phosphorus       | ppm      | ASTM D5185m |            | 4           | 0           | 2           |
| Zinc             | ppm      | ASTM D5185m |            | 9           | 0           | 1           |
| Sulfur           | ppm      | ASTM D5185m |            | 18588       | 20604       | 17361       |
| CONTAMINANTS     | ;        | method      | limit/base | current     | history1    | history2    |
| Silicon          | ppm      | ASTM D5185m | >25        | 21          | <b>2</b> 6  | 22          |
| Sodium           | ppm      | ASTM D5185m |            | 11          | 14          | 9           |
| Potassium        | ppm      | ASTM D5185m | >20        | 3           | 0           | <1          |
| FLUID DEGRADA    | ATION    | method      | limit/base | current     | history1    | history2    |
| Acid Number (AN) | mg KOH/g | ASTM D8045  | 0.4        | 0.37        | 0.38        | 0.444       |



# **OIL ANALYSIS REPORT**

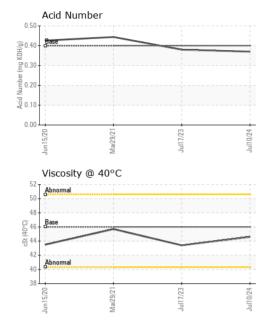

| VISUAL                  |        | method    | limit/base | current | history1 | history2 |
|-------------------------|--------|-----------|------------|---------|----------|----------|
| White Metal             | scalar | *Visual   | NONE       | NONE    | NONE     | NONE     |
| Yellow Metal            | scalar | *Visual   | NONE       | NONE    | NONE     | NONE     |
| Precipitate             | scalar | *Visual   | NONE       | NONE    | NONE     | NONE     |
| Silt                    | scalar | *Visual   | NONE       | NONE    | NONE     | NONE     |
| Debris                  | scalar | *Visual   | NONE       | NONE    | LIGHT    | NONE     |
| Sand/Dirt               | scalar | *Visual   | NONE       | NONE    | NONE     | NONE     |
| Appearance              | scalar | *Visual   | NORML      | NORML   | NORML    | NORML    |
| Odor                    | scalar | *Visual   | NORML      | NORML   | NORML    | NORML    |
| <b>Emulsified Water</b> | scalar | *Visual   | >0.05      | NEG     | NEG      | NEG      |
| Free Water              | scalar | *Visual   |            | NEG     | NEG      | NEG      |
| FLUID PROPERT           | TES    | method    | limit/base | current | history1 | history2 |
| Visc @ 40°C             | cSt    | ASTM D445 | 46         | 44.6    | 43.4     | 45.7     |
| SAMPLE IMAGES           | 3      | method    | limit/base | current | history1 | history2 |
| Color                   |        |           |            |         |          |          |
| Bottom                  |        |           |            |         |          |          |

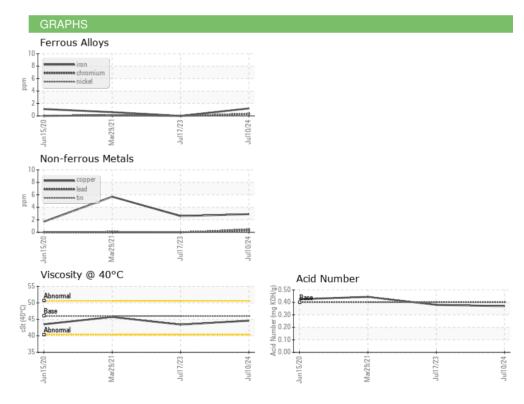





Certificate 12367

Laboratory Sample No. Lab Number : 06239228

Test Package : IND 2

: UDI0000463 Unique Number : 11128062

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received **Tested** 

: 18 Jul 2024 Diagnosed : 18 Jul 2024 - Wes Davis

: 17 Jul 2024

**DELTA INDUSTRIES - DOWNERS GROVE** 

2201 CURTISS STREET DOWNERS GROVE, IL US 60515

Contact: MICHAEL FERRIS

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (630)960-3931 Contact/Location: MICHAEL FERRIS - UCDELDOW

Report Id: UCDELDOW [WUSCAR] 06239228 (Generated: 07/18/2024 11:30:02) Rev: 1