




# OIL ANALYSIS REPORT

## Sample Rating Trend

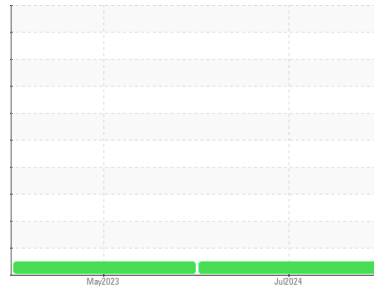

**NORMAL**



Area

**S-460 [10625]**

Machine Id

**KAESER 2943817 - LYON LLC (S/N 1004)**

Component

**Compressor**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UDI0000455</b>	UCH05849822	---
Sample Date	Client Info		<b>11 Jul 2024</b>	02 May 2023	---
Machine Age	hrs	Client Info	<b>68354</b>	64000	---
Oil Age	hrs	Client Info	<b>4009</b>	5600	---
Oil Changed	Client Info		<b>Changed</b>	Changed	---
Sample Status			<b>NORMAL</b>	NORMAL	---

### CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.05	<b>NEG</b>	NEG	---

### WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>&lt;1</b>	0	---
Chromium	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	---
Nickel	ppm	ASTM D5185m >3	<b>&lt;1</b>	0	---
Titanium	ppm	ASTM D5185m >3	<b>&lt;1</b>	0	---
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m >10	<b>3</b>	0	---
Lead	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	---
Copper	ppm	ASTM D5185m >50	<b>10</b>	10	---
Tin	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	0	---

### ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	---
Barium	ppm	ASTM D5185m 90	<b>&lt;1</b>	0	---
Molybdenum	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	---
Magnesium	ppm	ASTM D5185m 90	<b>33</b>	19	---
Calcium	ppm	ASTM D5185m 2	<b>0</b>	0	---
Phosphorus	ppm	ASTM D5185m	<b>8</b>	2	---
Zinc	ppm	ASTM D5185m	<b>16</b>	5	---
Sulfur	ppm	ASTM D5185m	<b>18928</b>	20573	---


### CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	0	---
Sodium	ppm	ASTM D5185m	<b>11</b>	9	---
Potassium	ppm	ASTM D5185m >20	<b>3</b>	2	---

### FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.26</b>	0.24	---


# OIL ANALYSIS REPORT

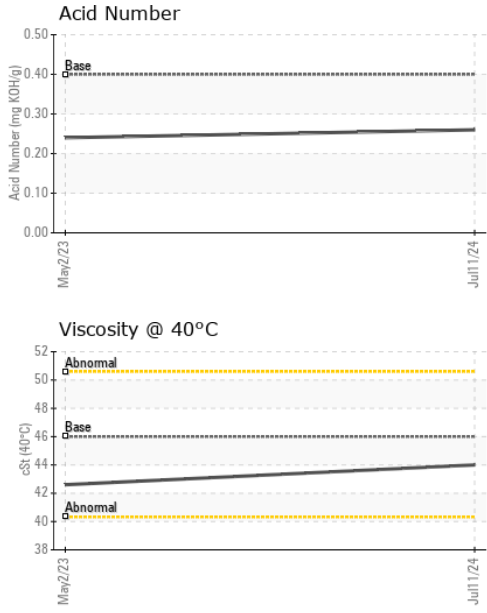





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	LIGHT	---
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	LIGHT	---
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	---
Free Water	scalar	*Visual		NEG	NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	46	<b>44.0</b>	42.6	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

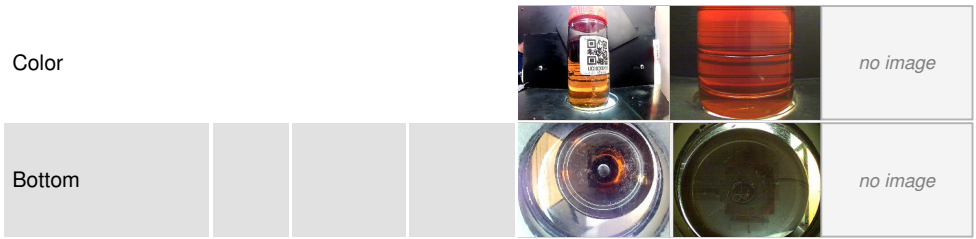

## GRAPHS

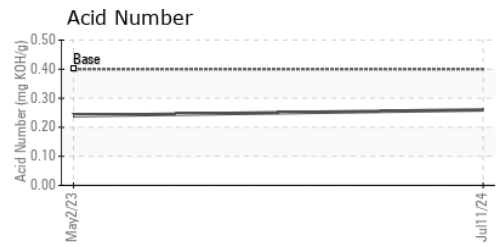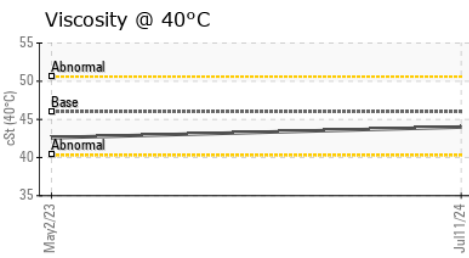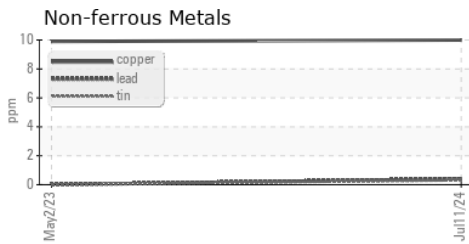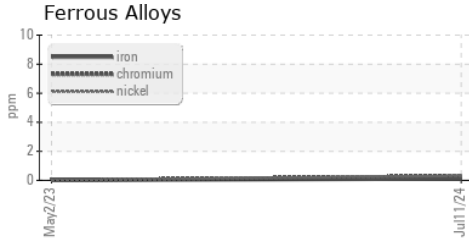

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UDI0000455      **Received** : 17 Jul 2024  
**Lab Number** : **06239242**      **Tested** : 18 Jul 2024  
**Unique Number** : 11128076      **Diagnosed** : 18 Jul 2024 - Wes Davis  
**Test Package** : IND 2

**DELTA INDUSTRIES - DOWNERS GROVE**  
 2201 CURTISS STREET  
 DOWNERS GROVE, IL  
 US 60515  
 Contact: MICHAEL FERRIS

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (630)960-3931