




# OIL ANALYSIS REPORT



Machine Id  
**JENBACHER GM03 (S/N 1144731)**  
 Component  
**Biogas Engine**  
 Fluid  
**MAHLER Q8 Mahler G8 SAE 40 (--- GAL)**

Sample Rating Trend

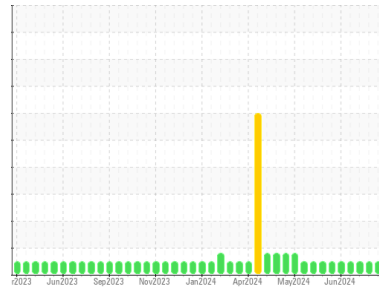

**NORMAL**



## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0944681</b>	WC0944677	WC0944675
Sample Date	Client Info		<b>15 Jul 2024</b>	01 Jul 2024	24 Jun 2024
Machine Age	hrs	Client Info	<b>52769</b>	52564	52412
Oil Age	hrs	Client Info	<b>1170</b>	965	813
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method	>.2	<b>NEG</b>	NEG	NEG
Glycol	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	<b>8</b>	5	6
Chromium	ppm	ASTM D5185m >5	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m >2	<b>&lt;1</b>	0	<1
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m >5	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >15	<b>3</b>	2	3
Lead	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m >15	<b>2</b>	0	1
Tin	ppm	ASTM D5185m >5	<b>3</b>	3	1
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	<1
Barium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m	<b>6</b>	7	9
Calcium	ppm	ASTM D5185m	<b>2354</b>	2471	2439
Phosphorus	ppm	ASTM D5185m	<b>381</b>	428	436
Zinc	ppm	ASTM D5185m	<b>470</b>	475	485
Sulfur	ppm	ASTM D5185m	<b>2521</b>	3040	2983

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >200	<b>25</b>	22	22
Sodium	ppm	ASTM D5185m >20	<b>0</b>	2	3
Potassium	ppm	ASTM D5185m >20	<b>2</b>	<1	2

## INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844 >2	<b>0</b>	0.1	0
Nitration	Abs/cm	*ASTM D7624 >20	<b>7.3</b>	7.5	7.4
Sulfation	Abs/.1mm	*ASTM D7415 >30	<b>17.2</b>	17.0	16.6


## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	<b>12.3</b>	12.6	12.2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.53</b>	0.92	0.81
Base Number (BN)	mg KOH/g	ASTM D2896 8.0	<b>6.83</b>	6.54	6.63




# OIL ANALYSIS REPORT


FT-IR (Direct Trend)

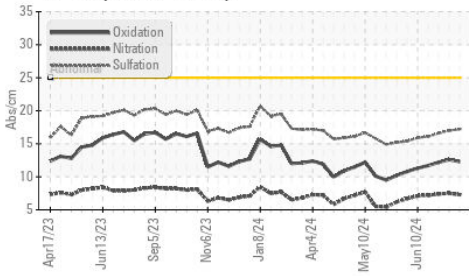


Acid Number

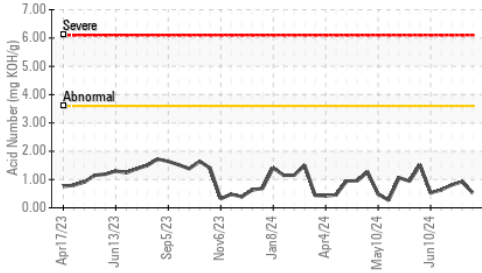

Base Number

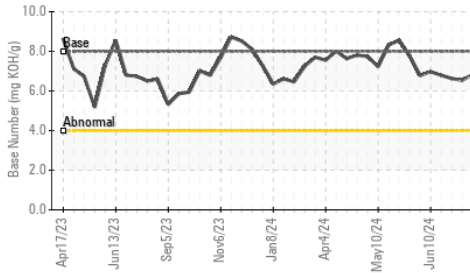

Viscosity @ 100°C

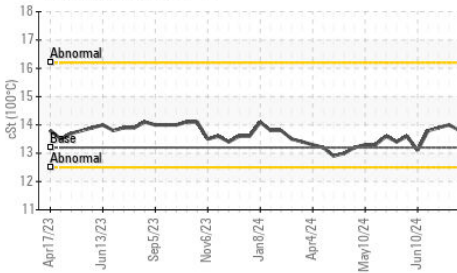


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	13.2	<b>13.8</b>	14.0	13.9

## GRAPHS


Iron (ppm)

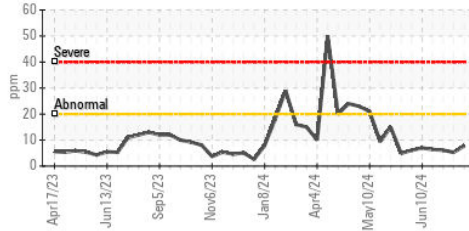


Lead (ppm)

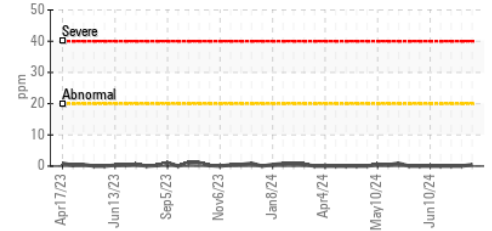


Aluminum (ppm)

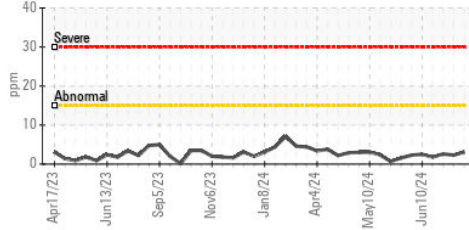


Chromium (ppm)

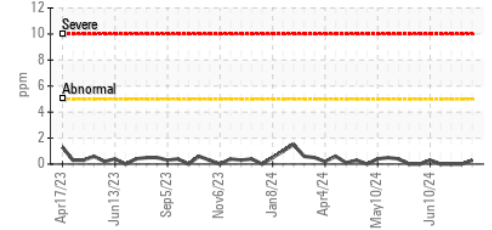


Copper (ppm)

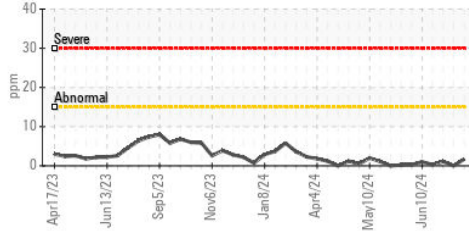


Silicon (ppm)

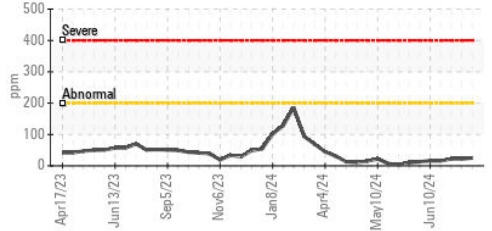

Viscosity @ 100°C

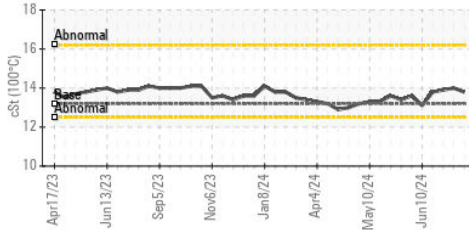

Base Number

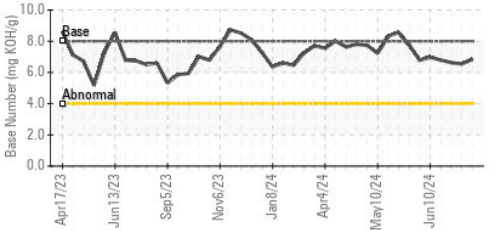

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0944681

Lab Number : 06239316

Unique Number : 11128150

Test Package : MOB 2

Received : 17 Jul 2024

Tested : 18 Jul 2024

Diagnosed : 19 Jul 2024 - Sean Felton

**PINE RIDGE**

105 BAILEY JESTER RD

GRIFFIN, GA

US 30224

Contact: STEPHEN SAVAGE

stephen.savage@cubedistrictenergy.com

T:

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)