


OIL ANALYSIS REPORT

Sample Rating Trend

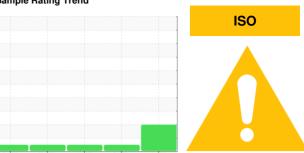

Machine Id

KAESER DSD 175 7364716 (S/N 1120)

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Sep2021	May2022	Jun 2023 Feb 2024	Jun 2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA019097	KCPA014206	KCPA002437
Sample Date		Client Info		21 Jun 2024	16 Feb 2024	07 Jun 2023
Machine Age	hrs	Client Info		26071	24248	19365
Oil Age	hrs	Client Info		1900	8000	0
Oil Changed		Client Info		Not Changd	Changed	N/A
Sample Status				ABNORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	<1
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	<1	0
Lead	ppm	ASTM D5185m	>10	0	<1	0
Copper	ppm	ASTM D5185m	>50	7	2	7
Tin	ppm	ASTM D5185m	>10	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	11	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m	90	9	<1	0
Calcium	ppm	ASTM D5185m	2	0	0	0
Phosphorus	ppm	ASTM D5185m		0	<1	1
Zinc	ppm	ASTM D5185m		2	0	0
Sulfur	ppm	ASTM D5185m		17657	7702	18452
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	<1
Sodium	ppm	ASTM D5185m		2	<1	<1
Potassium	ppm	ASTM D5185m	>20	0	<1	2
Water	%	ASTM D6304	>0.05	0.013	0.004	0.008
ppm Water	ppm	ASTM D6304	>500	135	43	81.2
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		12680	508	1029
Particles >6µm		ASTM D7647	>1300	4434	110	252
Particles >14µm		ASTM D7647	>80	529	16	17
Particles >21µm		ASTM D7647	>20	188	6	6
Particles >38µm		ASTM D7647	>4	<u> </u>	1	1
Particles >71µm		ASTM D7647	>3	1	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 21/19/16	16/14/11	17/15/11
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.42	0.46	0.45



OIL ANALYSIS REPORT







Certificate 12367

Laboratory Sample No.

: KCPA019097 Lab Number : 06239586 Unique Number : 11128420

Received **Tested**

: 17 Jul 2024 : 18 Jul 2024 Diagnosed Test Package : IND 2 (Additional Tests: KF, PrtCount)

: 19 Jul 2024 - Don Baldridge

US 31634 Contact: JUSTIN BRIDGES justin.bridges@mauserpackaging.com

1601 VALDOSTA HWY

HOMERVILLE, GA

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: BWAHOM [WUSCAR] 06239586 (Generated: 07/19/2024 14:34:19) Rev: 1

T:

F: