




OIL ANALYSIS REPORT

Sample Rating Trend

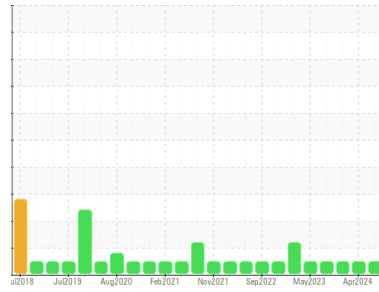

NORMAL



Machine Id
INGERSOLL RAND PARFRY CENTER 2 (S/N EE4219U17060)
 Component
Air Compressor
 Fluid
USPI AIR 46 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. Please note that this is a corrected copy for laboratory elemental data updates.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		USPM37060	USPM36625	USPM31770
Sample Date	Client Info		16 Jul 2024	02 Apr 2024	14 Dec 2023
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			NORMAL	NORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	<1	0
Chromium	ppm	ASTM D5185m >4	<1	<1	0
Nickel	ppm	ASTM D5185m >4	0	<1	<1
Titanium	ppm	ASTM D5185m	0	<1	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >10	1	0	0
Lead	ppm	ASTM D5185m >20	0	<1	0
Copper	ppm	ASTM D5185m >40	0	<1	0
Tin	ppm	ASTM D5185m >5	0	<1	<1
Vanadium	ppm	ASTM D5185m	0	<1	0
Cadmium	ppm	ASTM D5185m	0	<1	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<1	0	0
Barium	ppm	ASTM D5185m 0	0	0	0
Molybdenum	ppm	ASTM D5185m 0	0	<1	0
Manganese	ppm	ASTM D5185m	0	<1	<1
Magnesium	ppm	ASTM D5185m 0	<1	<1	1
Calcium	ppm	ASTM D5185m 0	0	0	0
Phosphorus	ppm	ASTM D5185m 1	14	9	10
Zinc	ppm	ASTM D5185m 0	0	0	0
Sulfur	ppm	ASTM D5185m 0	0	0	<1

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	<1	0
Sodium	ppm	ASTM D5185m	0	<1	<1
Potassium	ppm	ASTM D5185m >20	<1	<1	2
Water	%	ASTM D6304 >0.2	0.087	0.040	0.036
ppm Water	ppm	ASTM D6304 >2000	878	401	367

FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	712	3002	912
Particles >6µm	ASTM D7647	>2500	278	1133	321
Particles >14µm	ASTM D7647	>320	35	142	38
Particles >21µm	ASTM D7647	>80	9	37	9
Particles >38µm	ASTM D7647	>20	0	1	0
Particles >71µm	ASTM D7647	>4	0	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	17/15/12	19/17/14	17/16/12

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.05	0.29	0.25	0.20



OIL ANALYSIS REPORT

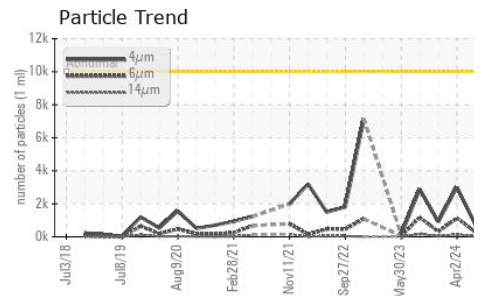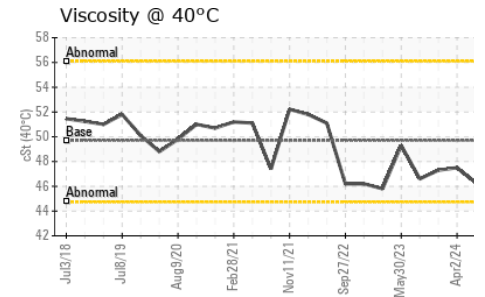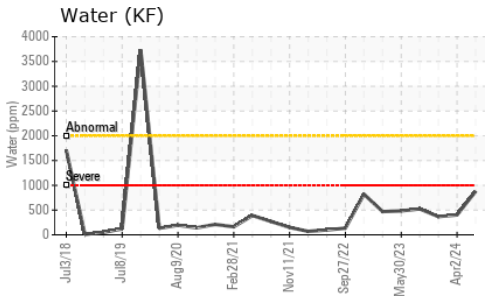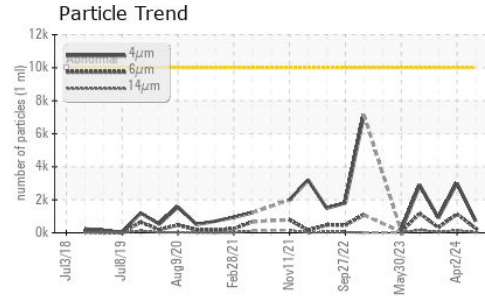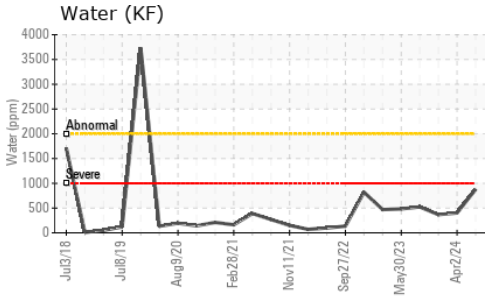

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	49.7	46.3	47.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------






Color



Bottom



GRAPHS

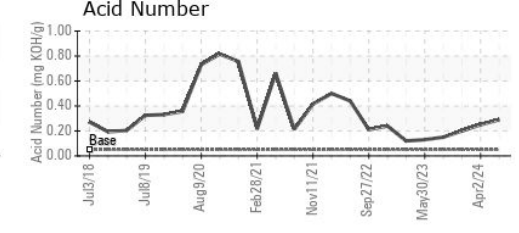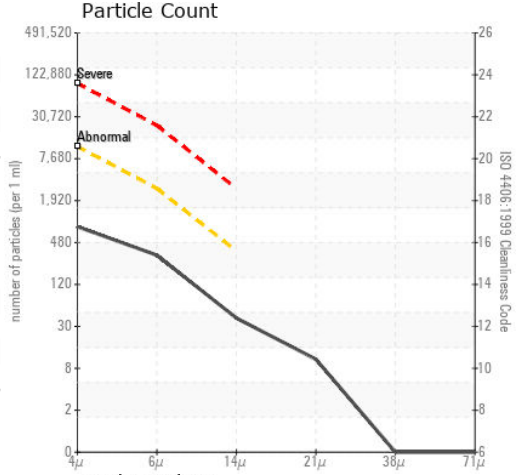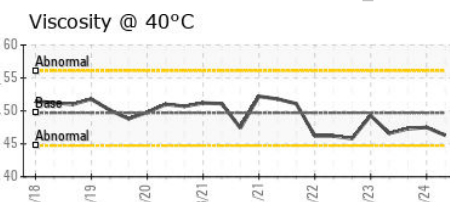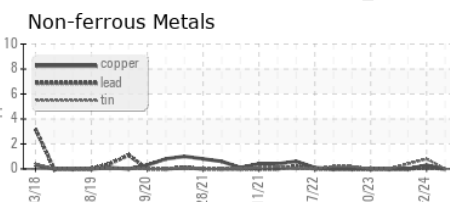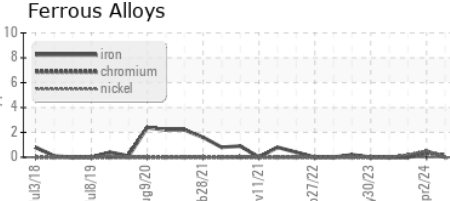

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : USPM37060
 Lab Number : 06239593
 Unique Number : 11128427
 Test Package : IND 2

Received : 17 Jul 2024
 Tested : 22 Jul 2024
 Diagnosed : 22 Jul 2024 - Doug Bogart

TYSON FOODS-GREEN FOREST-PRE
 601 TYSON DRIVE
 GREEN FOREST, AR
 US 72638
 Contact: DANNY SAUL
 dale.west@tyson.com
 T: (870)438-5211
 F: (870)438-7194

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)