


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id

GEA PAR FRY LS-2

Component Refrigeration Compressor

USPI ALT-68 SC (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


		pr2018 Mar2i	019 Jan 2020 Dec 2020	May2021 Feb2022 Jan2023	Dec2023	
SAMPLE INFORM	MOITAN	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0014993	USP0008037	USP0004221
Sample Date		Client Info		16 Jul 2024	02 Apr 2024	14 Dec 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	0	<1	0
Chromium	ppm	ASTM D5185m	>2	0	<1	0
Nickel	ppm	ASTM D5185m		0	<1	<1
Titanium	ppm	ASTM D5185m		0	<1	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	0	0	0
Lead	ppm	ASTM D5185m	>2	0	<1	0
Copper	ppm	ASTM D5185m	>8	0	<1	0
Tin	ppm	ASTM D5185m	>4	0	<1	0
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	ppm	ASTM D5185m		0	<1	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	<1	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m		0	<1	<1
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m		0	0	1
Zinc	ppm	ASTM D5185m		2	0	0
Sulfur	ppm	ASTM D5185m	50	8	0	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	2	3	2
Sodium	ppm	ASTM D5185m		<1	<1	0
Potassium	ppm	ASTM D5185m	>20	0	<1	2
Water	%	ASTM D6304	>0.01	0.004	0.008	0.005
ppm Water	ppm	ASTM D6304	>100	42	87	50
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		4760	6086	6411
Particles >6µm		ASTM D7647	>2500	1155	1387	1809
Particles >14µm		ASTM D7647	>320	52	46	46
Particles >21µm		ASTM D7647	>80	10	8	5
Particles >38µm		ASTM D7647	>20	0	0	0
Particles >71μm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/18/15	19/17/13	20/18/13	20/18/13
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.014	0.015	0.014





OIL ANALYSIS REPORT











VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	TEC.	method	limit/hase	current	history1	history2

I LOID I HOLL	LITTILO	memou			HISTORY	Tilotol y Z
Visc @ 40°C	cSt	ASTM D445	65.6	63.8	65.4	64.8

\circ	אוחו ד	11111	\sim \sim
$\sim A \Lambda$	11 P. I. P.	пила	GES

Color












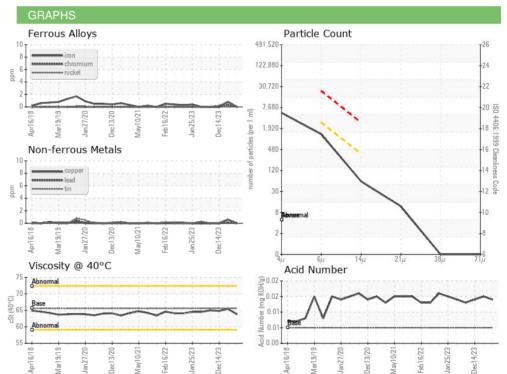





Certificate 12367

Laboratory Sample No.

Lab Number : 06239598

Test Package : IND 2

: USP0014993 Unique Number : 11128432

: WearCheck USA - 501 Madison Ave., Cary, NC 27513

Received : 17 Jul 2024 **Tested** : 18 Jul 2024 Diagnosed

: 18 Jul 2024 - Doug Bogart

GREEN FOREST, AR US

Contact: SERVICE MANAGER

TYSON FOODS-GREEN FOREST-USP

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: