


OIL ANALYSIS REPORT







Machine Id **PHILADELPHIA**

Component Hydraulic System

TENA-FILM 300 LTH ISO 46 (60 GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible. The system cleanliness is above the acceptable limit for the target ISO 4406 cleanliness code.


Fluid Condition

The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

				Jun 2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0933705		
Sample Date		Client Info		19 Jun 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	0		
Chromium	ppm	ASTM D5185m	>20	<1		
Nickel	ppm	ASTM D5185m	>20	0		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m		<1		
Aluminum	ppm	ASTM D5185m	>20	4		
Lead	ppm	ASTM D5185m	>20	0		
Copper	ppm	ASTM D5185m	>20	<1		
Tin	ppm	ASTM D5185m	>20	<1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		<1		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		<1		
Calcium	ppm	ASTM D5185m		20		
Phosphorus	ppm	ASTM D5185m		353		
Zinc	ppm	ASTM D5185m		417		
Sulfur	ppm	ASTM D5185m		2716		
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	2		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	<1		
Water	%	ASTM D6304	>0.05	0.005		
ppm Water	ppm	ASTM D6304	>500	54		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>1300	<u> </u>		
Particles >6µm		ASTM D7647	>320	<u>2235</u>		
Particles >14µm		ASTM D7647	>40	7 0		
Particles >21µm		ASTM D7647	>10	10		
Particles >38µm		ASTM D7647	>3	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>17/15/12	<u>^</u> 20/18/13		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.47		



OIL ANALYSIS REPORT

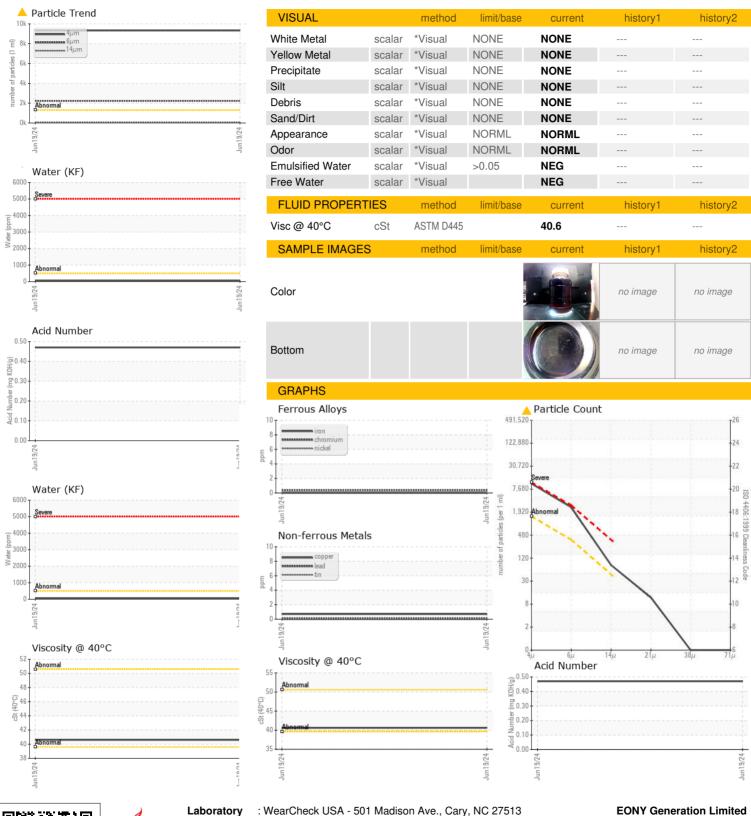





Certificate 12367

Laboratory Sample No.

Lab Number Unique Number : 11129163

: WC0933705 : 06240329

Received **Tested** Diagnosed : 19 Jul 2024 - Wes Davis

: 18 Jul 2024

: 19 Jul 2024

Test Package : IND 2 (Additional Tests: KF)

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. **EONY Generation Limited**

7659 Lyonsdale Road Lyons Falls, NY US 13368

Contact: RODNEY FOSTER rodfoster@energyottawa.com T: (613)738-5499

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)