


OIL ANALYSIS REPORT

Sample Rating Trend

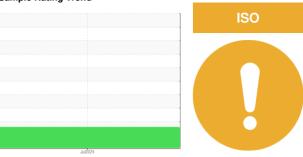

Machine Id

KAESER 5362403

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jul2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA018119		
Sample Date		Client Info		08 Jul 2024		
Machine Age	hrs	Client Info		50131		
Oil Age	hrs	Client Info		3000		
Oil Changed		Client Info		Changed		
Sample Status				ATTENTION		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm		>10	<1		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m	>2	<1		
Aluminum		ASTM D5185m		4		
Lead	ppm	ASTM D5185m	>10	0		
	ppm			11		
Copper	ppm	ASTM D5185m				
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		<1		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	90	<1		
Calcium	ppm	ASTM D5185m	2	0		
Phosphorus	ppm	ASTM D5185m		0		
Zinc	ppm	ASTM D5185m		5		
Sulfur	ppm	ASTM D5185m		14373		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m	720	0		
Potassium	ppm	ASTM D5185m	>20	<1		
Water	%	ASTM D6304	>0.05	0.011		
ppm Water	ppm	ASTM D6304	>500	116		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2969		
Particles >6µm		ASTM D7647	>1300	1347		
Particles >14µm		ASTM D7647	>80	115		
Particles >14µm		ASTM D7647	>20	32		
Particles >38µm		ASTM D7647	>4	2		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/18/14		
	TION					history?
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.38		



OIL ANALYSIS REPORT

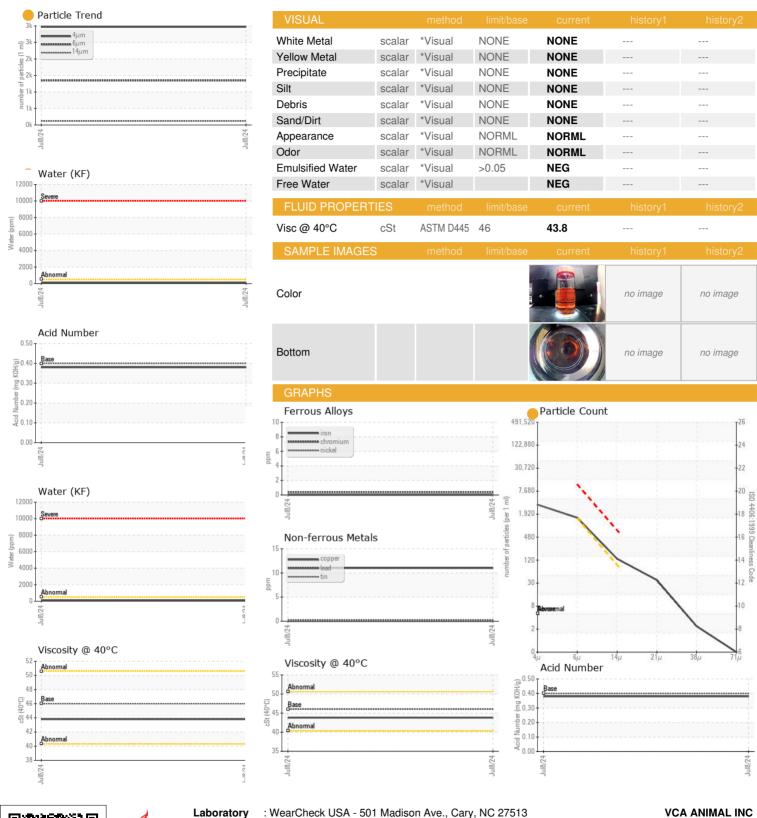



Certificate 12367

Laboratory Sample No.

: KCPA018119 Lab Number : 06240335

Received **Tested** Unique Number : 11129169 Diagnosed

: 20 Jul 2024 - Don Baldridge Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

: 18 Jul 2024

: 19 Jul 2024

Report Id: VCASAN [WUSCAR] 06240335 (Generated: 07/21/2024 11:17:39) Rev: 1

Contact/Location: Service Manager - VCASAN

2317 HOTEL CIR S

Contact: Service Manager

SAN DIEGO, CA

US 92108

T:

F: