

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

KAESER 8059704

Component Compressor Fluid KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA018202	KCPA000103	
Sample Date		Client Info		12 Jul 2024	26 Apr 2023	
Machine Age	hrs	Client Info		13574	6473	
Oil Age	hrs	Client Info		0	0	
Oil Changed		Client Info		Changed	N/A	
Sample Status				NORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	<1	0	
Nickel	ppm	ASTM D5185m	>3	0	<1	
Titanium	ppm	ASTM D5185m	>3	<1	0	
Silver		ASTM D5185m	>2	<1	0	
	ppm			4		
Aluminum	ppm	ASTM D5185m	>10		3	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm		>50	12	6	
Tin	ppm	ASTM D5185m	>10	<1	0	
Vanadium	ppm	ASTM D5185m		<1	0	
Cadmium	ppm	ASTM D5185m		<1	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m	0	<1	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	100	2	2	
Calcium	ppm	ASTM D5185m	0	0	0	
Phosphorus	ppm	ASTM D5185m	0	0	1	
Zinc	ppm	ASTM D5185m	0	88	98	
Sulfur	ppm	ASTM D5185m	23500	18382	16346	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	
Sodium	ppm	ASTM D5185m		0	0	
Potassium	ppm	ASTM D5185m	>20	1	<1	
Water	%	ASTM D6304	>0.05	0.010	0.008	
ppm Water	ppm	ASTM D6304	>500	109	85.7	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		4264	3664	
Particles >6µm		ASTM D7647	>1300	1143	820	
Particles >14µm		ASTM D7647	>80	60	32	
Particles >21µm		ASTM D7647	>20	9	6	
Particles >38µm		ASTM D7647	>4	1	0	
Particles >71µm		ASTM D7647		0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/13	19/17/12	
FLUID DEGRADA		method	limit/base	current	history1	history2
			1.0	0.48	0.44	
Acid Number (AN)	mg KOH/g	AO INI DOU40	1.0	U. 1 0	0.44	




OIL ANALYSIS REPORT





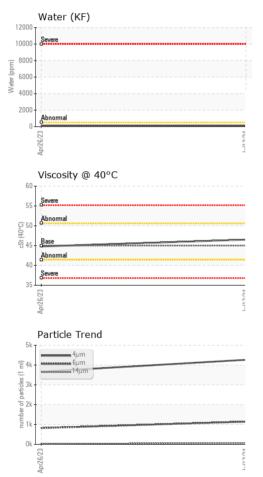

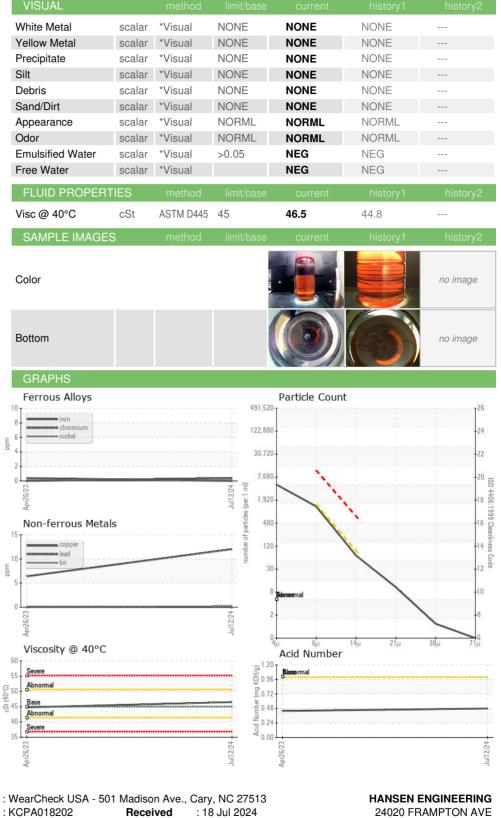



Lab Number Tested : 19 Jul 2024 : 06240341 : 20 Jul 2024 - Don Baldridge Unique Number : 11129175 Diagnosed Test Package : IND 2 (Additional Tests: KF, PrtCount) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

24020 FRAMPTON AVE

Laboratory

Sample No.

Contact/Location: Service Manager - HANHAR

Page 2 of 2

T:

F: