

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

KAESER 5867235

Component Compressor Fluid KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA020786		
Sample Date		Client Info		12 Jul 2024		
Machine Age	hrs	Client Info		14377		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Changed		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	<1		
Aluminum	ppm	ASTM D5185m	>10	4		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	12		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	<1		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	100	<1		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	0		
Zinc	ppm	ASTM D5185m	0	7		
Sulfur	ppm	ASTM D5185m	23500	18882		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	<1		
Water	%	ASTM D6304	>0.05	0.012		
ppm Water	ppm	ASTM D6304	>500	125		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		8253		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14µm		ASTM D7647	>80	<mark>人</mark> 196		
Particles >21µm		ASTM D7647	>20	<u> </u>		
Particles >38µm		ASTM D7647	>4	4		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	A 20/19/15		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.42		



OIL ANALYSIS REPORT

10k -	Particle Trend	VISU
; 〒 8k・	4μm	White M
[]]]		Yellow I
- yg ek		Precipit
number of particles (1 ml) 8 k 8 k 8 k 8 k		Silt
The 2k-		Debris
0k ·		Sand/D
	Jul12/24 Jul12/24	Appear
		Odor
	Water (KF)	Emulsif
12000		Free W
10000	Severe	FLUI
(n 8000 ·		Visc @
(mqq) after (ppm)		
4000		SAMF
2000	Abnormal	
0.	24	Color
	Jull 2/24	00101
1.20	Acid Number	
1111111111111	Basermal	Bottom
KOH/6		
(B) 0.96 0.72 0.48 0.48 0.48		GRAF
quny N		Ferro
Pio 0.24		¹⁰ L
0.00		8-
	Juli 2/24	E 6-
	ليار ١٠٠٠	-
	Water (KF)	2
12000	0	2/24



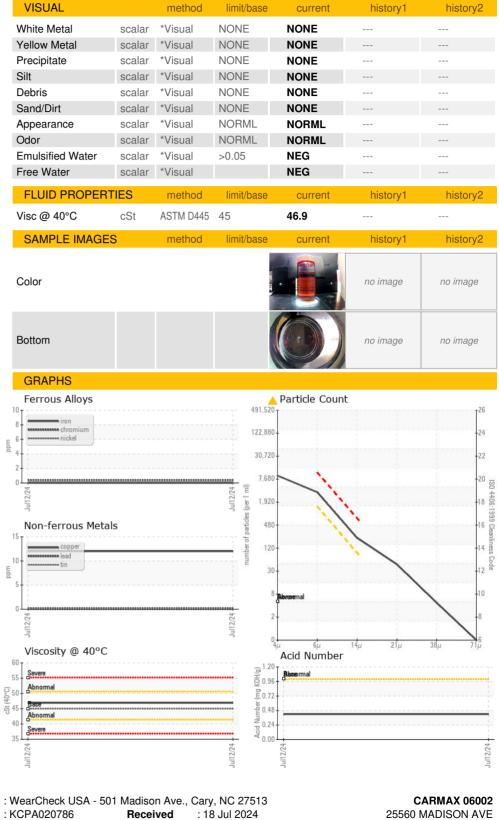




Lab Number : 06240343 Tested : 19 Jul 2024 : 20 Jul 2024 - Don Baldridge Unique Number : 11129177 Diagnosed Test Package : IND 2 (Additional Tests: KF, PrtCount) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

ŝ

Laboratory

Sample No.



T:

F:

Report Id: CARMUR [WUSCAR] 06240343 (Generated: 07/21/2024 11:16:05) Rev: 1

Contact/Location: Service Manager - CARMUR Page 2 of 2