


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id

8341648 (S/N 1056) Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Sep	2022	Nov2023 Jul2i	24	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC130928	KC122958	KC85948
Sample Date		Client Info		09 Jul 2024	28 Nov 2023	20 Sep 2022
Machine Age	hrs	Client Info		2225	1905	815
Oil Age	hrs	Client Info		3000	0	815
Oil Changed		Client Info		Changed	N/A	Changed
Sample Status				NORMAL	ATTENTION	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	<1
Chromium	ppm	ASTM D5185m	>10	<1	<1	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	<1	<1	0
Silver	ppm	ASTM D5185m	>2	<1	0	0
Aluminum	ppm	ASTM D5185m	>10	4	2	0
Lead	ppm	ASTM D5185m	>10	0	0	<1
Copper	ppm	ASTM D5185m	>50	2	3	1
Tin	ppm	ASTM D5185m	>10	<1	0	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	5	9
Molybdenum	ppm	ASTM D5185m		<1	0	0
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m	90	63	59	71
Calcium	ppm	ASTM D5185m	2	0	0	1
Phosphorus	ppm	ASTM D5185m		0	31	3
Zinc	ppm	ASTM D5185m		10	2	7
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	<1
Sodium	ppm	ASTM D5185m		7	12	8
Potassium	ppm	ASTM D5185m	>20	19	34	11
Water	%	ASTM D6304	>0.05	0.025	0.025	0.024
ppm Water	ppm	ASTM D6304	>500	259	255	245.1
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		853	3304	2239
Particles >6µm		ASTM D7647		267	829	640
Particles >14µm		ASTM D7647	>80	15	85	37
Particles >21µm		ASTM D7647		4	20	8
Particles >38µm		ASTM D7647	>4	0	0	1
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/15/11	19/17/14	18/16/12
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
	1/011/	10T11 D0015				

Acid Number (AN)

mg KOH/g ASTM D8045 0.4


0.30

0.34

0.36



OIL ANALYSIS REPORT

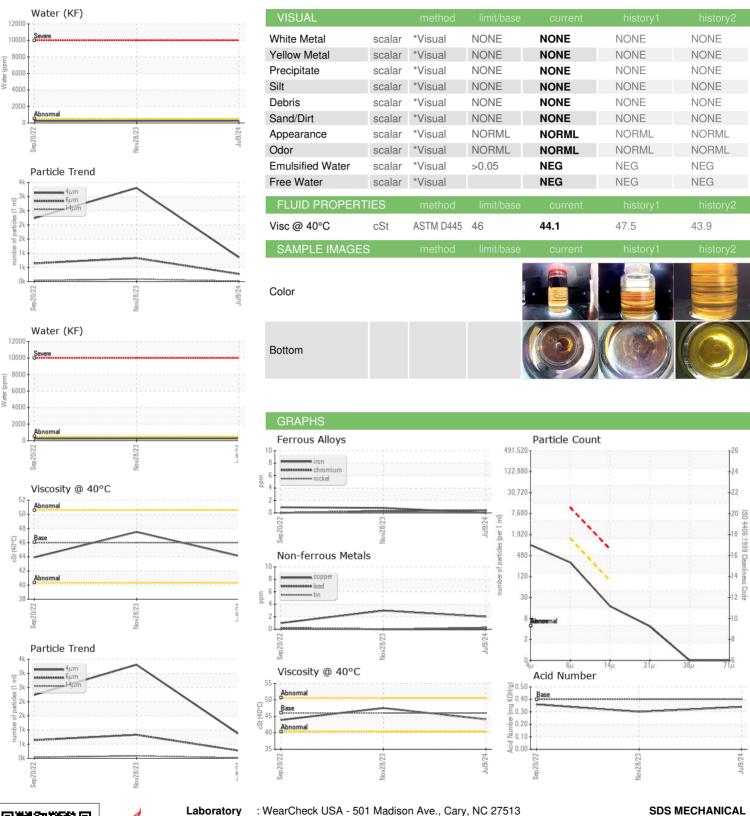





Certificate 12367

Sample No. Lab Number

Unique Number : 11129179

: KC130928 : 06240345 Test Package : IND 2

Received : 18 Jul 2024 **Tested** : 19 Jul 2024

Diagnosed : 20 Jul 2024 - Don Baldridge

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F:

10390 ASHEVILLE HWY

Contact: Service Manager

INMAN, SC

US 29349