

# **OIL ANALYSIS REPORT**

Sample Rating Trend



Machine Id

# KAESER 8337044 (S/N 2208)

Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

### Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jun2024		
SAMPLE INFORM	MATION	mothed	limit/boas	Ol kkont	history	hietery
	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA018412		
Sample Date		Client Info		14 Jun 2024		
Machine Age	hrs	Client Info		4234		
Oil Age	hrs	Client Info		3000		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	<1		
Aluminum	ppm	ASTM D5185m	>10	4		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	8		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	<1		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	100	16		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	2		
Zinc	ppm	ASTM D5185m	0	12		
Sulfur	ppm	ASTM D5185m	23500	18961		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	3		
Water	%	ASTM D6304	>0.05	0.015		
ppm Water	ppm	ASTM D6304	>500	159		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		1822		
Particles >6μm		ASTM D7647	>1300	703		
Particles >14μm		ASTM D7647	>80	32		
Particles >21µm		ASTM D7647	>20	4		
Particles >38µm		ASTM D7647	>4	1		
Particles >71μm		ASTM D7647		0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/17/12		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.40		



## **OIL ANALYSIS REPORT**

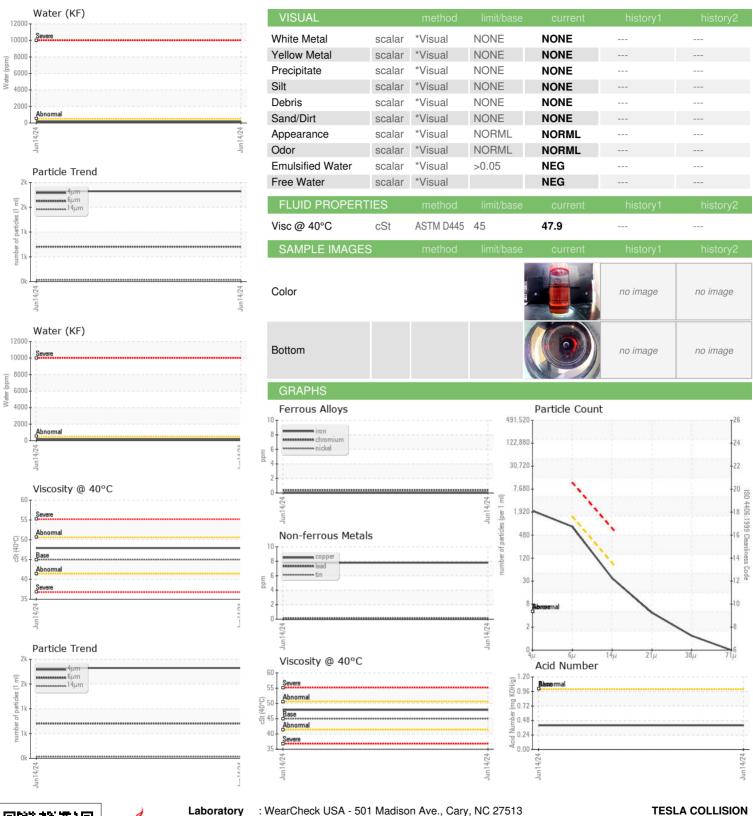



Sample No.

: KCPA018412 Lab Number : 06240353 Unique Number: 11129187

Received **Tested** Diagnosed

: 18 Jul 2024 : 19 Jul 2024 : 19 Jul 2024 - Doug Bogart 1825 CORPORATE CENTER DR OCEANSIDE, CA

US 92056 Contact: Service Manager

Test Package : IND 2 ( Additional Tests: KF, PrtCount ) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: Service Manager - TESOCE

T:

F: