




OIL ANALYSIS REPORT

Sample Rating Trend

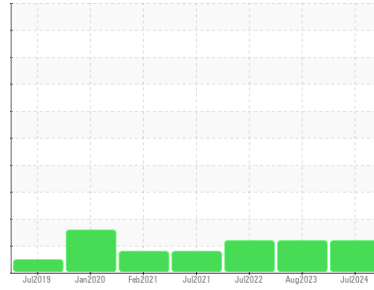

ISO



Area

Recovery

Pro Quip FFI56GB01 Standardization Tank, Agitator

Machine Id

Component

Gearbox

Fluid

JAX MAGNA-PLATE 460 FG (7 GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0901926	WC0827148	WC0706866
Sample Date	Client Info	16 Jul 2024	11 Aug 2023	13 Jul 2022
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >200	58	61	74
Chromium	ppm	ASTM D5185m >15	<1	0	0
Nickel	ppm	ASTM D5185m >15	0	0	0
Titanium	ppm	ASTM D5185m	<1	<1	<1
Silver	ppm	ASTM D5185m	<1	0	0
Aluminum	ppm	ASTM D5185m >25	4	<1	<1
Lead	ppm	ASTM D5185m >100	0	0	<1
Copper	ppm	ASTM D5185m >200	<1	<1	0
Tin	ppm	ASTM D5185m >25	<1	0	0
Vanadium	ppm	ASTM D5185m	<1	<1	0
Cadmium	ppm	ASTM D5185m	<1	<1	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	2
Barium	ppm	ASTM D5185m	0	<1	0
Molybdenum	ppm	ASTM D5185m	<1	0	0
Manganese	ppm	ASTM D5185m	<1	1	<1
Magnesium	ppm	ASTM D5185m	<1	7	<1
Calcium	ppm	ASTM D5185m	0	2	4
Phosphorus	ppm	ASTM D5185m	676	567	801
Zinc	ppm	ASTM D5185m	4	18	<1
Sulfur	ppm	ASTM D5185m	691	681	1018

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >50	3	2	3
Sodium	ppm	ASTM D5185m	0	1	0
Potassium	ppm	ASTM D5185m >20	1	<1	<1
Water	%	ASTM D6304 >0.2	0.005	0.007	0.012
ppm Water	ppm	ASTM D6304 >2000	54	77.3	125.0

FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >20000	▲ 81169	▲ 121983	▲ 146691
Particles >6µm	ASTM D7647 >5000	▲ 10770	▲ 10045	▲ 33615
Particles >14µm	ASTM D7647 >640	32	50	66
Particles >21µm	ASTM D7647 >160	3	10	14
Particles >38µm	ASTM D7647 >40	0	0	1
Particles >71µm	ASTM D7647 >10	0	0	0
Oil Cleanliness	ISO 4406 (c) >21/19/16	▲ 24/21/12	▲ 24/21/13	▲ 24/22/13

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	0.67	0.67	0.68




OIL ANALYSIS REPORT

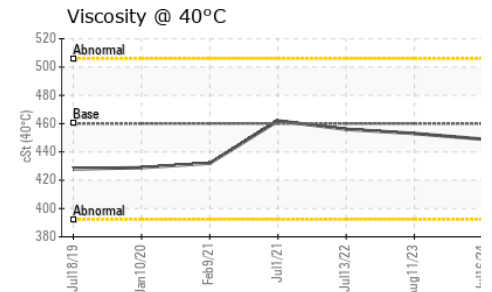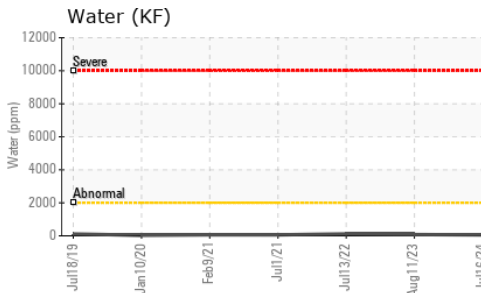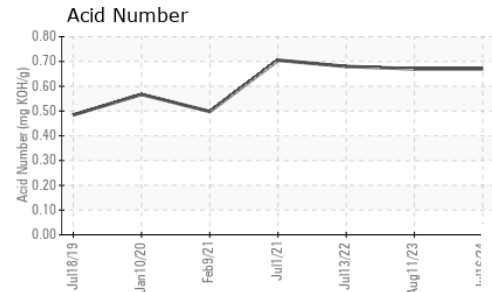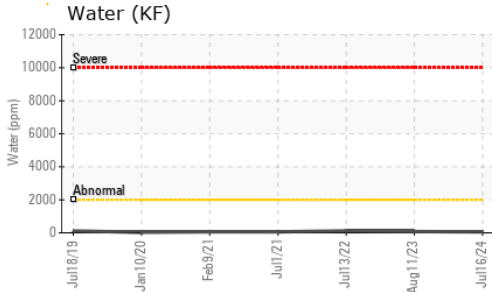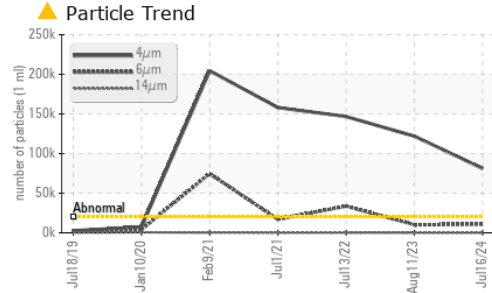





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 460	449	453	456

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

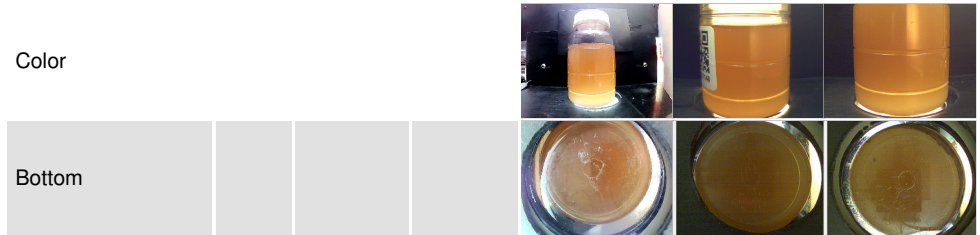

GRAPHS

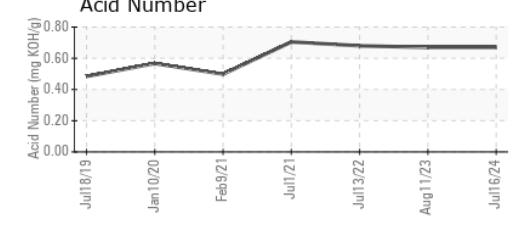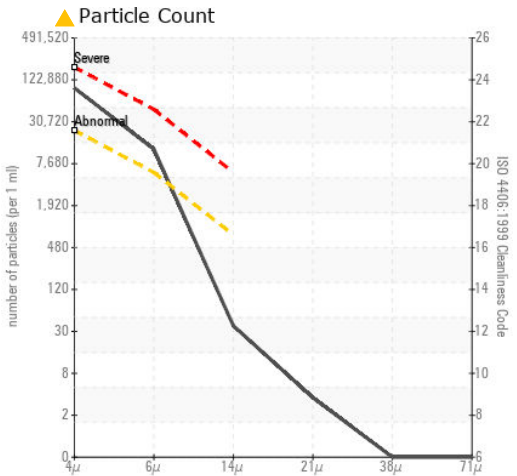

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0901926

Lab Number : 06240358

Unique Number : 11129192

Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Received : 18 Jul 2024

Tested : 19 Jul 2024

Diagnosed : 19 Jul 2024 - Doug Bogart

NOVOZYMES

P.O. BOX 576, 77 PERRY CHAPEL CHURCH ROAD

FRANKLINTON, NC

US 27525

Contact: BRUCE THOMAS

brct@novozymes.com

T: (919)494-3146

F: (919)494-3456