




OIL ANALYSIS REPORT

Sample Rating Trend

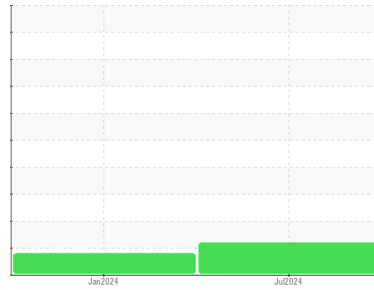

ISO



Machine Id
STUFF LINE 6
 Component
Hydraulic System
 Fluid
ESSO NUTO H ISO 46 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		USP0015042	USP0004842	---
Sample Date	Client Info		17 Jul 2024	17 Jan 2024	---
Machine Age	hrs	Client Info	0	0	---
Oil Age	hrs	Client Info	0	0	---
Oil Changed	Client Info		N/A	N/A	---
Sample Status			ABNORMAL	ATTENTION	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	1	0	---
Chromium	ppm	ASTM D5185m >20	0	0	---
Nickel	ppm	ASTM D5185m >20	0	0	---
Titanium	ppm	ASTM D5185m	0	0	---
Silver	ppm	ASTM D5185m	0	0	---
Aluminum	ppm	ASTM D5185m >20	3	0	---
Lead	ppm	ASTM D5185m >20	0	0	---
Copper	ppm	ASTM D5185m >20	5	5	---
Tin	ppm	ASTM D5185m >20	0	0	---
Vanadium	ppm	ASTM D5185m	0	0	---
Cadmium	ppm	ASTM D5185m	0	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	---
Barium	ppm	ASTM D5185m 0	0	0	---
Molybdenum	ppm	ASTM D5185m 0	0	0	---
Manganese	ppm	ASTM D5185m	0	0	---
Magnesium	ppm	ASTM D5185m 5	<1	0	---
Calcium	ppm	ASTM D5185m 50	43	37	---
Phosphorus	ppm	ASTM D5185m 330	326	355	---
Zinc	ppm	ASTM D5185m 410	405	437	---
Sulfur	ppm	ASTM D5185m 2700	988	898	---

CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	8	<1	---
Sodium	ppm	ASTM D5185m	1	<1	---
Potassium	ppm	ASTM D5185m >20	0	<1	---
Water	%	ASTM D6304 >0.05	0.008	0.004	---
ppm Water	ppm	ASTM D6304 >500	84	43	---

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	▲ 66607	● 17422	---
Particles >6µm	ASTM D7647	>2500	▲ 7019	2214	---
Particles >14µm	ASTM D7647	>640	49	89	---
Particles >21µm	ASTM D7647	>160	9	22	---
Particles >38µm	ASTM D7647	>40	0	1	---
Particles >71µm	ASTM D7647	>10	0	0	---
Oil Cleanliness	ISO 4406 (c)	>20/18/16	▲ 23/20/13	● 21/18/14	---

FLUID DEGRADATION


	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.45	0.29	0.31	---

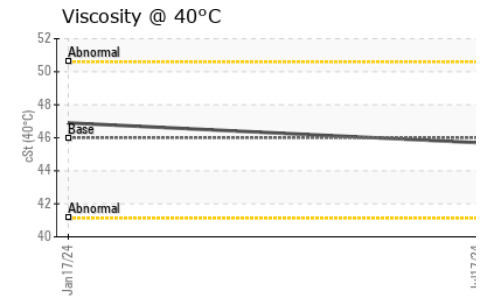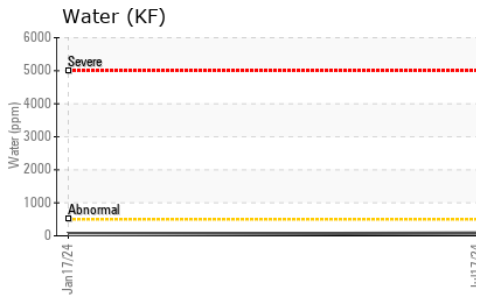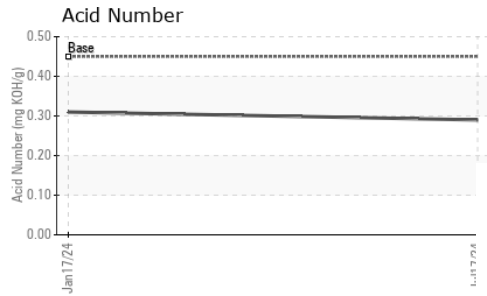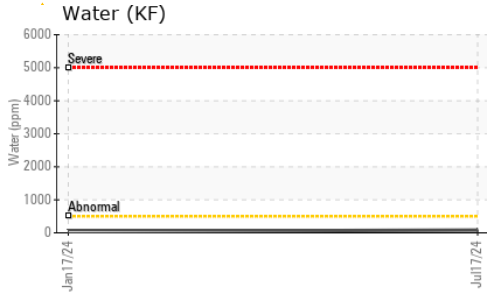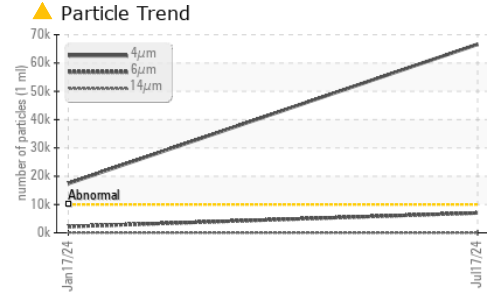





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	45.7	46.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

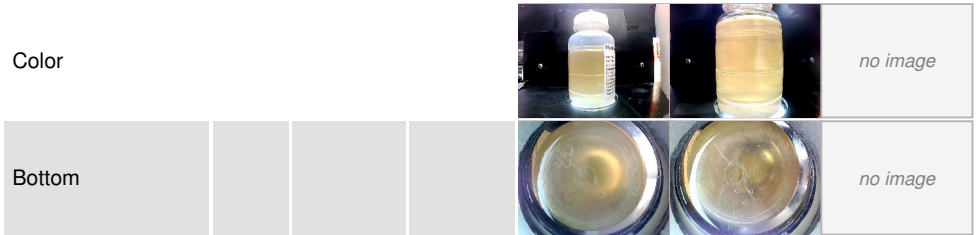

GRAPHS

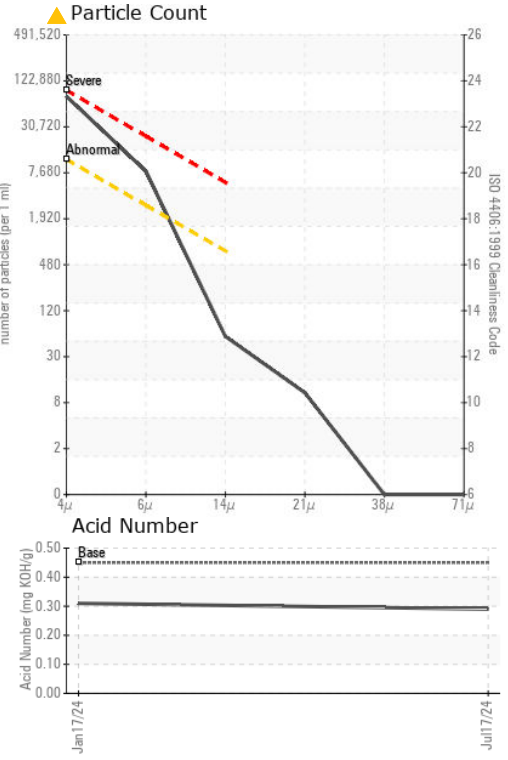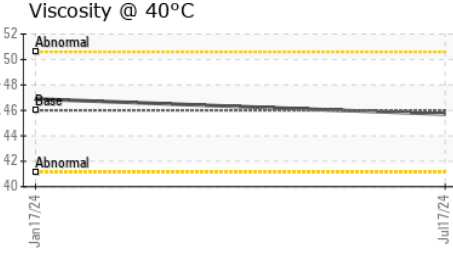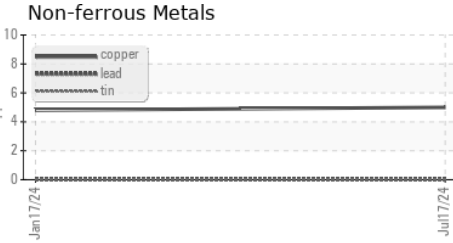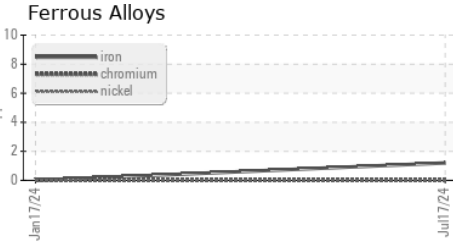

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : USP0015042
Lab Number : 06240386
Unique Number : 11129220
Test Package : IND 2

Received : 18 Jul 2024
Tested : 19 Jul 2024
Diagnosed : 19 Jul 2024 - Doug Bogart

KraftHeinz - Newberry - Plant 8335
 3704 LOUIS RICH DR
 NEWBERRY, SC
 US 29108
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: