




# OIL ANALYSIS REPORT

Sample Rating Trend

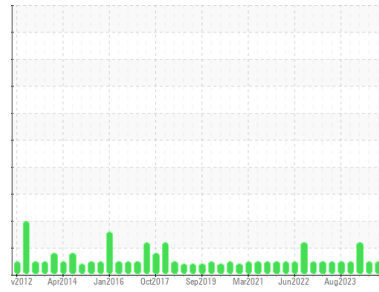

**NORMAL**



Machine Id  
**C-8 (S/N 7392011)**  
 Component  
**Compressor**  
 Fluid  
**USPI ALT-68 SC (220 LTR)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>USP0014968</b>	USP0007855	USP0007351
Sample Date	Client Info	<b>17 Jul 2024</b>	05 Apr 2024	07 Mar 2024
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	ABNORMAL

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<b>0</b>	<1	1
Chromium	ppm	ASTM D5185m >10	<b>0</b>	<1	<1
Nickel	ppm	ASTM D5185m	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m	<b>0</b>	<1	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >25	<b>0</b>	1	1
Lead	ppm	ASTM D5185m >25	<b>0</b>	1	0
Copper	ppm	ASTM D5185m >50	<b>0</b>	<1	0
Tin	ppm	ASTM D5185m >15	<b>0</b>	1	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	<1	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	<1	0
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Calcium	ppm	ASTM D5185m	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>0</b>	0	0
Zinc	ppm	ASTM D5185m	<b>0</b>	0	<1
Sulfur	ppm	ASTM D5185m 50	<b>0</b>	0	0

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<b>1</b>	2	2
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Potassium	ppm	ASTM D5185m >20	<b>0</b>	<1	<1
Water	%	ASTM D6304 >0.1	<b>0.006</b>	0.012	0.003
ppm Water	ppm	ASTM D6304 >1000	<b>69</b>	126	29

## FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	<b>3864</b>	4167	▲ 63629
Particles >6µm	ASTM D7647 >2500	<b>983</b>	834	▲ 14112
Particles >14µm	ASTM D7647 >320	<b>40</b>	30	261
Particles >21µm	ASTM D7647 >80	<b>5</b>	7	33
Particles >38µm	ASTM D7647 >20	<b>0</b>	0	0
Particles >71µm	ASTM D7647 >4	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >20/18/15	<b>19/17/12</b>	19/17/12	▲ 23/21/15

## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.005	<b>0.014</b>	0.014	0.015



# OIL ANALYSIS REPORT

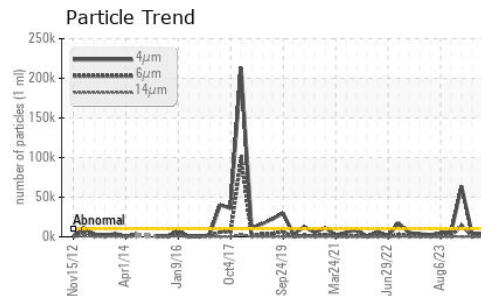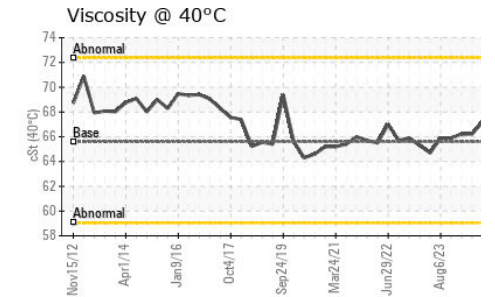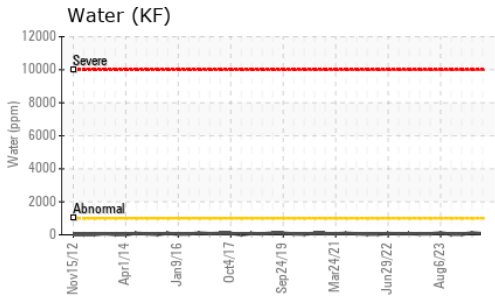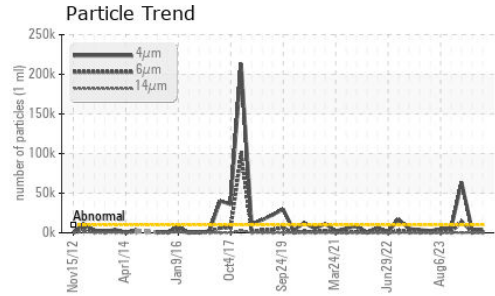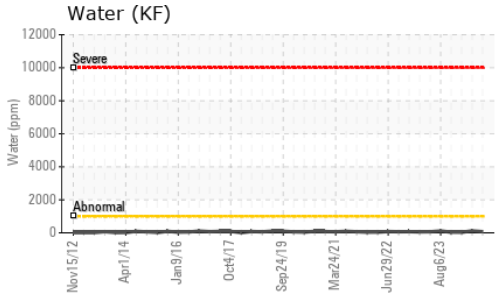






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	65.6	67.2	66.22

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------



## GRAPHS

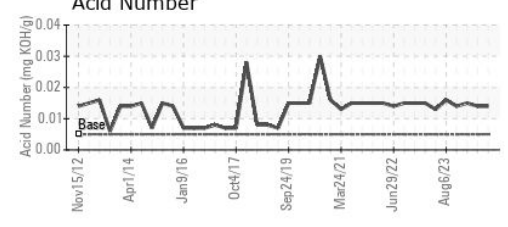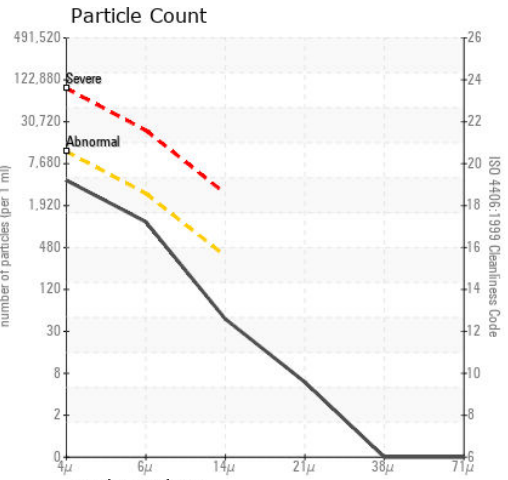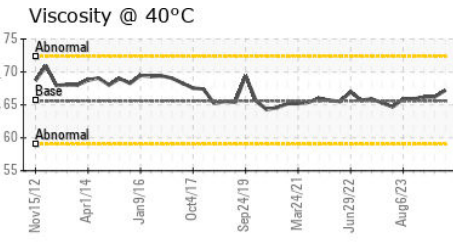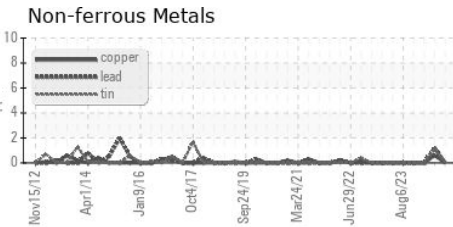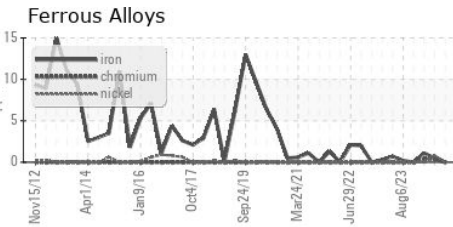

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP0014968 **Received** : 18 Jul 2024  
**Lab Number** : 06240388 **Tested** : 19 Jul 2024  
**Unique Number** : 11129222 **Diagnosed** : 19 Jul 2024 - Doug Bogart  
**Test Package** : IND 2

**TRIUMPH FOODS**

US  
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: