

# **OIL ANALYSIS REPORT**

Sample Rating Trend



Machine Id C-6 (S/N V0610)

Compressor

**USPI ALT-68 SC (220 LTR)** 

### DIAGNOSIS

#### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.


#### **Fluid Condition**


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


		v/2011 Aug/201	2 Sep2013 Dec2014 Apr20	116 Oct2017 Jun2019 Oct2020 Ji	un2022 Jul20	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0014972	USP0007352	USP0000781
Sample Date		Client Info		17 Jul 2024	07 Mar 2024	06 Aug 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	2
Chromium	ppm	ASTM D5185m	>10	0	<1	0
Nickel	ppm	ASTM D5185m		0	0	<1
Titanium	ppm	ASTM D5185m		0	0	<1
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	0	1	0
Lead	ppm	ASTM D5185m	>25	0	0	0
Copper	ppm	ASTM D5185m	>50	0	0	<1
Tin	ppm	ASTM D5185m	>15	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	<1
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m		0	0	0
Calcium	ppm	ASTM D5185m		<1	0	0
Phosphorus	ppm	ASTM D5185m		0	0	0
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m	50	0	0	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	1	2
Sodium	ppm	ASTM D5185m		<1	<1	0
Potassium	ppm	ASTM D5185m	>20	0	<1	0
Water	%	ASTM D6304	>0.1	0.003	0.00	0.003
ppm Water	ppm	ASTM D6304	>1000	37	0	31.6
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647	>10000	<u>▲</u> 56585	<b>▲</b> 48348	<b>△</b> 74989
Particles >6µm		ASTM D7647	>2500	<u> </u>	<u>11471</u>	<u>▲</u> 15033
Particles >14μm		ASTM D7647	>320	<u>^</u> 547	213	<b>4</b> 09
Particles >21μm		ASTM D7647		<u>^</u> 92	24	67
Particles >38μm		ASTM D7647	>20	0	0	1
Particles >71μm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	<u>23/21/16</u>	<u>\$\rightarrow\$ 23/21/15</u>	<u>\$\rightarrow\$ 23/21/16</u>
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.005	0.014	0.014	0.014





## **OIL ANALYSIS REPORT**














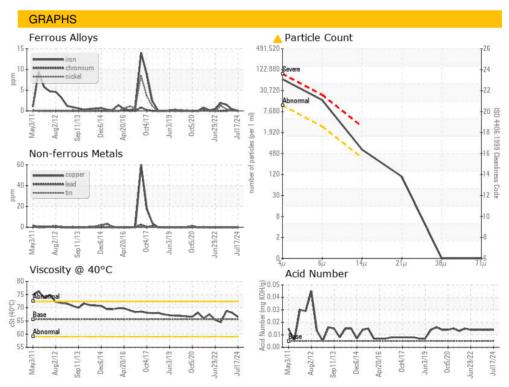





Certificate 12367

Laboratory Sample No.

Lab Number

: USP0014972

**Bottom** 

: 06240392

**Tested** 

Unique Number : 11129226 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 18 Jul 2024

: 19 Jul 2024

Diagnosed : 19 Jul 2024 - Doug Bogart US

**TRIUMPH FOODS** 

Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: TRISAIUSP [WUSCAR] 06240392 (Generated: 07/21/2024 13:10:05) Rev: 1

Contact/Location: SERVICE MANAGER? - TRISAIUSP

T:

F: