

# **OIL ANALYSIS REPORT**

# Sample Rating Trend







Machine Id C-7 (S/N V0500) Component Compressor

**USPI ALT-68 SC (200 LTR)** 

### DIAGNOSIS

## Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


# **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


		c2011 May20	13 Dec2014 Aug2016	Aug2018 Feb2021 Mar2022 A	hpr2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0014967	USP0007349	USP0005650
Sample Date		Client Info		17 Jul 2024	07 Mar 2024	24 Jan 2024
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	ABNORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	<1	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	0	1	0
Lead	ppm	ASTM D5185m	>25	0	0	0
Copper	ppm	ASTM D5185m	>50	0	0	0
Tin	ppm	ASTM D5185m	>15	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m		0	0	0
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m		0	0	0
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m	50	0	0	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	2	<1
Sodium	ppm	ASTM D5185m		<1	<1	<1
Potassium	ppm	ASTM D5185m	>20	0	<1	0
Water	%	ASTM D6304	>0.1	0.004	0.002	0.004
ppm Water	ppm	ASTM D6304	>1000	41	25	46
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	6702	<u>4</u> 24146	4430
Particles >6µm		ASTM D7647	>2500	2110	<u>▲</u> 5762	970
Particles >14µm		ASTM D7647	>320	96	80	28
Particles >21µm		ASTM D7647	>80	12	7	7
Particles >38µm		ASTM D7647	>20	0	0	0
Particles >71μm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	20/18/14	<u>22/20/13</u>	19/17/12
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.005	0.014	0.014	0.014





# **OIL ANALYSIS REPORT**




50k -		um um Jum		4			
00k -				1			
		A		W	N	h	
50k - Abn	ormal	A	10	-////	V "	. /	







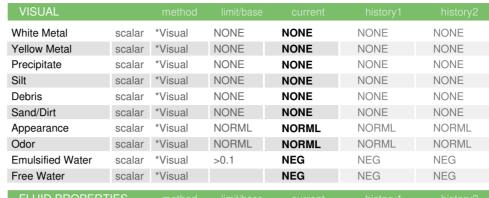

FLUID PROPER	THES	method	ilmit/base		nistory i	nistory2
Visc @ 40°C	cSt	ASTM D445	65.6	67.3	68.2	68.3

SAMPLE IMAGES	method		
			(Variation)

Color





GR	RAPHS											
Fer	rous All	oys					Par 491,520 T	ticle Co	unt			т26
_	iron											
10-	ennesse chrom	ium	<b>A</b>				122,880 <b>Severe</b>					+24
5-	1/	1	1		Λ		30,720 - <b>Abnom</b>					-22
0	<u></u>		1		\		7 680 1	ııdı				-20
Dec12/1	May29/13	Dec6/14 - Aug26/16 -	Aug1/18	Feb10/21	Mar28/22	Apr26/23	1,920-	1				-18
noN	≥ n-ferrou				_		1.920 - 480 - 120 -		1:			+20 +18 +16 +14 +12
8 =	coppe	1					120 -		/			-14
C	essesses tin						30-			/		12
2	1/0	M	Δ				8-			1		-10
Dec12/11-	May29/13	Dec6/14 -	Aug1/18	Feb10/21	Mar28/22	Apr26/23	2-					-8
Dec	May2	Dec Aug2	Aug	Feb	Mar2	Apr2	0444	-	.,			716
	cosity @	40°C					Acid	6µ d Numb	14μ er	21μ	38μ	/1μ
75 T Mhn	omal						(B) 0.06					
70 - Base	ormal	2		^^		~	g 0.04-	er er er				
	ormal				¥¥		Acid Number (mg KOH/g)  8 20.00  8 200.00					
60 Abn	omia	11111					Base		<u> </u>	/		
Dec12/11-	May29/13	Dec6/14 - Aug26/16 -	Aug1/18	Feb10/21	Mar28/22 -	Apr26/23	A Dec12/11-	May29/13	Dec6/14 -	Aug1/18	Feb10/21	Apr26/23





Laboratory Sample No.

: USP0014967 Lab Number : 06240411 Unique Number : 11129245

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 18 Jul 2024

**Tested** : 19 Jul 2024 Diagnosed : 19 Jul 2024 - Doug Bogart

Test Package : IND 2 Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: TRISAIUSP [WUSCAR] 06240411 (Generated: 07/21/2024 13:14:43) Rev: 1

Contact/Location: SERVICE MANAGER? - TRISAIUSP

US

T:

F:

**TRIUMPH FOODS** 

Contact: SERVICE MANAGER