

OIL ANALYSIS REPORT

Area [3122] **QUNCY 92057J - SCHAEFFLER**

Component Compressor

ULTRACHEM PO 4010 (--- GAL)

Sample Rating Trend



Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0943004	WC0863565	WC0863527
Sample Date		Client Info		26 Jun 2024	09 Apr 2024	30 Oct 2023
Machine Age	hrs	Client Info		19724	19285	0
Oil Age	hrs	Client Info		8000	2000	3000
Oil Changed		Client Info		Changed	Not Changd	Not Changd
Sample Status				NORMAL	NORMAL	NORMAL
CONTAMINATION	V	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG	NEG	NEG
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	1
Chromium	ppm	ASTM D5185m	>10	0	0	<1
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	<1	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	<1	<1	2
Lead	ppm	ASTM D5185m	>25	0	0	0
Copper	ppm	ASTM D5185m	>50	2	2	1
Tin	ppm	ASTM D5185m	>15	0	<1	0
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	0.4	1	0	0
Molybdenum	ppm	ASTM D5185m	0.5	0	0	0
Manganese	ppm	ASTM D5185m	0.4	0	<1	0
Magnesium	ppm	ASTM D5185m	0	0	0	0
Calcium	ppm	ASTM D5185m	0.3	0	0	0
Phosphorus	ppm	ASTM D5185m	1376	693	694	452
Zinc	ppm	ASTM D5185m	0	10	11	0
Sulfur	ppm	ASTM D5185m	320	820	1299	516
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	<1
Sodium	ppm	ASTM D5185m		<1	2	6
Potassium	ppm	ASTM D5185m	>20	0	<1	<1
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.573	0.70	0.64	0.56



OIL ANALYSIS REPORT



VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	TES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	41.57	54.5	54.9	54.5
SAMPLE IMAGES r		method	limit/base	current	history1	history2
Color						

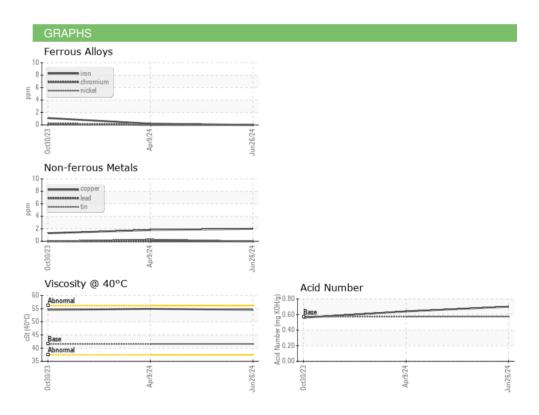





Certificate 12367

Laboratory Sample No.

Lab Number : 06240442

: WC0943004 Unique Number : 11129276 Test Package : IND 2

To discuss this sample report, contact Customer Service at 1-800-237-1369.

Bottom

: WearCheck USA - 501 Madison Ave., Cary, NC 27513

Received **Tested** Diagnosed

: 18 Jul 2024 : 19 Jul 2024 : 19 Jul 2024 - Doug Bogart

ELEVATED INDUSTRIAL SOLUTIONS - EIS 302 HUGHES ST FOUNTAIN INN, SC US 29644

Contact: DARRIN WARD dward@elevatedindustrial.com

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (864)862-7653 Contact/Location: DARRIN WARD - PALFOU

T: