

OIL ANALYSIS REPORT

Area [3267] QUINCY UN117850 - MCCALL FARMS

Compressor

Fluid {not provided} (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

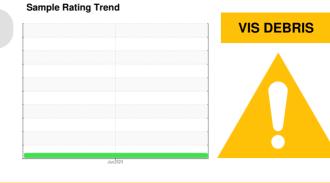


SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0943045		
Sample Date		Client Info		20 Jun 2024		
Machine Age	hrs	Client Info		92866		
Oil Age	hrs	Client Info		6000		
Oil Changed		Client Info		Changed		
Sample Status				MARGINAL		
CONTAMINATION	N	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	0		
Lead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m	>50	0		
Tin	ppm	ASTM D5185m	>15	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		2		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		2		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		639		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m		1391		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		1		
Potassium	ppm	ASTM D5185m	>20	0		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.49		



OIL ANALYSIS REPORT

VISUAL

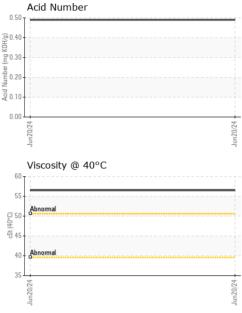

	VISUAL						TIIStory2
	White Metal	scalar	*Visual	NONE	NONE		
	Yellow Metal	scalar	*Visual	NONE	NONE		
	Precipitate		*Visual	NONE	NONE		
	Silt	scalar	*Visual	NONE	NONE		
	Debris	scalar	*Visual	NONE			
	Sand/Dirt		*Visual	NONE	NONE		
)/24	Appearance		*Visual	NORML	NORML		
Jun20/24	Odor		*Visual	NORML	NORML		
	Emulsified Water	scalar	*Visual	>0.1	NEG		
	Free Water		*Visual	20.1	NEG		
			method	limit/base	current	history1	history2
	Visc @ 40°C		ASTM D445		56.5		
	SAMPLE IMAGE	S	method	limit/base	current	history1	history2
Jun20/24 +	Color					no image	no image
	Bottom					no image	no image
	Ferrous Alloys	ls		Jun20/24			
	Jun20/24			Jun20/24			
	Viscosity @ 40°C				Acid Number		
	60 T			€0.5	T		
	55 - Abnormal			<u></u>	0 +		
	00 50 - Abnormal 99 83 45 -			(B)HO) 0.3 (B)HO) 0.4 (B)HO) 0.3 (B)HO) 0.1 (B)HO) 0.1 (B)HO) 0.1 (B)HO) 0.1 (B)HO) 0.1 (B)HO) 0.1 (B)HO) 0.5 (B)HO) 0.5	0		
				4 0.2	0		
	1			- Pip	0		
	35 L+			0.0	0		
	Jun20/24			Jun20/24	Jun20/24		-
Laboratory Sample No. Lab Number	: WC0943045 : 0 <mark>6240446</mark>	Receiv Testeo	ved : 18 d : 19	: 18 Jul 2024 302 HUGHES : 19 Jul 2024 FOUNTAIN INN, : 19 Jul 2024 - Doug Bogart US 29 Contact: DARRIN WA			
Sample No. Lab Number	: WC0943045 Received : 18 Jul 2024 302 : 06240446 Tested : 19 Jul 2024 FOUN : 11129280 Diagnosed : 19 Jul 2024 - Doug Bogart						

limit/base

current

method

history1

history2

Report Id: PALFOU [WUSCAR] 06240446 (Generated: 07/21/2024 10:48:11) Rev: 1

Contact/Location: DARRIN WARD - PALFOU