

## **OIL ANALYSIS REPORT**

# Area [2103] Machine Id KAESER 4614373 - MOLHERN BELTING (S/N 1115)

Compressor

Fluid KAESER SIGMA (OEM) S-460 (--- GAL)

#### Recommendation

Resample at the next service interval to monitor.

#### Wear


All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

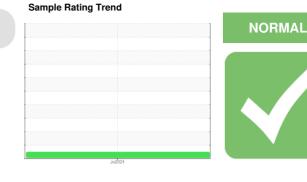


SAMPLE INFORM	<b>/IATION</b>	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0947642		
Sample Date		Client Info		10 Jul 2024		
Machine Age	hrs	Client Info		43034		
Oil Age	hrs	Client Info		7000		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
CONTAMINATIO	N	method	limit/base	current	history1	history2
Water		WC Method	>0.05	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	16		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	<1		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	90	<1		
Calcium	ppm	ASTM D5185m	2	0		
Phosphorus	ppm	ASTM D5185m		13		
Zinc	ppm	ASTM D5185m		26		
Sulfur	ppm	ASTM D5185m		17651		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	3		
Sodium	ppm	ASTM D5185m		2		
Potassium	ppm	ASTM D5185m	>20	0		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.34		



# **OIL ANALYSIS REPORT**

VISUAL

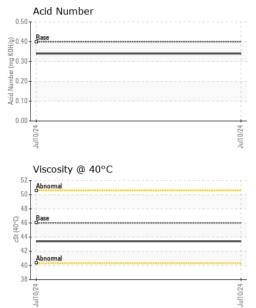

	VISUAL		method	limit/base	current	nistory i	nistory2
	White Metal	scalar	*Visual	NONE	NONE		
	Yellow Metal	scalar	*Visual	NONE	NONE		
	Precipitate	scalar	*Visual	NONE	NONE		
	Silt	scalar	*Visual	NONE	NONE		
	Debris	scalar	*Visual	NONE	NONE		
	Sand/Dirt	scalar	*Visual	NONE	NONE		
Jul10/24	Appearance	scalar	*Visual	NORML	NORML		
- In C	Odor	scalar	*Visual	NORML	NORML		
	Emulsified Water	scalar	*Visual	>0.05	NEG		
	Free Water	scalar	*Visual		NEG		
	FLUID PROPER1	<b>FIES</b>	method	limit/base	current	history1	history2
	Visc @ 40°C	cSt	ASTM D445	46	43.4		
	SAMPLE IMAGES	S	method	limit/base	current	history1	history2
Jul10/24	Color					no image	no image
	Bottom					no image	no image
	Non-ferrous Metal	ls		Juli0/24	Acid Number		
	50 Abnormal			( <sup>0.5</sup> ( <sup>0</sup> /H0)	Base		
	Base			¥ 0.4 ق0.3	)		
	Base Base Abnormal			y Bu Bu 0.3 V 0.1 V 0.0	)		
	40 - <b>Q</b>			N p 0.1	)+		
	1.1						
	35						
	35 <b>4</b> + 2/0 linf			Jul10/24	Jul10/24		

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (864)862-7653

Report Id: PALFOU [WUSCAR] 06240451 (Generated: 07/21/2024 10:47:14) Rev: 1

Contact/Location: DARRIN WARD - PALFOU