




# OIL ANALYSIS REPORT

Sample Rating Trend

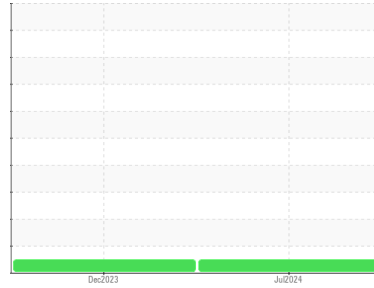

**NORMAL**



Area

**AIRLUBE 228 [DA1475]**

Machine Id

**ATLAS COPCO API661044 - GT TECHNOLOGIES-PLANT 2**

Component

**Compressor**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCH06240476</b>	UCH06038702	---
Sample Date	Client Info		<b>15 Jul 2024</b>	01 Dec 2023	---
Machine Age	hrs	Client Info	<b>91689</b>	87188	---
Oil Age	hrs	Client Info	<b>2186</b>	6440	---
Oil Changed	Client Info		<b>Not Chngd</b>	Not Chngd	---
Sample Status			<b>NORMAL</b>	NORMAL	---

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	<b>NEG</b>	NEG	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	<1	---
Chromium	ppm	ASTM D5185m >5	<b>0</b>	<1	---
Nickel	ppm	ASTM D5185m	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m	<b>0</b>	<1	---
Silver	ppm	ASTM D5185m	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m >15	<b>0</b>	16	---
Lead	ppm	ASTM D5185m >65	<b>0</b>	0	---
Copper	ppm	ASTM D5185m >65	<b>0</b>	<1	---
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 1.5	<b>0</b>	0	---
Barium	ppm	ASTM D5185m 0	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	<1	---
Manganese	ppm	ASTM D5185m 0.3	<b>0</b>	0	---
Magnesium	ppm	ASTM D5185m 0	<b>&lt;1</b>	0	---
Calcium	ppm	ASTM D5185m 0	<b>0</b>	0	---
Phosphorus	ppm	ASTM D5185m 406	<b>123</b>	53	---
Zinc	ppm	ASTM D5185m 0	<b>0</b>	0	---
Sulfur	ppm	ASTM D5185m 1283	<b>473</b>	0	---

## CONTAMINANTS



	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >35	<b>5</b>	<1	---
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Potassium	ppm	ASTM D5185m >20	<b>0</b>	1	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.463	<b>0.55</b>	1.40	---




# OIL ANALYSIS REPORT

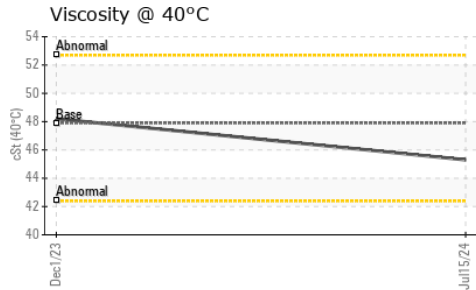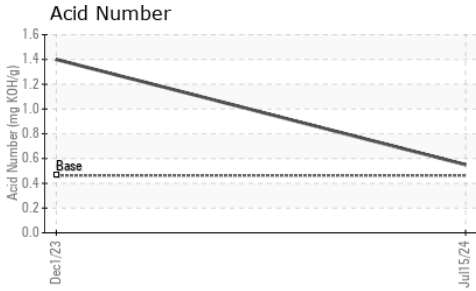




VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	47.9	45.3	48.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

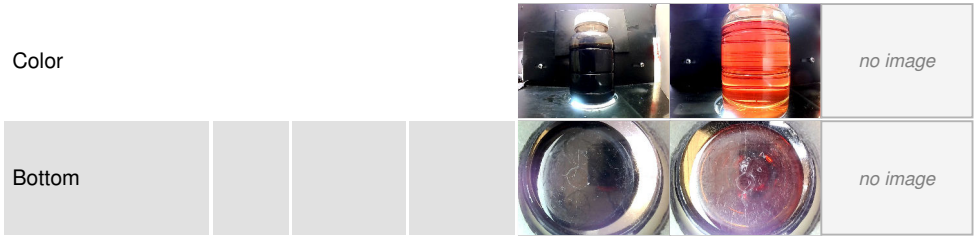

## GRAPHS

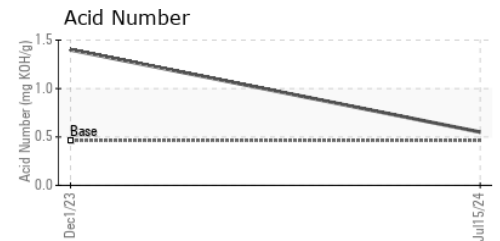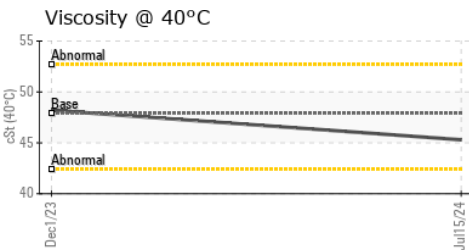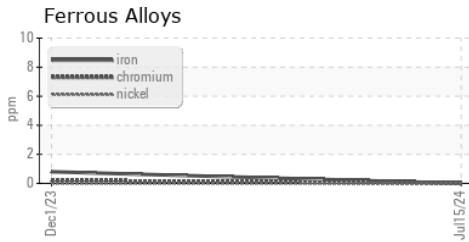

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06240476  
**Lab Number** : 06240476  
**Unique Number** : 11129310  
**Test Package** : IND 2

**Received** : 18 Jul 2024  
**Tested** : 19 Jul 2024  
**Diagnosed** : 19 Jul 2024 - Wes Davis

**DIRECT AIR - AIR TECHNOLOGIES**  
 400 WRIGHT AVE  
 MIDDLETOWN, OH  
 US 45044  
 Contact: APRIL MOORE  
 april.moore@aircompressors.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (513)539-6040