




OIL ANALYSIS REPORT



Area
Victoria Hospital Ch#7 [8551]
 Machine Id
CARRIER 2295J50628
 Component
Chiller
 Fluid
{not provided} (--- GAL)

Sample Rating Trend

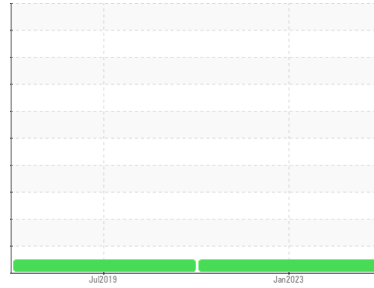

NORMAL



DIAGNOSIS

Recommendation
 The test results indicate normal wear patterns for this type of unit with the moisture and acidity also in the acceptable range.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			GTT8551	GTT8552	---
Sample Date	Client Info			09 Jan 2023	15 Jul 2019	---
Oil Changed	Client Info			N/A	N/A	---
Sample Status				NORMAL	NORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)		<1	<1	---
Chromium	ppm	ASTM D5185(m)		<1	<1	---
Aluminum	ppm	ASTM D5185(m)		<1	<1	---
Lead	ppm	ASTM D5185(m)		<1	<1	---
Copper	ppm	ASTM D5185(m)		2	2	---
Tin	ppm	ASTM D5185(m)		<1	<1	---

ADDITIVES		method	limit/base	current	history1	history2
Zinc	ppm	ASTM D5185(m)		<1	<1	---

CONTAMINANTS		method	limit/base	current	history1	history2
ppm Water	ppm	ASTM D6304*		82	53	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*		0.008	0.047	---

SAMPLE IMAGES		method	limit/base	current	history1	history2
Color					<i>no image</i>	<i>no image</i>
Bottom					<i>no image</i>	<i>no image</i>

OIL ANALYSIS REPORT

GRAPHS



Sample No. : GTT8551 **Received** : 16 Jan 2023
Lab Number : 20232135 **Diagnosed** : 10 Mar 2023
Unique Number : 15953921 **Diagnostician** : Wes Davis
Test Package : IND 2 (Additional Tests: ICP, KF, TAN Auto)

To discuss this sample report, contact Customer Service at 1-905-847-9300 Ext 26.

Test denoted () outside scope of accreditation, (m) method modified, (e) tested at external lab.*

Damages: Seller shall in no event be liable for special, incidental, or consequential damages, of a commercial nature, resulting from any cause.

Carrier Commerical Service
C/O Conduent Div of Carrier Canada, 1-2740 Matheson Blvd
Mississauga, ON
CA L4W 4X3
Contact: Service Manager

T:
F: