



RAPPORT DU CARBURANT

Sample Rating Trend


NORMALE



Secteur
[99354]
Identité de la machine
25453454

Composant
Carburant diesel
Fluide

No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- GAL)

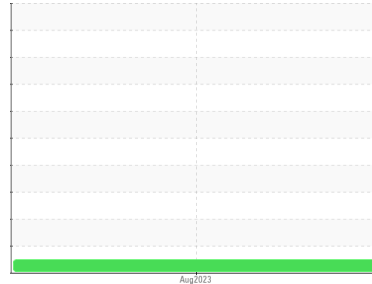

DIAGNOSTIC

Recommendation

Laboratory test indicate that this fuel is suitable for use and meets all test requirements. Resample at the next service interval to monitor.

Corrossione

{not applicable}

Contaminants

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. There is no indication of any contamination in the diesel fuel.

État Du Carburant

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel (US EPA/CGSB-3.517-3 type B).

INFORMATION SUR L'ÉCHANTILLON		methode	limite/base	actuel	passé1	passé2
Numéro d'échant.	Client Info			CU0019853	---	---
Date d'échant.	Client Info			15 Aug 2023	---	---
Âge d la Machine	hrs	Client Info		0	---	---
Statut de l'échant.				NORMAL	---	---

PHYSICAL PROPERTIES		methode	limite/base	actuel	passé1	passé2
Densité		ASTM D1298*	0.839	0.829	---	---
Couleur du carburant	text	Visual Screen*	Yllow	Red	---	---
Visc 40°C	cSt	ASTM D7279(m)	3.0	2.1	---	---
Point d'éclair Pensky-Martens	°C	ASTM D7215*	52	54	---	---

SULFUR CONTENT		methode	limite/base	actuel	passé1	passé2
Soufre	ppm	ASTM D5185(m)	10	6	---	---






DISTILLATION		methode	limite/base	actuel	passé1	passé2
Point d'ébullition initial	°C	ASTM D2887*	165	165	---	---
Point de distillation de 5%	°C	ASTM D2887*		188	---	---
Point de distillation de 10%	°C	ASTM D2887*	201	197	---	---
Point de distillation de 15%	°C	ASTM D2887*		203	---	---
Point de distillation de 20%	°C	ASTM D2887*	216	210	---	---
Point de distillation de 30%	°C	ASTM D2887*	230	221	---	---
Point de distillation de 40%	°C	ASTM D2887*	243	232	---	---
Point de distillation de 50%	°C	ASTM D2887*	255	243	---	---
Point de distillation de 60%	°C	ASTM D2887*	267	256	---	---
Point de distillation de 70%	°C	ASTM D2887*	280	270	---	---
Point de distillation de 80%	°C	ASTM D2887*	295	288	---	---
Point de distillation de 85%	°C	ASTM D2887*		300	---	---
Point de distillation de 90%	°C	ASTM D2887*	310	313	---	---
Point de distillation de 95%	°C	ASTM D2887*		334	---	---
Point d'ébullition final	°C	ASTM D2887*	341	353	---	---

IGNITION QUALITY		methode	limite/base	actuel	passé1	passé2
Densité API		ASTM D1298*	37.7	39	---	---
Indice de cétane		ASTM D4737*	<40.0	48	---	---

CONTAMINANTS		methode	limite/base	actuel	passé1	passé2
Silicium	ppm	ASTM D5185(m)	<1.0	0	---	---
Sodium	ppm	ASTM D5185(m)	<0.1	<1	---	---
Potassium	ppm	ASTM D5185(m)	<0.1	0	---	---
Eau	%	ASTM D6304*	<0.05	0.003	---	---
ppm d'eau	ppm	ASTM D6304*	<500	27.4	---	---

PROPRETÉ DU FLUIDE		methode	limite/base	actuel	passé1	passé2
Particules >4µ		ASTM D7647	>2500	338	---	---
Particules >6µ		ASTM D7647	>640	104	---	---
Particules >14µ		ASTM D7647	>80	15	---	---
Particules >21µ		ASTM D7647	>20	5	---	---
Particules >38µ		ASTM D7647	>4	0	---	---
Particules >71µ		ASTM D7647	>3	0	---	---
Propreté de l'huile		ISO 4406 (c)	>18/16/13	16/14/11	---	---




RAPPORT DU CARBURANT

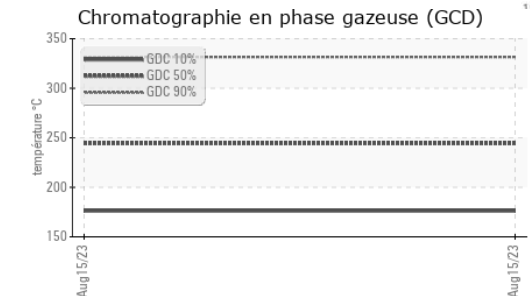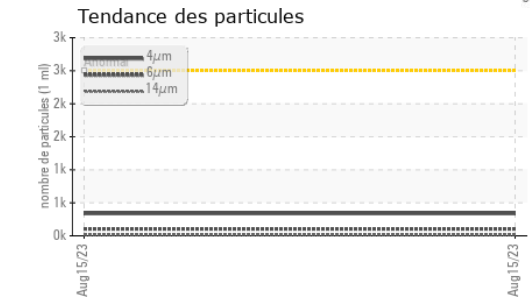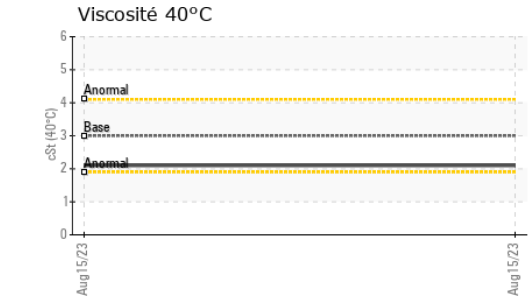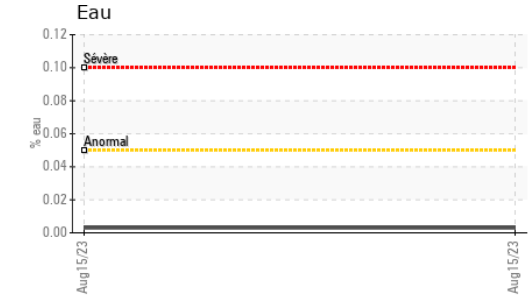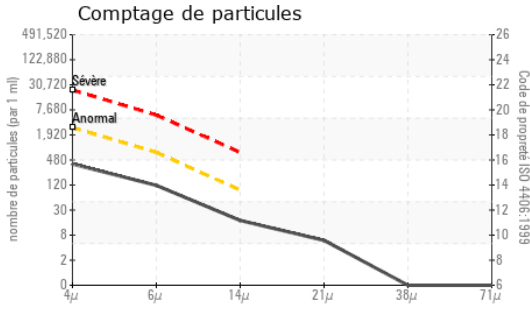

HEAVY METALS	methode	limite/base	actuel	passé1	passé2
Aluminium	ppm	ASTM D5185(m)	<0.1	0	---
Nickel	ppm	ASTM D5185(m)	<0.1	0	---
Plomb	ppm	ASTM D5185(m)	<0.1	0	---
Vanadium	ppm	ASTM D5185(m)	<0.1	0	---
Fer	ppm	ASTM D5185(m)	<0.1	<1	---
Calcium	ppm	ASTM D5185(m)	<0.1	0	---
Magnésium	ppm	ASTM D5185(m)	<0.1	0	---
Phosphore	ppm	ASTM D5185(m)	<0.1	0	---
Zinc	ppm	ASTM D5185(m)	<0.1	0	---

IMAGES DE L'ÉCHANTILLON	methode	limite/base	actuel	passé1	passé2
Coluer				no image	no image
Fond				no image	no image

GRAPHIQUES

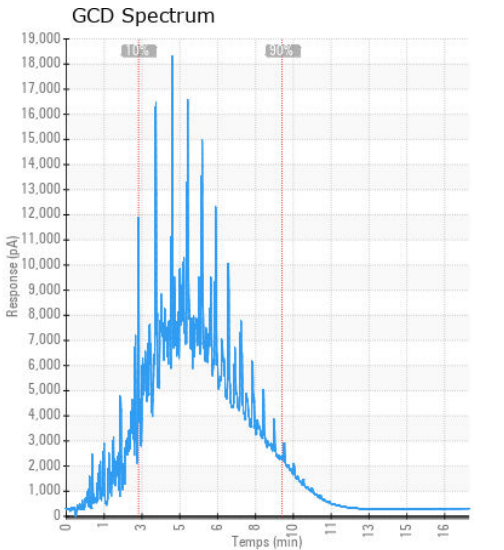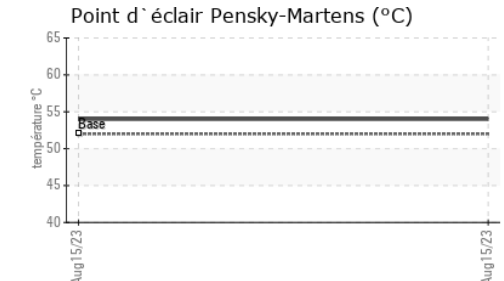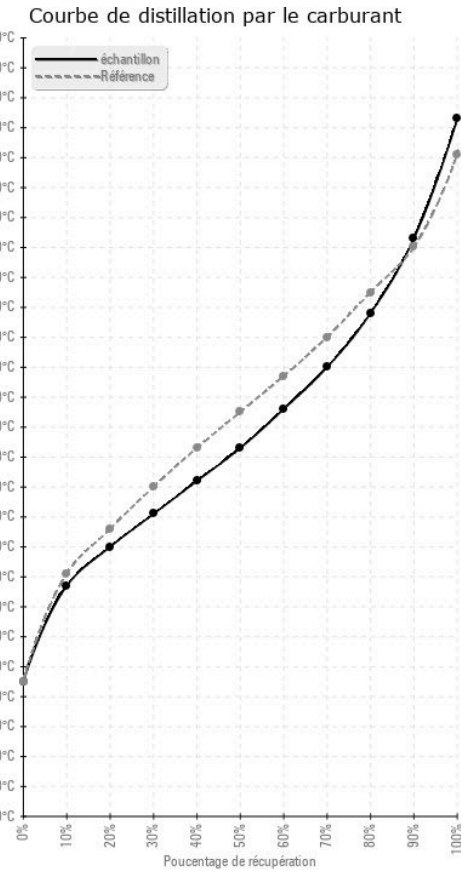

Laboratoire : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
N° d'échantillon : CU0019853
N° de laboratoire : 02576598
Numéro unique : 5629658
Analyse : FUEL (Additional Tests: CC Flash, GC-PercFuel, PrtCount)

CUMMINS EASTERN CANADA LP
 3189 SWANSEA CRESCENT
 OTTAWA, ON
 CA K1G 3W5
 Contact: Max Lauzon
 max.lauzon@cummins.com
 T:
 F: (613)736-1202

Pour discuter cette rapport, contacter le service à la clientèle au 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 La validez de los resultados y la interpretación se basan en la muestra y la información proporcionada.