




# RAPPORT DU CARBURANT

Sample Rating Trend

ISO(LES NORMES)

Secteur  
**[99830]**  
Identité de la machine  
**C917102120**

Composant  
**Carburant diesel**  
Fluide  
**DIESEL FUEL No. 2 (--- GAL)**

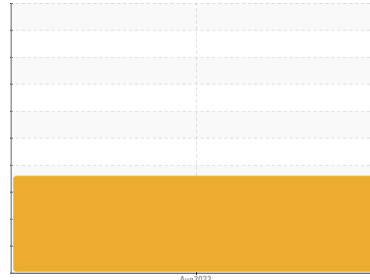

## DIAGNOSTIC

### Recommendation

Check seals and/or filters for points of contaminant entry. Laboratory test indicate that this fuel is suitable for use and meets all test requirements. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We advise that you filter this fluid before use. We recommend you service the filters on this component. Resample in 30-45 days to monitor this situation.

### Corrosionne

(not applicable)

### Contaminants

There is a high amount of silt (particulates < 14 microns in size) present in the fuel. The water content is negligible.

### État Du Carburant

All laboratory tests indicate that this sample meets specifications for No.2 diesel fuel, low sulfur (US EPA/CGSB-3.517-3 type B). The fuel is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

INFORMATION SUR L'ÉCHANTILLON		methode	limite/base	actuel	passé1	passé2
Numéro d'échant.	Client Info			<b>CU0019852</b>	---	---
Date d'échant.	Client Info			<b>19 Aug 2023</b>	---	---
Âge d la Machine	hrs	Client Info		<b>0</b>	---	---
Statut de l'échant.				<b>SEVERE</b>	---	---

PHYSICAL PROPERTIES		methode	limite/base	actuel	passé1	passé2
Densité	ASTM D1298*	0.850		<b>0.824</b>	---	---
Couleur du carburant	text	Visual Screen*	YELLOW	<b>Red</b>	---	---
Visc 40°C	cSt	ASTM D7279(m)	4.1	<b>2</b>	---	---
Point d'éclair Pensky-Martens	°C	ASTM D7215*	40	<b>55.5</b>	---	---

SULFUR CONTENT		methode	limite/base	actuel	passé1	passé2
Soufre	ppm	ASTM D5185(m)		<b>8</b>	---	---






DISTILLATION		methode	limite/base	actuel	passé1	passé2
Point d'ébullition initial	°C	ASTM D2887*	174	<b>165</b>	---	---
Point de distillation de 5%	°C	ASTM D2887*		<b>184</b>	---	---
Point de distillation de 10%	°C	ASTM D2887*	186	<b>192</b>	---	---
Point de distillation de 15%	°C	ASTM D2887*		<b>198</b>	---	---
Point de distillation de 20%	°C	ASTM D2887*	206	<b>204</b>	---	---
Point de distillation de 30%	°C	ASTM D2887*	226	<b>215</b>	---	---
Point de distillation de 40%	°C	ASTM D2887*	245	<b>227</b>	---	---
Point de distillation de 50%	°C	ASTM D2887*	260	<b>238</b>	---	---
Point de distillation de 60%	°C	ASTM D2887*	272	<b>253</b>	---	---
Point de distillation de 70%	°C	ASTM D2887*	285	<b>268</b>	---	---
Point de distillation de 80%	°C	ASTM D2887*	315	<b>285</b>	---	---
Point de distillation de 85%	°C	ASTM D2887*		<b>297</b>	---	---
Point de distillation de 90%	°C	ASTM D2887*	360	<b>309</b>	---	---
Point de distillation de 95%	°C	ASTM D2887*		<b>328</b>	---	---
Point d'ébullition final	°C	ASTM D2887*	>360	<b>347</b>	---	---

IGNITION QUALITY		methode	limite/base	actuel	passé1	passé2
Densité API	ASTM D1298*	35.0		<b>40</b>	---	---
Indice de cétane	ASTM D4737*	<40.0		<b>49</b>	---	---

CONTAMINANTS		methode	limite/base	actuel	passé1	passé2
Silicium	ppm	ASTM D5185(m)	<1.0	<b>0</b>	---	---
Sodium	ppm	ASTM D5185(m)	<0.1	<b>&lt;1</b>	---	---
Potassium	ppm	ASTM D5185(m)	<0.1	<b>&lt;1</b>	---	---
Eau	%	ASTM D6304*	<0.05	<b>0.003</b>	---	---
ppm d'eau	ppm	ASTM D6304*	<500	<b>28.6</b>	---	---

PROPRETÉ DU FLUIDE		methode	limite/base	actuel	passé1	passé2
Particules >4µ	ASTM D7647	>2500		<b>57637</b>	---	---
Particules >6µ	ASTM D7647	>640		<b>13702</b>	---	---
Particules >14µ	ASTM D7647	>80		<b>23</b>	---	---
Particules >21µ	ASTM D7647	>20		<b>2</b>	---	---
Particules >38µ	ASTM D7647	>4		<b>0</b>	---	---
Particules >71µ	ASTM D7647	>3		<b>0</b>	---	---
Propreté de l'huile	ISO 4406 (c)	>18/16/13		<b>23/21/12</b>	---	---




# RAPPORT DU CARBURANT

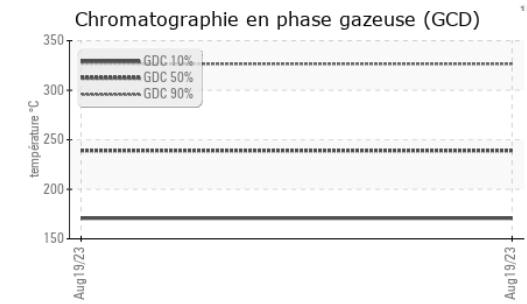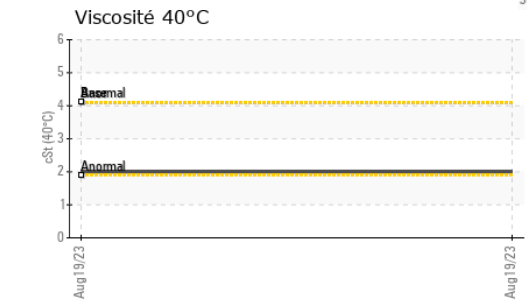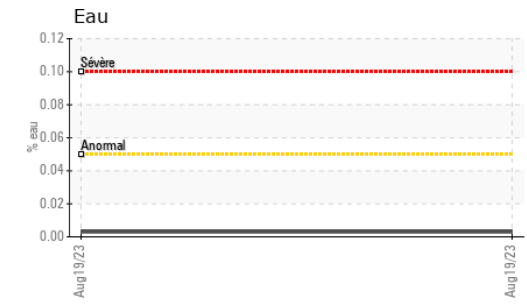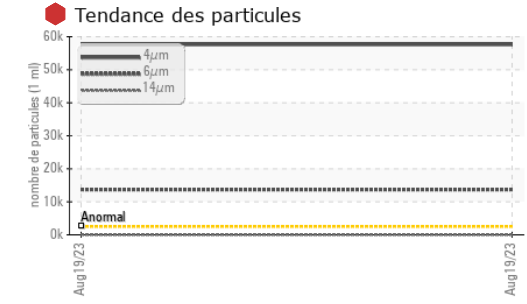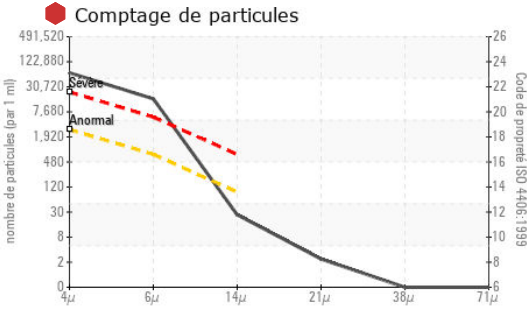

HEAVY METALS		methode	limite/base	actuel	passé1	passé2
Aluminium	ppm	ASTM D5185(m)	<0.1	0	---	---
Nickel	ppm	ASTM D5185(m)	<0.1	0	---	---
Plomb	ppm	ASTM D5185(m)	<0.1	<1	---	---
Vanadium	ppm	ASTM D5185(m)	<0.1	0	---	---
Fer	ppm	ASTM D5185(m)	<0.1	<1	---	---
Calcium	ppm	ASTM D5185(m)	<0.1	0	---	---
Magnésium	ppm	ASTM D5185(m)	<0.1	0	---	---
Phosphore	ppm	ASTM D5185(m)	<0.1	0	---	---
Zinc	ppm	ASTM D5185(m)	<0.1	0	---	---

IMAGES DE L'ÉCHANTILLON		methode	limite/base	actuel	passé1	passé2
Coluer					no image	no image
Fond					no image	no image

## GRAPHIQUES

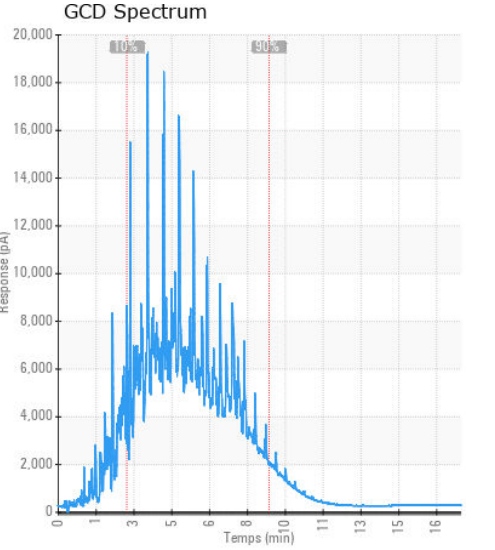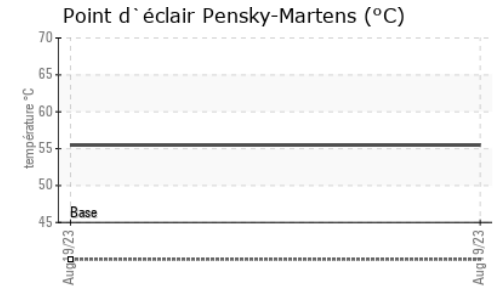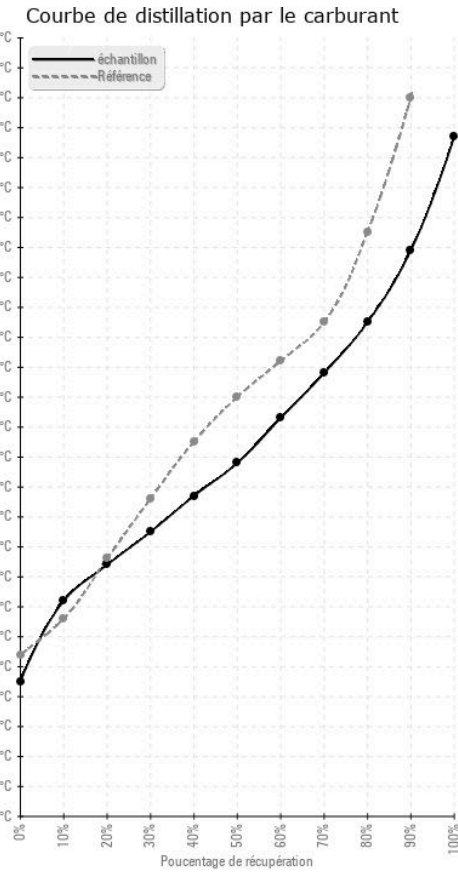

**Laboratoire** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**N° d'échantillon** : CU0019852  
**N° de laboratoire** : 02578272  
**Numéro unique** : 5631332  
**Analyse** : FUEL ( Additional Tests: CC Flash, GC-PercFuel, PrtCount )

**CUMMINS EASTERN CANADA LP**  
 3189 SWANSEA CRESCENT  
 OTTAWA, ON  
 CA K1G 3W5  
 Contact: Max Lauzon  
 max.lauzon@cummins.com  
 T:  
 F: (613)736-1202

Pour discuter cette rapport, contacter le service à la clientèle au 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 La validez de los resultados y la interpretación se basan en la muestra y la información proporcionada.