



RAPPORT DU CARBURANT

Sample Rating Trend

NORMALE



Secteur
CONFEDERATION [99874]
Identité de la machine
G060945002

Composant
Carburant diesel
Fluide

No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- GAL)



DIAGNOSTIC

Recommendation

Laboratory test indicate that this fuel is suitable for use and meets all test requirements. Resample at the next service interval to monitor.

Corrossione

{not applicable}

Contaminants

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. There is no indication of any contamination in the diesel fuel.

État Du Carburant

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel (US EPA/CGSB-3.517-3 type B).

| INFORMATION SUR L'ÉCHANTILLON | | methode | limite/base | actuel | passé1 | passé2 |
|-------------------------------|-------------|-------------|-------------|--------------------|--------|--------|
| Numéro d'échant. | Client Info | | | CU0021996 | --- | --- |
| Date d'échant. | Client Info | | | 30 Oct 2023 | --- | --- |
| Âge d la Machine | hrs | Client Info | | 0 | --- | --- |
| Statut de l'échant. | | | | NORMAL | --- | --- |

| PHYSICAL PROPERTIES | | methode | limite/base | actuel | passé1 | passé2 |
|-------------------------------|------|----------------|-------------|--------------|--------|--------|
| Densité | | ASTM D1298* | 0.839 | 0.827 | --- | --- |
| Couleur du carburant | text | Visual Screen* | Yllow | Red | --- | --- |
| Visc 40°C | cSt | ASTM D7279(m) | 3.0 | 2.2 | --- | --- |
| Point d'éclair Pensky-Martens | °C | ASTM D7215* | 52 | 53.9 | --- | --- |

| SULFUR CONTENT | | methode | limite/base | actuel | passé1 | passé2 |
|----------------|-----|---------------|-------------|----------|--------|--------|
| Soufre | ppm | ASTM D5185(m) | 10 | 9 | --- | --- |






| DISTILLATION | | methode | limite/base | actuel | passé1 | passé2 |
|------------------------------|----|-------------|-------------|------------|--------|--------|
| Point d'ébullition initial | °C | ASTM D2887* | 165 | 162 | --- | --- |
| Point de distillation de 5% | °C | ASTM D2887* | | 183 | --- | --- |
| Point de distillation de 10% | °C | ASTM D2887* | 201 | 192 | --- | --- |
| Point de distillation de 15% | °C | ASTM D2887* | | 200 | --- | --- |
| Point de distillation de 20% | °C | ASTM D2887* | 216 | 207 | --- | --- |
| Point de distillation de 30% | °C | ASTM D2887* | 230 | 221 | --- | --- |
| Point de distillation de 40% | °C | ASTM D2887* | 243 | 235 | --- | --- |
| Point de distillation de 50% | °C | ASTM D2887* | 255 | 248 | --- | --- |
| Point de distillation de 60% | °C | ASTM D2887* | 267 | 263 | --- | --- |
| Point de distillation de 70% | °C | ASTM D2887* | 280 | 277 | --- | --- |
| Point de distillation de 80% | °C | ASTM D2887* | 295 | 293 | --- | --- |
| Point de distillation de 85% | °C | ASTM D2887* | | 305 | --- | --- |
| Point de distillation de 90% | °C | ASTM D2887* | 310 | 316 | --- | --- |
| Point de distillation de 95% | °C | ASTM D2887* | | 336 | --- | --- |
| Point d'ébullition final | °C | ASTM D2887* | 341 | 358 | --- | --- |

| IGNITION QUALITY | | methode | limite/base | actuel | passé1 | passé2 |
|------------------|--|-------------|-------------|-----------|--------|--------|
| Densité API | | ASTM D1298* | 37.7 | 39 | --- | --- |
| Indice de cétane | | ASTM D4737* | <40.0 | 50 | --- | --- |

| CONTAMINANTS | | methode | limite/base | actuel | passé1 | passé2 |
|--------------|-----|---------------|-------------|--------------|--------|--------|
| Silicium | ppm | ASTM D5185(m) | <1.0 | 0 | --- | --- |
| Sodium | ppm | ASTM D5185(m) | <0.1 | 0 | --- | --- |
| Potassium | ppm | ASTM D5185(m) | <0.1 | <1 | --- | --- |
| Eau | % | ASTM D6304* | <0.05 | 0.001 | --- | --- |
| ppm d'eau | ppm | ASTM D6304* | <500 | 10.5 | --- | --- |

| PROPRETÉ DU FLUIDE | | methode | limite/base | actuel | passé1 | passé2 |
|---------------------|--|--------------|-------------|-----------------|--------|--------|
| Particules >4µ | | ASTM D7647 | >2500 | 1055 | --- | --- |
| Particules >6µ | | ASTM D7647 | >640 | 317 | --- | --- |
| Particules >14µ | | ASTM D7647 | >80 | 35 | --- | --- |
| Particules >21µ | | ASTM D7647 | >20 | 9 | --- | --- |
| Particules >38µ | | ASTM D7647 | >4 | 0 | --- | --- |
| Particules >71µ | | ASTM D7647 | >3 | 0 | --- | --- |
| Propreté de l'huile | | ISO 4406 (c) | >18/16/13 | 17/15/12 | --- | --- |




RAPPORT DU CARBURANT

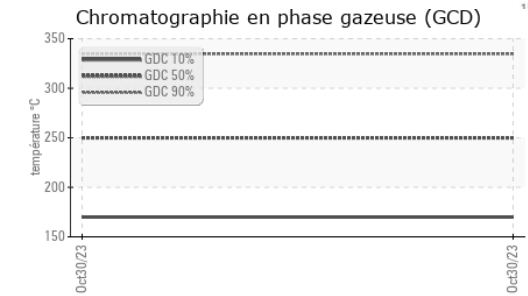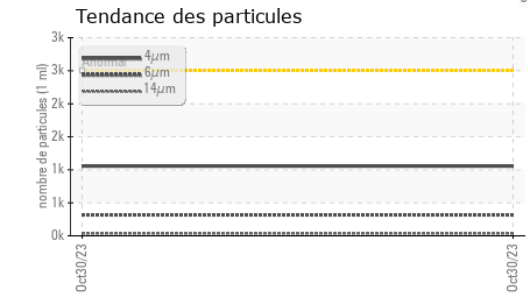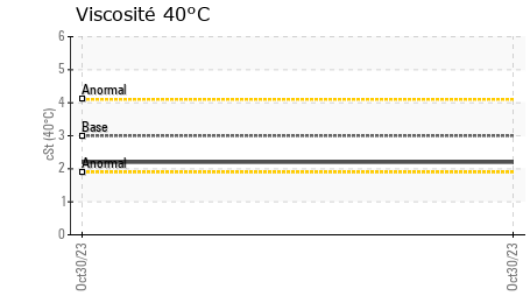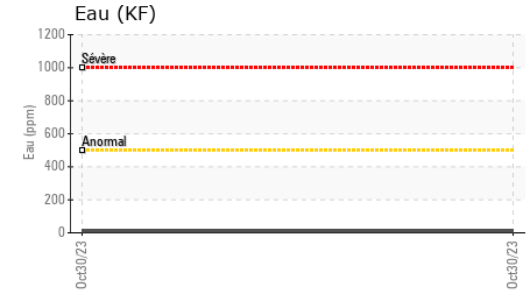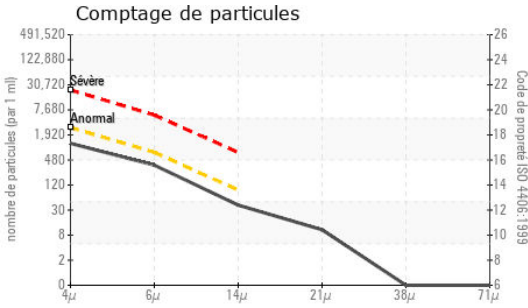

| HEAVY METALS | methode | limite/base | actuel | passé1 | passé2 |
|--------------|---------|---------------|--------|--------|--------|
| Aluminium | ppm | ASTM D5185(m) | <0.1 | 0 | --- |
| Nickel | ppm | ASTM D5185(m) | <0.1 | 0 | --- |
| Plomb | ppm | ASTM D5185(m) | <0.1 | 0 | --- |
| Vanadium | ppm | ASTM D5185(m) | <0.1 | 0 | --- |
| Fer | ppm | ASTM D5185(m) | <0.1 | <1 | --- |
| Calcium | ppm | ASTM D5185(m) | <0.1 | <1 | --- |
| Magnésium | ppm | ASTM D5185(m) | <0.1 | <1 | --- |
| Phosphore | ppm | ASTM D5185(m) | <0.1 | <1 | --- |
| Zinc | ppm | ASTM D5185(m) | <0.1 | <1 | --- |

| IMAGES DE L'ÉCHANTILLON | methode | limite/base | actuel | passé1 | passé2 |
|-------------------------|---------|-------------|--------|----------|----------|
| Coluer | | | | no image | no image |
| Fond | | | | no image | no image |

GRAPHIQUES

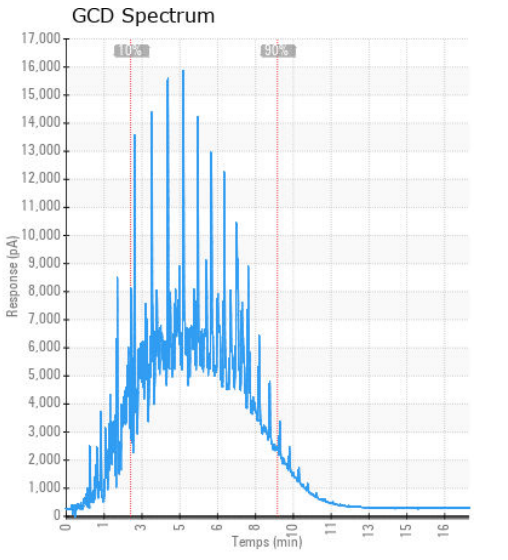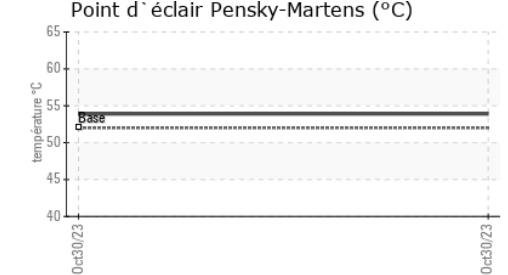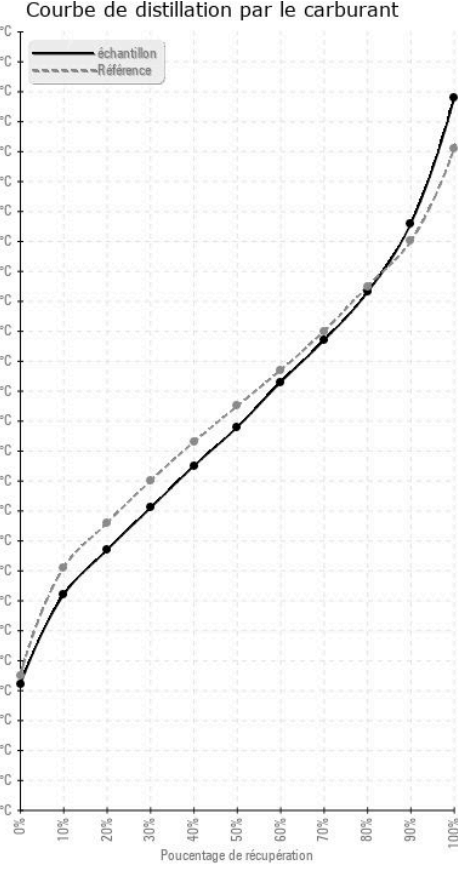

Laboratoire : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
N° d'échantillon : CU0021996
N° de laboratoire : 02593060
Numéro unique : 5670139
Analyse : FUEL (Additional Tests: CC Flash, GC-PercFuel, PrtCount)

CUMMINS EASTERN CANADA LP
 3189 SWANSEA CRESCENT
 OTTAWA, ON
 CA K1G 3W5
 Contact: Cindy Harrison
 cindy.harrison@cummins.com
 T: (613)736-1146
 F: x:

Pour discuter cette rapport, contacter le service à la clientèle au 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 La validez de los resultados y la interpretación se basan en la muestra y la información proporcionada.