


PROBLEM SUMMARY

Sample Rating Trend



WATER


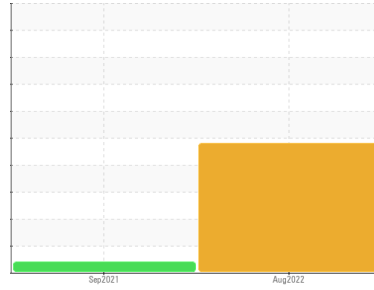


Machine Id
KAESER SFC 55T 6235682 (S/N 1068)

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

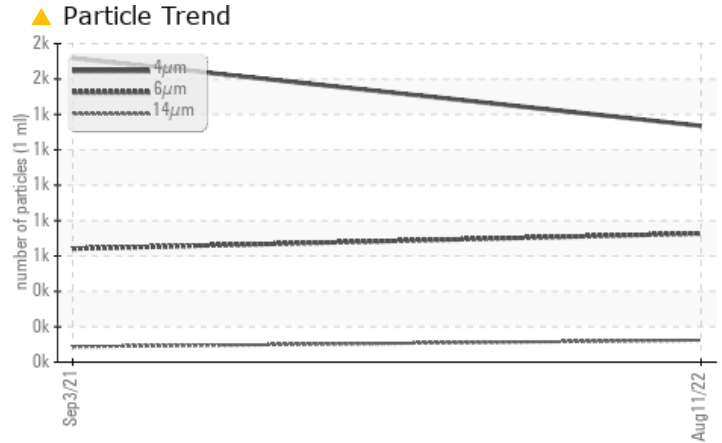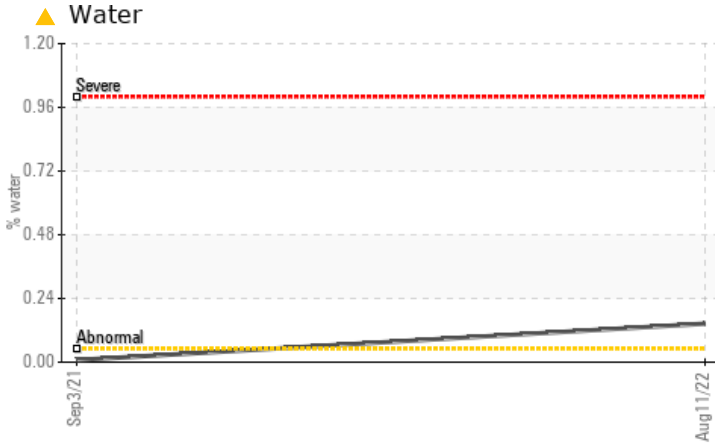

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	ATTENTION	---
Water	%	ASTM D6304	>0.05	▲ 0.145	0.008	---
ppm Water	ppm	ASTM D6304	>500	▲ 1450	87.8	---
Particles >14µm		ASTM D7647	>80	▲ 124	▲ 87	---
Particles >21µm		ASTM D7647	>20	▲ 42	20	---
Particles >38µm		ASTM D7647	>4	▲ 6	2	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 18/17/14	▲ 17/14	---
Free Water	scalar	*Visual		▲ 1.0	NEG	---

Customer Id: TRUFRE
Sample No.: KCP48250
Lab Number: 05618953
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

03 Sep 2021 Diag: Don Baldrige

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report



Machine Id
KAESER SFC 55T 6235682 (S/N 1068)

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

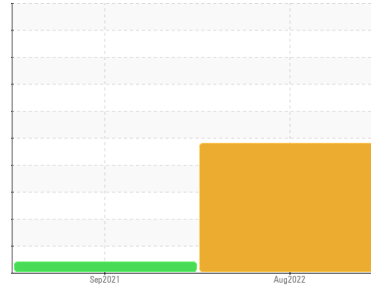

DIAGNOSIS

▲ Recommendation

Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

▲ Contamination

There is a moderate amount of particulates present in the oil. Free water present. There is a light concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history 1	history 2
Sample Number				KCP48250	KCP37997	---
Sample Date				11 Aug 2022	03 Sep 2021	---
Machine Age	hrs			0	25544	---
Oil Age	hrs			0	0	---
Oil Changed				Changed	Changed	---
Sample Status				ABNORMAL	ATTENTION	---

WEAR METALS		method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m	>50	0	0	---
Chromium	ppm	ASTM D5185m	>10	0	0	---
Nickel	ppm	ASTM D5185m	>3	0	0	---
Titanium	ppm	ASTM D5185m	>3	0	0	---
Silver	ppm	ASTM D5185m	>2	0	0	---
Aluminum	ppm	ASTM D5185m	>10	0	0	---
Lead	ppm	ASTM D5185m	>10	0	0	---
Copper	ppm	ASTM D5185m	>50	16	11	---
Tin	ppm	ASTM D5185m	>10	<1	<1	---
Antimony	ppm	ASTM D5185m		---	0	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---



ADDITIVES		method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m	0	<1	2	---
Barium	ppm	ASTM D5185m	90	0	0	---
Molybdenum	ppm	ASTM D5185m	0	0	0	---
Manganese	ppm	ASTM D5185m		0	0	---
Magnesium	ppm	ASTM D5185m	100	<1	0	---
Calcium	ppm	ASTM D5185m	0	0	0	---
Phosphorus	ppm	ASTM D5185m	0	0	0	---
Zinc	ppm	ASTM D5185m	0	2	0	---
Sulfur	ppm	ASTM D5185m	23500	14715	13480	---

CONTAMINANTS		method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m	>25	<1	0	---
Sodium	ppm	ASTM D5185m		<1	0	---
Potassium	ppm	ASTM D5185m	>20	0	0	---
Water	%	ASTM D6304	>0.05	▲ 0.145	0.008	---
ppm Water	ppm	ASTM D6304	>500	▲ 1450	87.8	---

FLUID CLEANLINESS		method	limit/base	current	history 1	history 2
Particles >4µm		ASTM D7647		1335	1718	---
Particles >6µm		ASTM D7647	>1300	727	641	---
Particles >14µm		ASTM D7647	>80	▲ 124	▲ 87	---
Particles >21µm		ASTM D7647	>20	▲ 42	20	---
Particles >38µm		ASTM D7647	>4	▲ 6	2	---
Particles >71µm		ASTM D7647	>3	1	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 18/17/14	▲ 17/14	---

FLUID DEGRADATION		method	limit/base	current	history 1	history 2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.54	0.529	---


OIL ANALYSIS REPORT

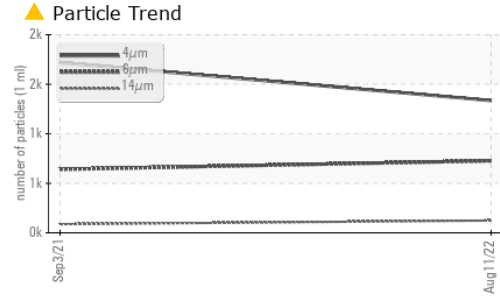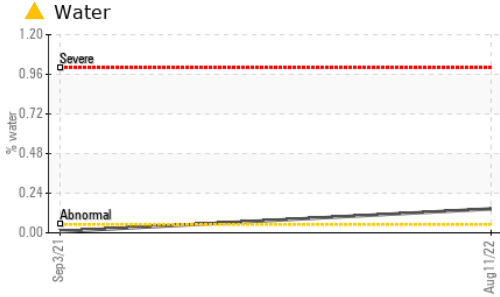






VISUAL	method	limit/base	current	history 1	history 2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	0.2%	NEG
Free Water	scalar	*Visual	▲ 1.0	NEG	---

FLUID PROPERTIES	method	limit/base	current	history 1	history 2
Visc @ 40°C	cSt	ASTM D445	45	48.9	50.7

SAMPLE IMAGES	method	limit/base	current	history 1	history 2
---------------	--------	------------	---------	-----------	-----------

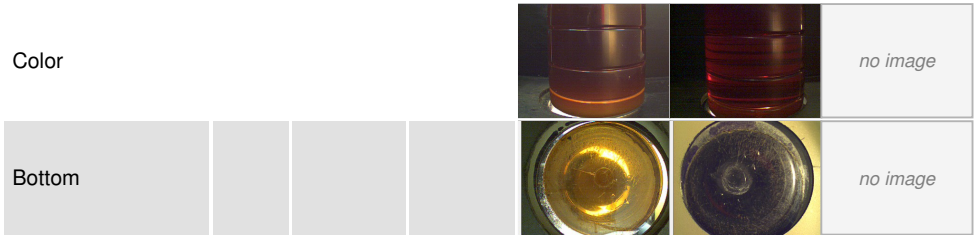

GRAPHS

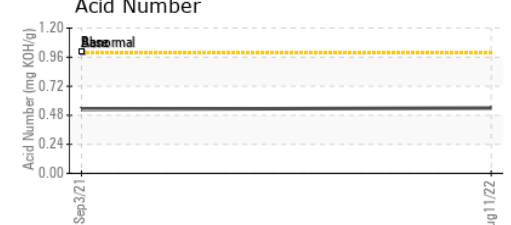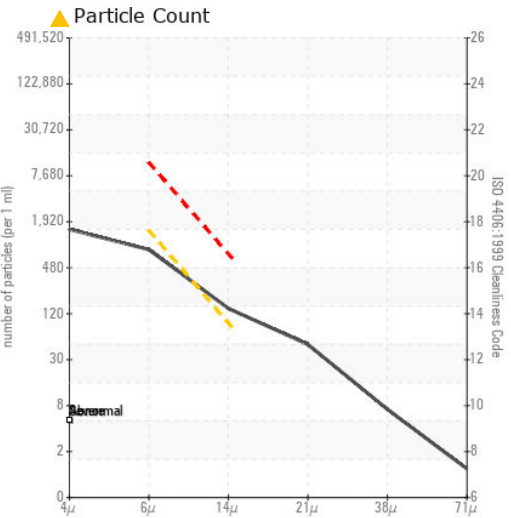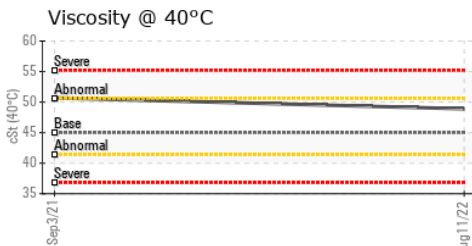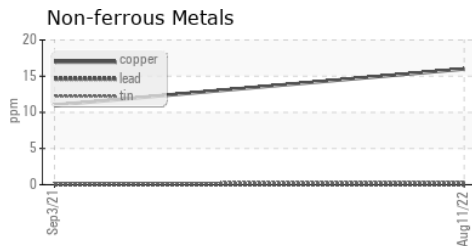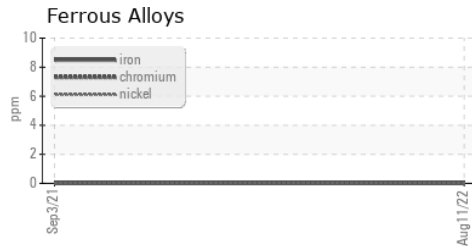

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP48250 **Received** : 16 Aug 2022
Lab Number : 05618953 **Diagnosed** : 22 Aug 2022
Unique Number : 10098460 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

TRUE-TECH CORPORATION - JABIL
 4050 TECHNOLOGY DR
 FREMONT, CA
 USA 94538
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: