

## **PROBLEM SUMMARY**

Sample Rating Trend



Machine Id


# KAESER ASD 25 4022787 (S/N 1490)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

#### **COMPONENT CONDITION SUMMARY**

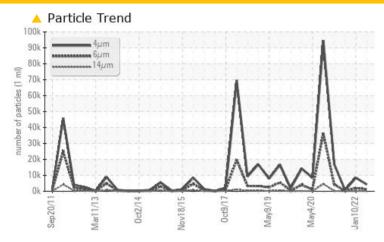

#### **RECOMMENDATION**

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			ATTENTION	ATTENTION	NORMAL				
Particles >14μm	ASTM D7647	>80	<b>4</b> 96	<u>▲</u> 108	12				
Oil Cleanliness	ISO 4406 (c)	>/17/13	<b>19/17/14</b>	<u> </u>	14/11				

Customer Id: PERHOU Sample No.: KC91328 Lab Number: 05621824 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Jonathan Hester +1 919-379-4092 x4092 jhester@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

#### **RECOMMENDED ACTIONS**

Action	Status	Date	Done By	Description
Change Fluid			?	Oil and filter change at the time of sampling has been noted.
Change Filter			?	Oil and filter change at the time of sampling has been noted.

#### HISTORICAL DIAGNOSIS

#### 10 Jan 2022 Diag: Jonathan Hester





No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



#### 27 Aug 2021 Diag: Don Baldridge

#### NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

# view report

#### 01 Feb 2021 Diag: Doug Bogart

ISO



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





## **OIL ANALYSIS REPORT**

Sample Rating Trend



Machine Id

# KAESER ASD 25 4022787 (S/N 1490)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

#### DIAGNOSIS

#### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a moderate amount of particulates present in the oil.

#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		p2011 Mar2i	013 Oct2014 Nov2015	Oct2017 May2019 May2020	Jan2022	
SAMPLE INFORM	MATION	method	limit/base	current	history 1	history 2
Sample Number				KC91328	KC85652	KC98915
Sample Date				15 Aug 2022	10 Jan 2022	27 Aug 2021
Machine Age	hrs			77993	74443	72716
Oil Age	hrs			6000	2000	6000
Oil Changed				Changed	Not Changd	Changed
Sample Status				ATTENTION	ATTENTION	NORMAL
WEAR METALS		method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m	>50	0	<1	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	1	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	1	<1
Aluminum	ppm	ASTM D5185m	>10	<1	1	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	11	5	8
Tin	ppm	ASTM D5185m	>10	<1	0	0
Antimony	ppm	ASTM D5185m			0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m		0	0	12
Barium	ppm	ASTM D5185m	90	0	6	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m	90	1	38	0
Calcium	ppm	ASTM D5185m	2	0	<1	0
Phosphorus	ppm	ASTM D5185m		4	4	<1
Zinc	ppm	ASTM D5185m		7	19	0
CONTAMINANTS		method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m	>25	<1	<1	<1
Sodium	ppm	ASTM D5185m		<1	19	<1
Potassium	ppm	ASTM D5185m	>20	<1	0	0
Water	%	ASTM D6304	>0.05	0.008	0.006	0.011
ppm Water	ppm	ASTM D6304	>500	85.7	60.4	111.7
FLUID CLEANLIN	IESS	method	limit/base	current	history 1	history 2
Particles >4μm		ASTM D7647		4286	8401	721
Particles >6µm		ASTM D7647	>1300	1195	<b>▲</b> 1975	137
Particles >14µm		ASTM D7647	>80	<b>4</b> 96	<u> </u>	12
Particles >21µm		ASTM D7647	>20	18	<u>^</u> 25	3
Particles >38μm		ASTM D7647	>4	1	1	0
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	<b>19/17/14</b>	<u>▲</u> 18/14	14/11
FLUID DEGRADA	TION	method	limit/base	current	history 1	history 2
A : 1 A 1 (A A 1)		AOTA DOO45	0.4	0.24	0.400	0.045

Acid Number (AN)

mg KOH/g ASTM D8045 0.4


0.428

0.34

0.345



## **OIL ANALYSIS REPORT**



VISUAL		method	limit/base	current	history 1	history 2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
<b>Emulsified Water</b>	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	TIES	method	limit/base	current	history 1	history 2

1.20 T							
Sev	ere	1111		1111	1 1 1 1 1		
0.96							
팔0.72							
0.72 +							
0.24				۸			
0.00 Abr	ormal			_/:\_			
150	1/13	2/14	8/15	9/17	9/19	4/20	0/22
ep2	- Fo	Oct	2	Oct	Λαγ	/ay	=

Visc @ 40°C cSt ASTM D445 46 44.7 45.0 44.3

SAMPLE IMAGES

method

limit/base

current

history 1

history 2

Color


**Bottom** 









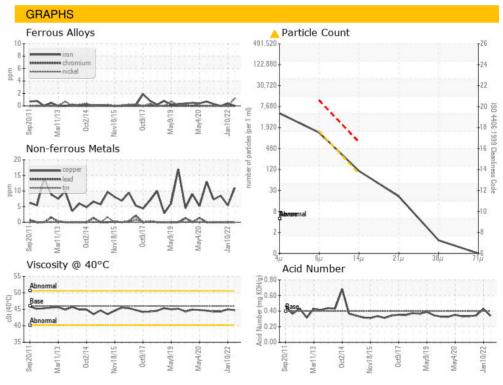



Certificate L2367

Laboratory Sample No. Lab Number **Unique Number** 

: KC91328 : 05621824 : 10101331 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 19 Aug 2022 Diagnosed Diagnostician : Jonathan Hester

: 22 Aug 2022

**PERRYMAN** 213 VANDALE DR HOUSTON, PA USA 15342

Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: