


PROBLEM SUMMARY

Sample Rating Trend



ISO

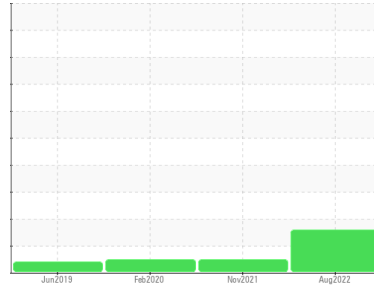


Machine Id
KAESER CSD 75 5571007 (S/N 1219)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

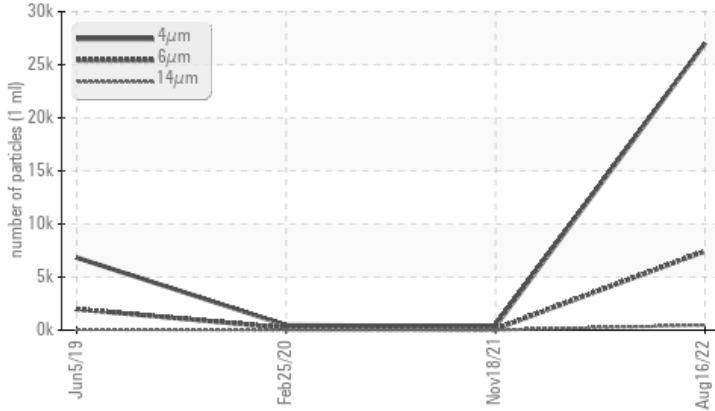

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	NORMAL	NORMAL
Particles >6µm	ASTM D7647	>1300	▲ 7445	107	204
Particles >14µm	ASTM D7647	>80	▲ 469	11	25
Particles >21µm	ASTM D7647	>20	▲ 70	2	7
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 22/20/16	14/11	15/12

Customer Id: HOBOKL
Sample No.: KCP50540
Lab Number: 05623865
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

18 Nov 2021 Diag: Jonathan Hester

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



25 Feb 2020 Diag: Jonathan Hester

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



05 Jun 2019 Diag: Jonathan Hester

ISO



The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report



Machine Id
KAESER CSD 75 5571007 (S/N 1219)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

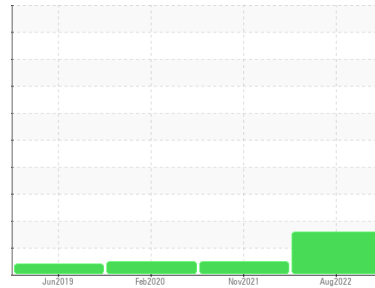

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history 1	history 2
Sample Number		KCP50540	KCP39799	KCP20631
Sample Date		16 Aug 2022	18 Nov 2021	25 Feb 2020
Machine Age	hrs	22907	19988	13830
Oil Age	hrs	2919	6158	0
Oil Changed		Not Changed	Changed	N/A
Sample Status		ABNORMAL	NORMAL	NORMAL

WEAR METALS

method	limit/base	current	history 1	history 2
Iron	ppm ASTM D5185m >50	<1	0	1
Chromium	ppm ASTM D5185m >10	0	0	<1
Nickel	ppm ASTM D5185m >3	0	0	<1
Titanium	ppm ASTM D5185m >3	0	0	0
Silver	ppm ASTM D5185m >2	0	0	<1
Aluminum	ppm ASTM D5185m >10	<1	1	<1
Lead	ppm ASTM D5185m >10	0	0	<1
Copper	ppm ASTM D5185m >50	3	6	4
Tin	ppm ASTM D5185m >10	0	0	0
Antimony	ppm ASTM D5185m	---	0	0
Vanadium	ppm ASTM D5185m	0	0	0
Cadmium	ppm ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history 1	history 2
Boron	ppm ASTM D5185m	0	0	<1
Barium	ppm ASTM D5185m 90	0	0	0
Molybdenum	ppm ASTM D5185m	0	0	0
Manganese	ppm ASTM D5185m	0	0	0
Magnesium	ppm ASTM D5185m 90	61	39	59
Calcium	ppm ASTM D5185m 2	0	0	<1
Phosphorus	ppm ASTM D5185m	3	5	<1
Zinc	ppm ASTM D5185m	41	63	20
Sulfur	ppm ASTM D5185m	18401	16259	14999

CONTAMINANTS

method	limit/base	current	history 1	history 2
Silicon	ppm ASTM D5185m >25	<1	0	<1
Sodium	ppm ASTM D5185m	19	25	24
Potassium	ppm ASTM D5185m >20	6	8	17
Water	% ASTM D6304 >0.05	0.027	0.015	0.011
ppm Water	ppm ASTM D6304 >500	276.1	155.7	119.2


FLUID CLEANLINESS

method	limit/base	current	history 1	history 2
Particles >4µm	ASTM D7647	27028	374	459
Particles >6µm	ASTM D7647 >1300	▲ 7445	107	204
Particles >14µm	ASTM D7647 >80	▲ 469	11	25
Particles >21µm	ASTM D7647 >20	▲ 70	2	7
Particles >38µm	ASTM D7647 >4	3	0	0
Particles >71µm	ASTM D7647 >3	0	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 22/20/16	14/11	15/12

FLUID DEGRADATION

method	limit/base	current	history 1	history 2
Acid Number (AN)	mg KOH/g ASTM D8045 0.4	0.34	0.409	0.359


OIL ANALYSIS REPORT

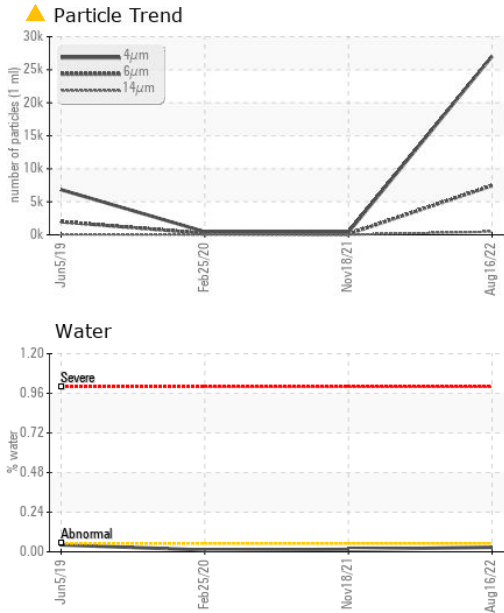


PARAMETER	method	limit/base	current	history 1	history 2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history 1	history 2
Visc @ 40°C	cSt	ASTM D445 46	43.8	44.7	47.0

SAMPLE IMAGES	method	limit/base	current	history 1	history 2
---------------	--------	------------	---------	-----------	-----------

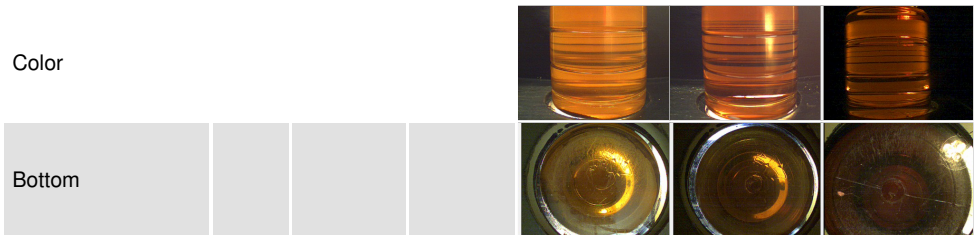

GRAPHS

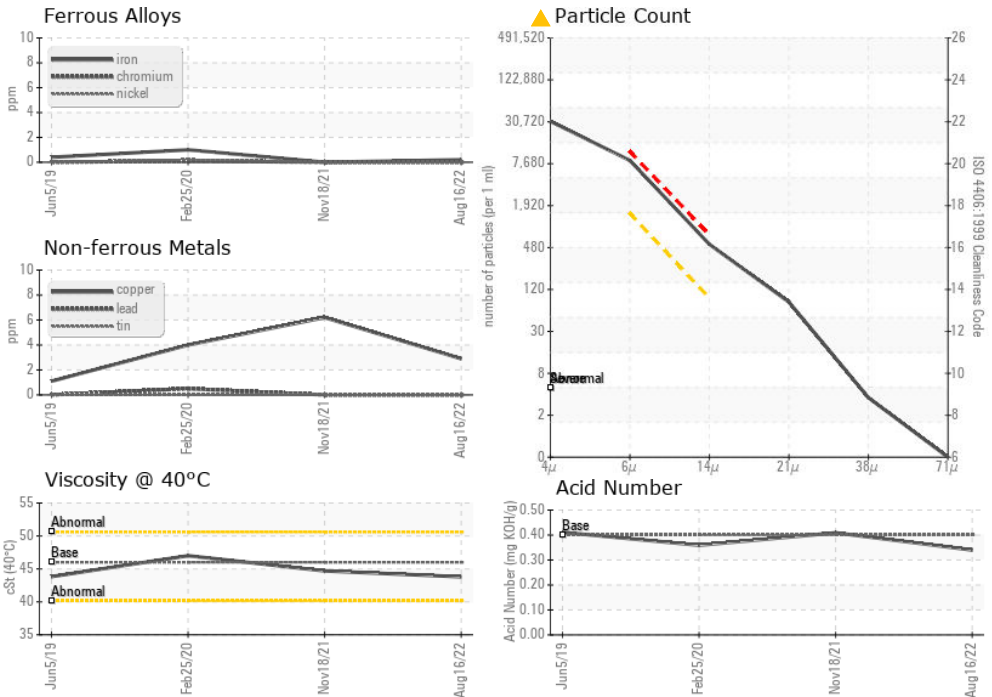

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP50540 **Received** : 22 Aug 2022
Lab Number : 05623865 **Diagnosed** : 24 Aug 2022
Unique Number : 10103372 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

HOBBY LOBBY
 7707 SW 44TH ST
 OKLAHOMA CITY, OK
 USA 73179
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)