

PROBLEM SUMMARY

Sample Rating Trend



ISO




Machine Id
NOT GIVEN KCP48325 (S/N NO INFO ON SIF/BOTTLE)

Component
Compressor
Fluid
NOT GIVEN (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

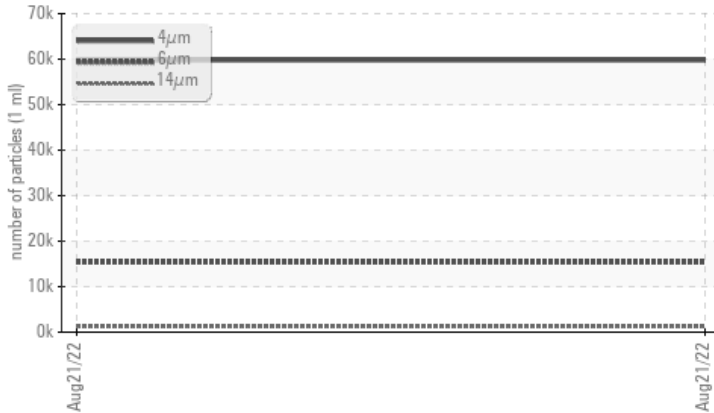

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	---	---
Particles >6µm	ASTM D7647	>1300	▲ 15364	---	---
Particles >14µm	ASTM D7647	>80	▲ 1229	---	---
Particles >21µm	ASTM D7647	>20	▲ 202	---	---
Particles >38µm	ASTM D7647	>4	▲ 9	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 23/21/17	---	---

Customer Id: KAEFRE
Sample No.: KCP48325
Lab Number: 05623868
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.

HISTORICAL DIAGNOSIS

OIL ANALYSIS REPORT

Sample Rating Trend



ISO



Machine Id
NOT GIVEN KCP48325 (S/N NO INFO ON SIF/BOTTLE)

Component
Compressor
Fluid
NOT GIVEN (--- GAL)

DIAGNOSIS

▲ Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history 1	history 2
Sample Number			KCP48325	---	---
Sample Date			21 Aug 2022	---	---
Machine Age	hrs		0	---	---
Oil Age	hrs		0	---	---
Oil Changed			N/A	---	---
Sample Status			ABNORMAL	---	---

WEAR METALS

	method	limit/base	current	history 1	history 2
Iron	ppm ASTM D5185m	>50	1	---	---
Chromium	ppm ASTM D5185m	>10	0	---	---
Nickel	ppm ASTM D5185m		0	---	---
Titanium	ppm ASTM D5185m		0	---	---
Silver	ppm ASTM D5185m		0	---	---
Aluminum	ppm ASTM D5185m	>25	1	---	---
Lead	ppm ASTM D5185m	>25	0	---	---
Copper	ppm ASTM D5185m	>50	2	---	---
Tin	ppm ASTM D5185m	>15	0	---	---
Vanadium	ppm ASTM D5185m		0	---	---
Cadmium	ppm ASTM D5185m		0	---	---

ADDITIVES

	method	limit/base	current	history 1	history 2
Boron	ppm ASTM D5185m		0	---	---
Barium	ppm ASTM D5185m		0	---	---
Molybdenum	ppm ASTM D5185m		0	---	---
Manganese	ppm ASTM D5185m		<1	---	---
Magnesium	ppm ASTM D5185m		9	---	---
Calcium	ppm ASTM D5185m		0	---	---
Phosphorus	ppm ASTM D5185m		3	---	---
Zinc	ppm ASTM D5185m		6	---	---
Sulfur	ppm ASTM D5185m		18370	---	---

CONTAMINANTS

	method	limit/base	current	history 1	history 2
Silicon	ppm ASTM D5185m	>25	<1	---	---
Sodium	ppm ASTM D5185m		2	---	---
Potassium	ppm ASTM D5185m	>20	0	---	---
Water	% ASTM D6304	>0.1	0.010	---	---
ppm Water	ppm ASTM D6304	>1000	106.6	---	---


FLUID CLEANLINESS

	method	limit/base	current	history 1	history 2
Particles >4µm	ASTM D7647		59770	---	---
Particles >6µm	ASTM D7647	>1300	▲ 15364	---	---
Particles >14µm	ASTM D7647	>80	▲ 1229	---	---
Particles >21µm	ASTM D7647	>20	▲ 202	---	---
Particles >38µm	ASTM D7647	>4	▲ 9	---	---
Particles >71µm	ASTM D7647	>3	0	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 23/21/17	---	---

FLUID DEGRADATION

	method	limit/base	current	history 1	history 2
Acid Number (AN)	mg KOH/g ASTM D8045		0.41	---	---

OIL ANALYSIS REPORT

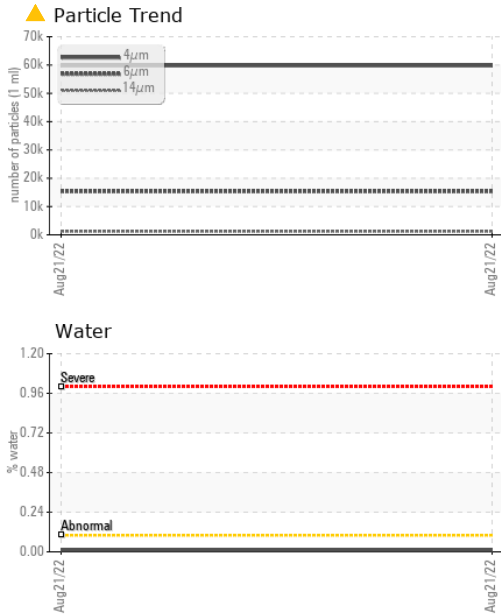




VISUAL	method	limit/base	current	history 1	history 2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history 1	history 2
Visc @ 40°C	cSt	ASTM D445	46.8	---	---

SAMPLE IMAGES	method	limit/base	current	history 1	history 2
---------------	--------	------------	---------	-----------	-----------

Color				no image	no image
Bottom				no image	no image

GRAPHS

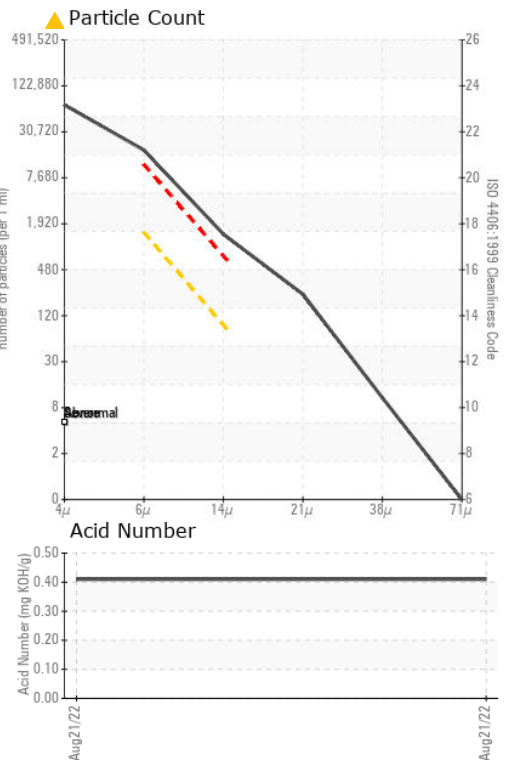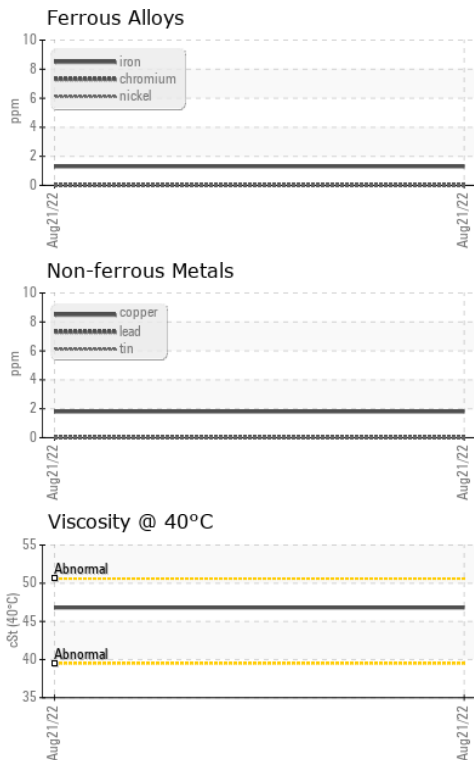

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP48325 **Received** : 22 Aug 2022
Lab Number : 05623868 **Diagnosed** : 24 Aug 2022
Unique Number : 10103375 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

KAESER COMPRESSOR
 511 SIGMA DRIVE
 FREDERICKSBURG, VA
 USA 22408
 Contact: Warranty Department
 warranty.us@kaeser.com
 T: (540)898-5500
 F: (540)898-5520

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)