


PROBLEM SUMMARY

Sample Rating Trend



ISO

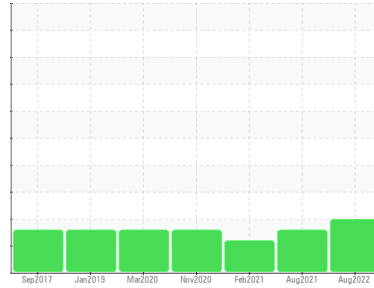


Machine Id
KAESER SK 15 5319317 (S/N 1055)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

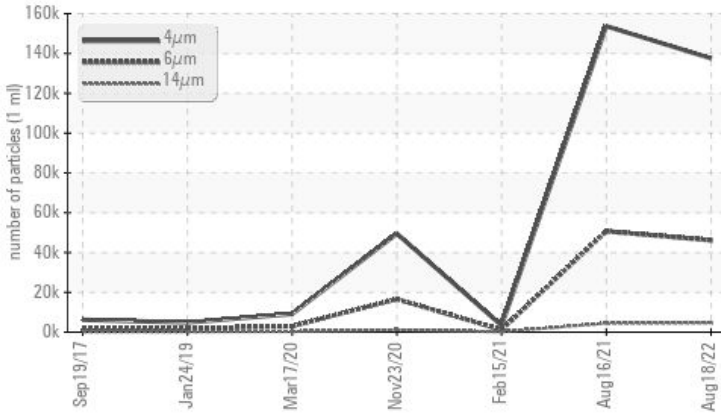

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	ABNORMAL
Particles >6µm	ASTM D7647	>1300	▲ 46146	▲ 50677	1145
Particles >14µm	ASTM D7647	>20	▲ 4729	▲ 4487	▲ 150
Particles >21µm	ASTM D7647	>4	▲ 764	▲ 788	▲ 58
Particles >38µm	ASTM D7647	>3	▲ 29	▲ 21	▲ 6
Oil Cleanliness	ISO 4406 (c)	>17/11	▲ 23/19	▲ 23/19	▲ 17/14

Customer Id: KROFOR
Sample No.: KCP48112
Lab Number: 05623884
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldrige +1
don.b505@comcast.net

To change component or sample information:

Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

16 Aug 2021 Diag: Jonathan Hester

ISO



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



15 Feb 2021 Diag: Doug Bogart

ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



23 Nov 2020 Diag: Don Baldrige

ISO




No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



Machine Id
KAESER SK 15 5319317 (S/N 1055)

Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

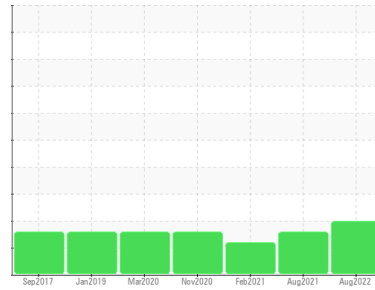

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history 1	history 2
Sample Number			KCP48112	KCP42582	KCP30732
Sample Date			18 Aug 2022	16 Aug 2021	15 Feb 2021
Machine Age	hrs		28594	24381	22183
Oil Age	hrs		1610	2200	4000
Oil Changed			Not Changed	Not Changed	Changed
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m >50	<1	<1	<1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	<1
Aluminum	ppm	ASTM D5185m >10	<1	0	<1
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	1	2	6
Tin	ppm	ASTM D5185m >10	0	0	<1
Antimony	ppm	ASTM D5185m	---	4	10
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m	0	<1	11
Barium	ppm	ASTM D5185m 90	13	6	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	<1	0
Magnesium	ppm	ASTM D5185m 90	78	64	44
Calcium	ppm	ASTM D5185m 2	1	1	0
Phosphorus	ppm	ASTM D5185m	6	2	5
Zinc	ppm	ASTM D5185m	0	0	0
Sulfur	ppm	ASTM D5185m	18722	17089	16928

CONTAMINANTS

	method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m >25	<1	<1	<1
Sodium	ppm	ASTM D5185m	12	14	11
Potassium	ppm	ASTM D5185m >20	0	2	<1
Water	%	ASTM D6304 >0.05	0.025	0.032	0.020
ppm Water	ppm	ASTM D6304 >500	251.3	322.2	209.7


FLUID CLEANLINESS

	method	limit/base	current	history 1	history 2
Particles >4µm	ASTM D7647		137539	153695	3306
Particles >6µm	ASTM D7647	>1300	▲ 46146	▲ 50677	1145
Particles >14µm	ASTM D7647	>20	▲ 4729	▲ 4487	▲ 150
Particles >21µm	ASTM D7647	>4	▲ 764	▲ 788	▲ 58
Particles >38µm	ASTM D7647	>3	▲ 29	▲ 21	▲ 6
Particles >71µm	ASTM D7647	>3	1	0	0
Oil Cleanliness	ISO 4406 (c)	>17/11	▲ 23/19	▲ 23/19	▲ 17/14

FLUID DEGRADATION

	method	limit/base	current	history 1	history 2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.33	0.351	0.359


OIL ANALYSIS REPORT

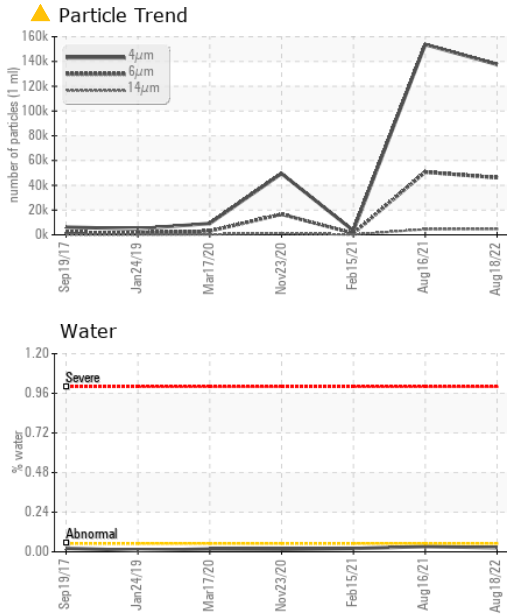



PARAMETER	method	limit/base	current	history 1	history 2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history 1	history 2
Visc @ 40°C	cSt	ASTM D445	46	44.3	44.2

SAMPLE IMAGES	method	limit/base	current	history 1	history 2
---------------	--------	------------	---------	-----------	-----------

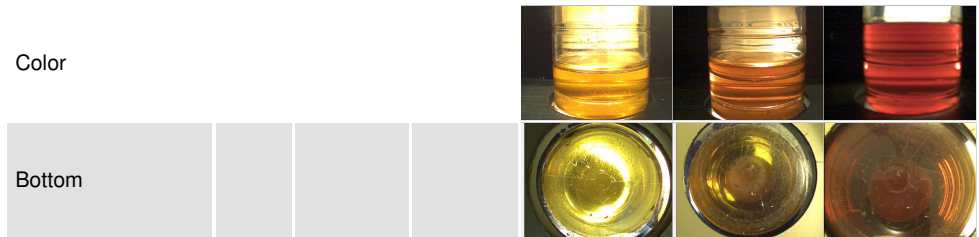

GRAPHS

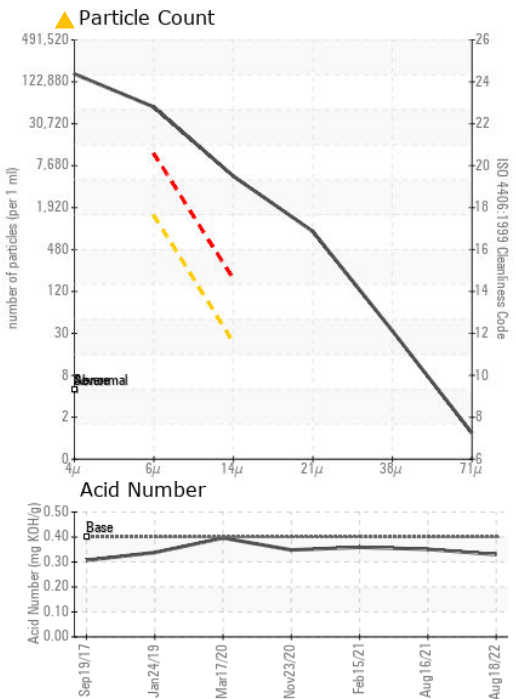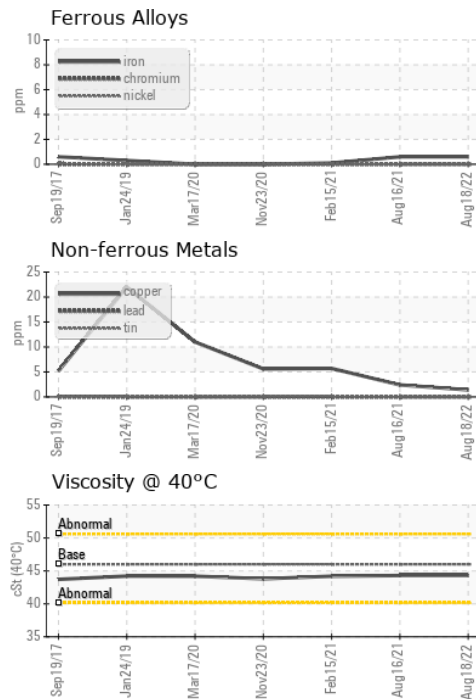

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP48112 **Received** : 22 Aug 2022
Lab Number : 05623884 **Diagnosed** : 24 Aug 2022
Unique Number : 10103391 **Diagnostician** : Don Baldridge
Test Package : IND 2 (Additional Tests: KF, PrtCount)

KROGER DISTRIBUTION
 2000 ANVIL BLOCK RD
 FOREST PARK, GA
 USA 30297
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)