


PROBLEM SUMMARY

Sample Rating Trend



WATER


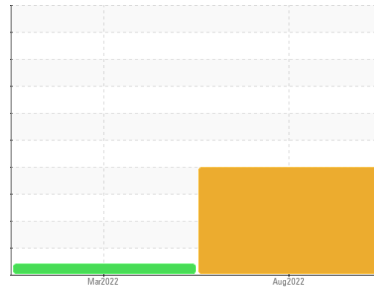


Machine Id
KAESER CSD 100 7116022 (S/N 1043)

Component
Compressor

Fluid
KAESER SIGMA (OEM) FG-460 (--- QTS)

COMPONENT CONDITION SUMMARY

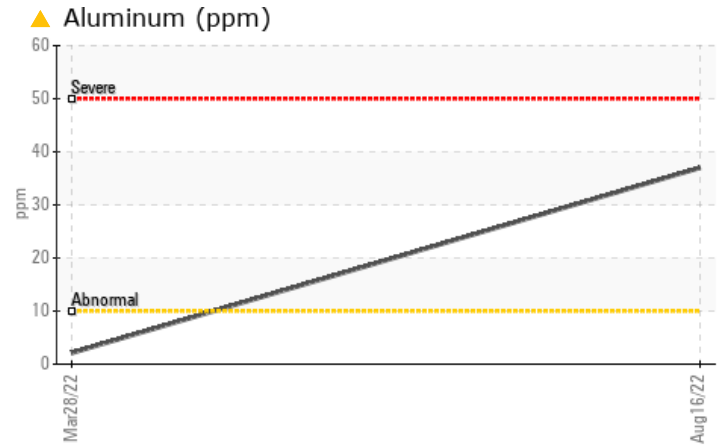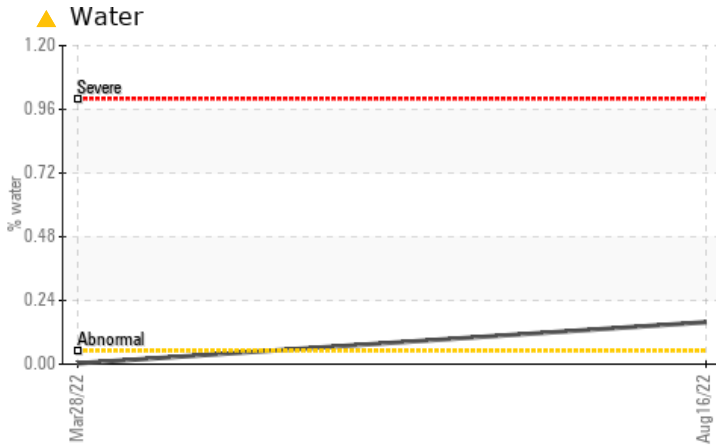

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	ABNORMAL	---
Aluminum	ppm	ASTM D5185m	>10	▲ 37	2	---
Water	%	ASTM D6304	>0.05	▲ 0.158	0.003	---
ppm Water	ppm	ASTM D6304	>500	▲ 1580	31.3	---
Free Water	scalar	*Visual		▲ 1.0	NEG	---

Customer Id: GREWILVT
Sample No.: KCP48125
Lab Number: 05627473
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

28 Mar 2022 Diag: Jonathan Hester

VIS DEBRIS




Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

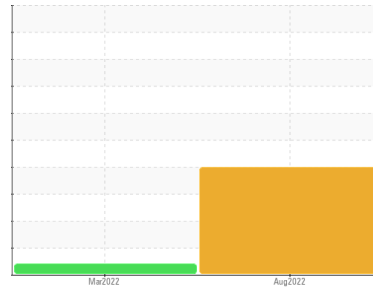

WATER



Machine Id
KAESER CSD 100 7116022 (S/N 1043)

Component
Compressor

Fluid
KAESER SIGMA (OEM) FG-460 (--- QTS)

DIAGNOSIS

▲ Recommendation

Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition.

▲ Wear

The aluminum level is abnormal. All other component wear rates are normal.

▲ Contamination

Free water present. There is a light concentration of water present in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history 1	history 2
Sample Number			KCP48125	KC94933	---
Sample Date			16 Aug 2022	28 Mar 2022	---
Machine Age	hrs		11226	9354	---
Oil Age	hrs		173	2815	---
Oil Changed			Changed	Changed	---
Sample Status			ABNORMAL	ABNORMAL	---

WEAR METALS

	method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m >50	10	0	---
Chromium	ppm	ASTM D5185m >10	<1	0	---
Nickel	ppm	ASTM D5185m >3	0	<1	---
Titanium	ppm	ASTM D5185m >3	0	0	---
Silver	ppm	ASTM D5185m >2	0	0	---
Aluminum	ppm	ASTM D5185m >10	▲ 37	2	---
Lead	ppm	ASTM D5185m >10	<1	0	---
Copper	ppm	ASTM D5185m >50	1	2	---
Tin	ppm	ASTM D5185m >10	<1	0	---
Vanadium	ppm	ASTM D5185m	<1	0	---
Cadmium	ppm	ASTM D5185m	<1	0	---

ADDITIVES

	method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m	0	0	---
Barium	ppm	ASTM D5185m	0	0	---
Molybdenum	ppm	ASTM D5185m	0	0	---
Manganese	ppm	ASTM D5185m	<1	0	---
Magnesium	ppm	ASTM D5185m	2	0	---
Calcium	ppm	ASTM D5185m	<1	0	---
Phosphorus	ppm	ASTM D5185m 500	468	30	---
Zinc	ppm	ASTM D5185m	90	<1	---
Sulfur	ppm	ASTM D5185m	1621	509	---

CONTAMINANTS

	method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m >25	<1	0	---
Sodium	ppm	ASTM D5185m	<1	1	---
Potassium	ppm	ASTM D5185m >20	<1	0	---
Water	%	ASTM D6304 >0.05	▲ 0.158	0.003	---
ppm Water	ppm	ASTM D6304 >500	▲ 1580	31.3	---




FLUID CLEANLINESS

	method	limit/base	current	history 1	history 2
Particles >4µm	ASTM D7647		859	---	---
Particles >6µm	ASTM D7647	>1300	468	---	---
Particles >14µm	ASTM D7647	>80	80	---	---
Particles >21µm	ASTM D7647	>20	27	---	---
Particles >38µm	ASTM D7647	>4	4	---	---
Particles >71µm	ASTM D7647	>3	0	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	17/16/13	---	---

FLUID DEGRADATION

	method	limit/base	current	history 1	history 2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.5	1.46	0.68	---


OIL ANALYSIS REPORT

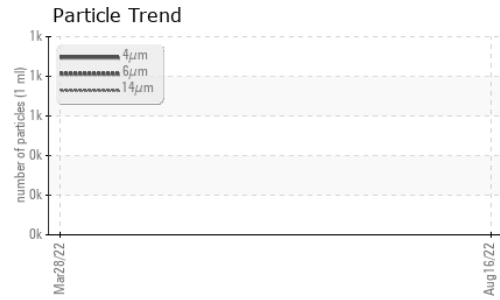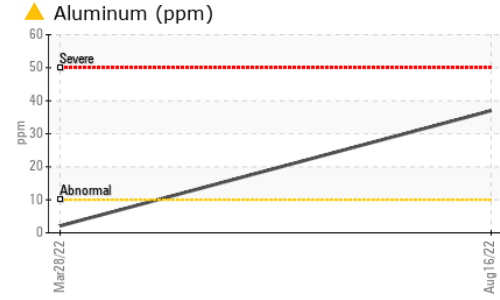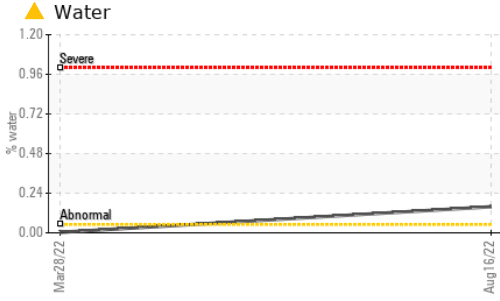






VISUAL	method	limit/base	current	history 1	history 2	
White Metal	scalar	*Visual	NONE	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	NONE	---
Debris	scalar	*Visual	NONE	LIGHT	▲ MODER	---
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	0.2%	NEG	---
Free Water	scalar	*Visual		▲ 1.0	NEG	---

FLUID PROPERTIES	method	limit/base	current	history 1	history 2	
Visc @ 40°C	cSt	ASTM D445	46	46.2	47.4	---

SAMPLE IMAGES	method	limit/base	current	history 1	history 2
---------------	--------	------------	---------	-----------	-----------

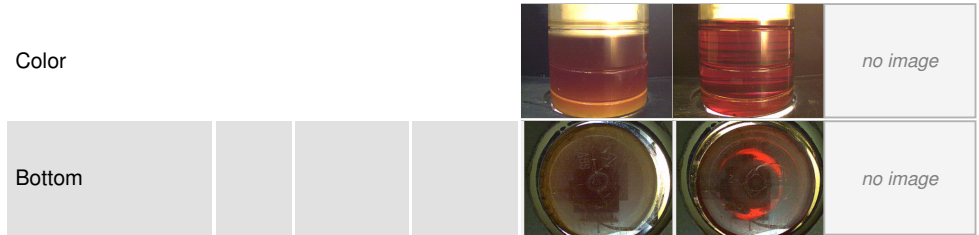

GRAPHS

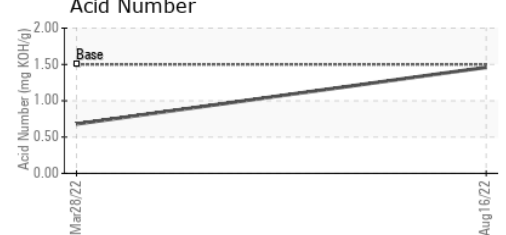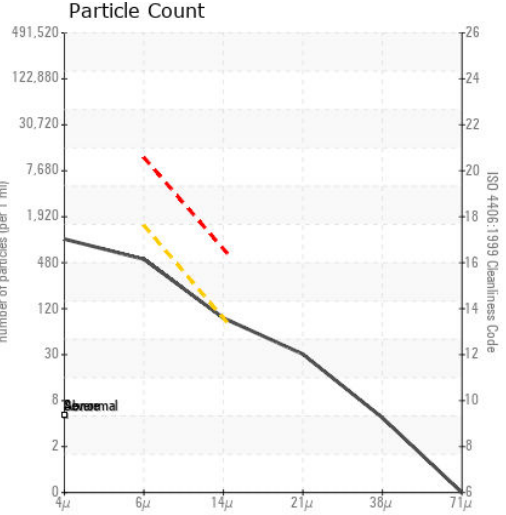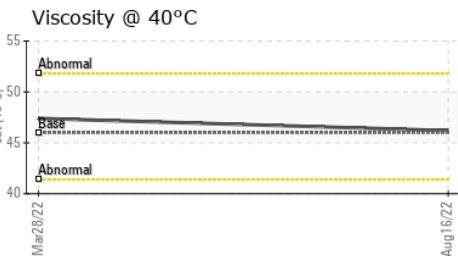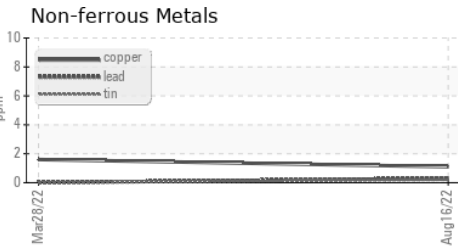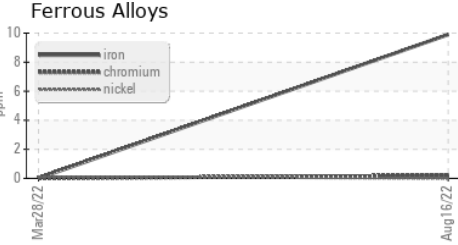

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP48125 **Received** : 25 Aug 2022
Lab Number : 05627473 **Diagnosed** : 30 Aug 2022
Unique Number : 10111994 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

GREEN MOUNTAIN COFFEE ROASTERS
 687 MARSHALL AVE
 WILLISTON, VT
 USA 05495
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: