


# PROBLEM SUMMARY

Sample Rating Trend



ISO

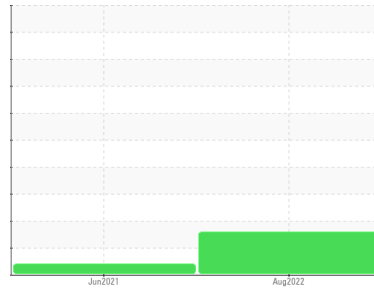


Machine Id  
**5561873 (S/N 1490)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## COMPONENT CONDITION SUMMARY

▲ Particle Trend

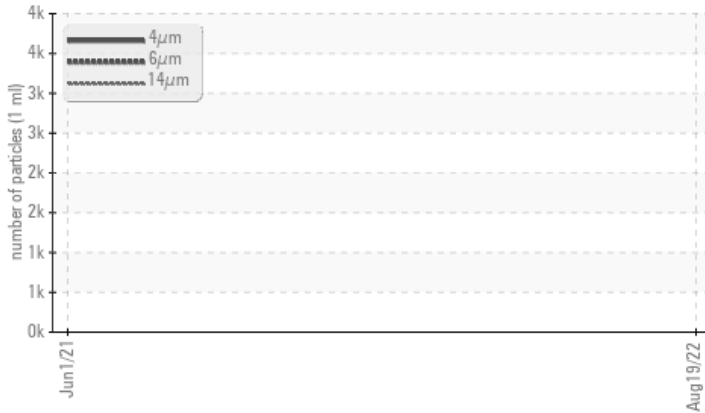

## RECOMMENDATION

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status	ASTM D7647	ASTM D7647	ABNORMAL	ABNORMAL	---
Particles >6µm	>1300	▲ 1662	---	---	---
Particles >14µm	>80	▲ 305	---	---	---
Particles >21µm	>20	▲ 96	---	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 19/18/15	---	---

Customer Id: CASLIT  
Sample No.: KCP49403  
Lab Number: 05627957  
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:  
Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

## HISTORICAL DIAGNOSIS

### 01 Jun 2021 Diag: Don Baldrige

#### VIS DEBRIS




No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

view report



# OIL ANALYSIS REPORT

Sample Rating Trend

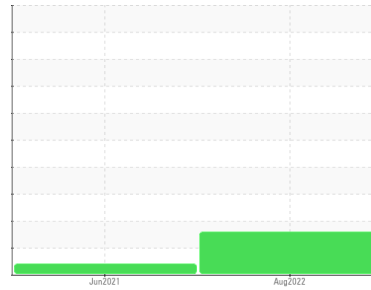

ISO



Machine Id  
**5561873 (S/N 1490)**  
Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

**DIAGNOSIS**

▲ **Recommendation**

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

▲ **Contamination**

There is a high amount of particulates present in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history 1	history 2
Sample Number				<b>KCP49403</b>	KCP32769	---
Sample Date				<b>19 Aug 2022</b>	01 Jun 2021	---
Machine Age	hrs			<b>6220</b>	4122	---
Oil Age	hrs			<b>2098</b>	2298	---
Oil Changed				<b>Changed</b>	Changed	---
Sample Status				<b>ABNORMAL</b>	ABNORMAL	---

WEAR METALS		method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	<1	---
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Copper	ppm	ASTM D5185m	>50	<b>14</b>	12	---
Tin	ppm	ASTM D5185m	>10	<b>0</b>	<1	---
Antimony	ppm	ASTM D5185m		<b>---</b>	0	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---


ADDITIVES		method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m	0	<b>0</b>	13	---
Barium	ppm	ASTM D5185m	90	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m		<b>0</b>	0	---
Magnesium	ppm	ASTM D5185m	100	<b>0</b>	<1	---
Calcium	ppm	ASTM D5185m	0	<b>0</b>	0	---
Phosphorus	ppm	ASTM D5185m	0	<b>2</b>	3	---
Zinc	ppm	ASTM D5185m	0	<b>0</b>	0	---
Sulfur	ppm	ASTM D5185m	23500	<b>16805</b>	15704	---

CONTAMINANTS		method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	1	---
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	---
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Water	%	ASTM D6304	>0.05	<b>0.008</b>	0.005	---
ppm Water	ppm	ASTM D6304	>500	<b>80.4</b>	53.3	---

FLUID CLEANLINESS		method	limit/base	current	history 1	history 2
Particles >4µm		ASTM D7647		<b>3650</b>	---	---
Particles >6µm		ASTM D7647	>1300	▲ <b>1662</b>	---	---
Particles >14µm		ASTM D7647	>80	▲ <b>305</b>	---	---
Particles >21µm		ASTM D7647	>20	▲ <b>96</b>	---	---
Particles >38µm		ASTM D7647	>4	<b>2</b>	---	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	---	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ <b>19/18/15</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history 1	history 2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	<b>0.41</b>	0.405	---


# OIL ANALYSIS REPORT

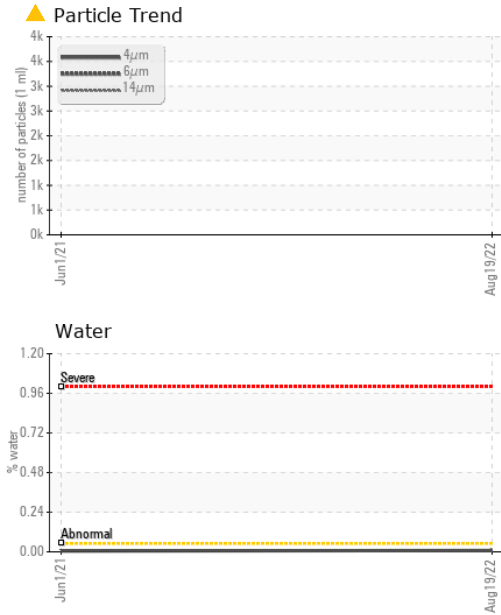





VISUAL	method	limit/base	current	history 1	history 2
White Metal	scalar	*Visual	NONE	VLITE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history 1	history 2
Visc @ 40°C	cSt	ASTM D445	45	49.8	48.0

SAMPLE IMAGES	method	limit/base	current	history 1	history 2
---------------	--------	------------	---------	-----------	-----------

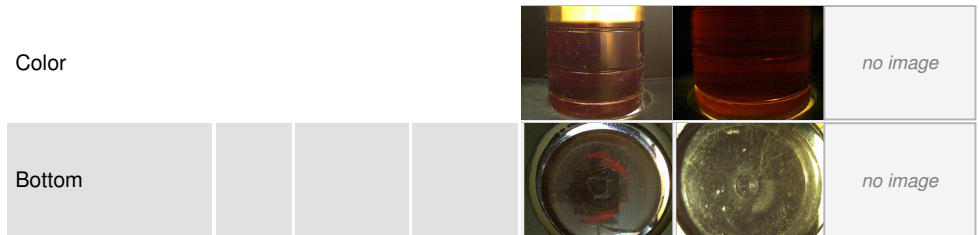

## GRAPHS

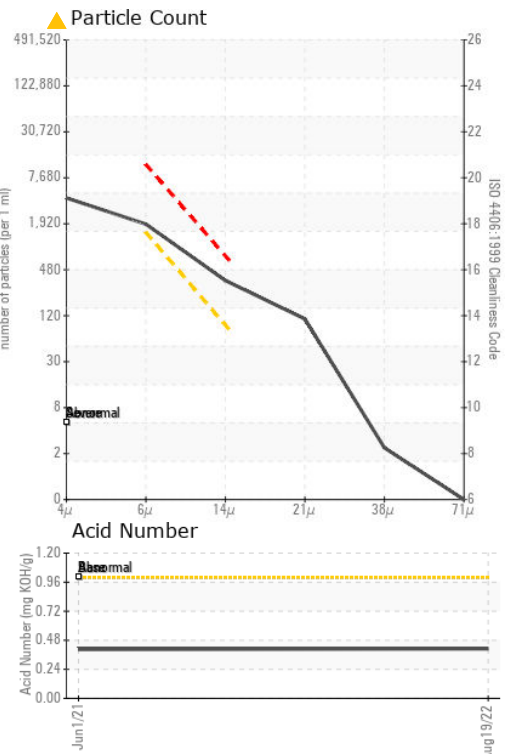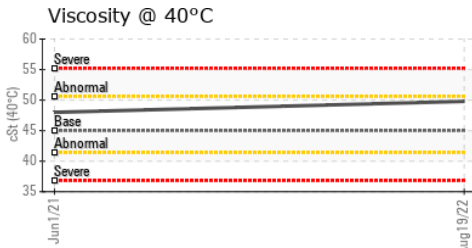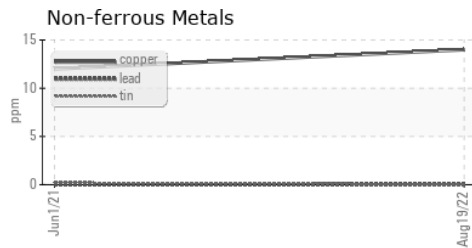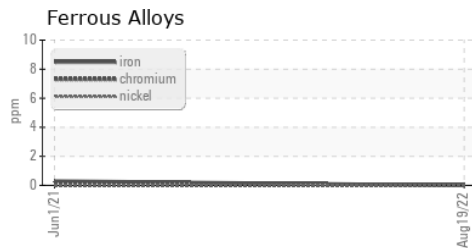

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCP49403 **Received** : 26 Aug 2022  
**Lab Number** : 05627957 **Diagnosed** : 29 Aug 2022  
**Unique Number** : 10112478 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**CASEWORK LOGIC**  
 5251 S RIO GRANDE ST  
 LITTLETON, CO  
 USA 80120  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)