

PROBLEM SUMMARY

Sample Rating Trend

ISO


7378445 (S/N 1640)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

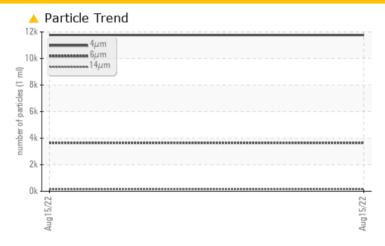

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

| PROBLEMATIC TE | ST RESULTS | | | |
|-----------------|--------------|---------|-----------------|------|
| Sample Status | | | ABNORMAL | |
| Particles >6µm | ASTM D7647 | >1300 | △ 3647 | |
| Particles >14µm | ASTM D7647 | >80 | 146 | |
| Particles >21µm | ASTM D7647 | >20 | <u>^</u> 27 | |
| Oil Cleanliness | ISO 4406 (c) | >/17/13 | 21/19/14 | |

Customer Id: KAEFRE Sample No.: KCP48304 Lab Number: 05628959 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 dougb@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

| RECOMMENDED AC | CTIONS | | | |
|----------------|--------|------|---------|---|
| Action | Status | Date | Done By | Description |
| Change Filter | | | ? | We recommend you service the filters on this component. |
| | | | | |

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

Sample Rating Trend

ISO

Machine Id

7378445 (S/N 1640)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| SAMPLE INFORM | /ATION | method | limit/base | current | history 1 | history 2 |
|-----------------|---------|--------------|-------------|-------------------|------------|------------|
| | VIATION | memou | IIIIIIVDase | | Thistory I | Thistory 2 |
| Sample Number | | | | KCP48304 | | |
| Sample Date | | | | 15 Aug 2022 | | |
| Machine Age | hrs | | | 1932 | | |
| Oil Age | hrs | | | 1932 | | |
| Oil Changed | | | | N/A | | |
| Sample Status | | | | ABNORMAL | | |
| WEAR METALS | | method | limit/base | current | history 1 | history 2 |
| ron | ppm | ASTM D5185m | >50 | <1 | | |
| Chromium | ppm | ASTM D5185m | >10 | 0 | | |
| Nickel | ppm | ASTM D5185m | >3 | 0 | | |
| - Titanium | ppm | ASTM D5185m | >3 | 0 | | |
| Silver | ppm | ASTM D5185m | >2 | 0 | | |
| Aluminum | ppm | ASTM D5185m | >10 | <1 | | |
| _ead | ppm | ASTM D5185m | >10 | 0 | | |
| Copper | ppm | ASTM D5185m | >50 | 2 | | |
| īn | ppm | ASTM D5185m | >10 | 0 | | |
| /anadium | ppm | ASTM D5185m | | 0 | | |
| Cadmium | ppm | ASTM D5185m | | 0 | | |
| ADDITIVES | | method | limit/base | current | history 1 | history 2 |
| Boron | ppm | ASTM D5185m | 0 | 0 | | |
| Barium | ppm | ASTM D5185m | 90 | 17 | | |
| Nolybdenum | ppm | ASTM D5185m | 0 | 0 | | |
| Manganese | ppm | ASTM D5185m | | <1 | | |
| Magnesium | ppm | ASTM D5185m | 100 | 70 | | |
| Calcium | ppm | ASTM D5185m | 0 | 2 | | |
| Phosphorus | ppm | ASTM D5185m | 0 | 2 | | |
| Zinc | ppm | ASTM D5185m | 0 | 3 | | |
| Sulfur | ppm | ASTM D5185m | 23500 | 17815 | | |
| CONTAMINANTS | 3 | method | limit/base | current | history 1 | history 2 |
| Silicon | ppm | ASTM D5185m | >25 | <1 | | |
| Sodium | ppm | ASTM D5185m | | 13 | | |
| otassium | ppm | ASTM D5185m | >20 | 6 | | |
| Vater | % | ASTM D6304 | >0.05 | 0.022 | | |
| ppm Water | ppm | ASTM D6304 | >500 | 226.2 | | |
| FLUID CLEANLIN | IESS | method | limit/base | current | history 1 | history 2 |
| Particles >4μm | | ASTM D7647 | | 11765 | | |
| Particles >6µm | | ASTM D7647 | >1300 | <u>▲</u> 3647 | | |
| Particles >14µm | | ASTM D7647 | >80 | <u> </u> | | |
| Particles >21µm | | ASTM D7647 | >20 | <u>^</u> 27 | | |
| Particles >38µm | | ASTM D7647 | >4 | 1 | | |
| Particles >71µm | | ASTM D7647 | >3 | 0 | | |
| Dil Cleanliness | | ISO 4406 (c) | >/17/13 | <u>^</u> 21/19/14 | | |
| FLUID DEGRADA | ATION | method | limit/base | current | history 1 | history 2 |


Acid Number (AN)


mg KOH/g ASTM D8045 1.0

0.30



OIL ANALYSIS REPORT

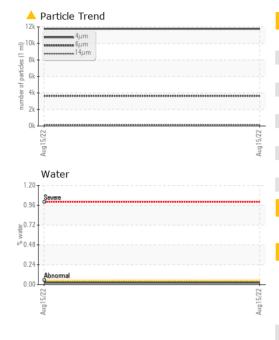

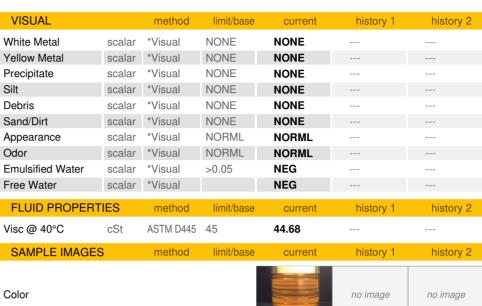

| 122,880 30,720 7,680 1,920 1 | Ferrous Alloys | ▲ Particle Count | |
|--|--------------------------|--|------------|
| 122,880 30,720 7,680 1,920 1 | | 491,520 | |
| 200 | *************** chromium | 122.880 | |
| Non-ferrous Metals 1,920 | - nanananan nickel | | |
| Non-ferrous Metals 1,920 | | 30,720 | |
| Severe Abnormal Severe Abnormal Severe Severe Abnormal Severe Abnormal Severe Abnormal Severe Abnormal Severe Abnormal Ab | | | |
| Severe Abnormal Severe Abnormal Severe Severe Abnormal Severe Abnormal Severe Abnormal Severe Abnormal Severe Abnormal Ab | 19/22 | 1 1 920 III | |
| Viscosity @ 40°C Severe Abnormal Base Abnormal Severe | Augl | Aug 1,520 | |
| Severe Abnormal Severe Abnormal Severe Severe Abnormal Severe Abnormal Severe Abnormal Severe Abnormal Severe Abnormal Ab | Non-ferrous Metals | 19 480 480 | |
| Viscosity @ 40°C Severe Abnormal Base Abnormal Severe | copper | 120 | |
| Severe Abnormal Base Abnormal Severe Abnormal Severe Abnormal Severe Abnormal Severe Abnormal Severe Abnormal Abn | | | _ |
| Viscosity @ 40°C Acid Number Severe Abnormal Base Abnormal Severe Abnormal Severe | | 30 | |
| Viscosity @ 40°C Acid Number Acid Number Base Abnormal | | 8 Bibrosemal | |
| Viscosity @ 40°C Acid Number Acid Number Base Abnormal | 2 | 2 | |
| Viscosity @ 40°C Acid Number Acid Number Base Abnormal | 915/2 | 1,1 | |
| Severe | | 4μ 6μ 14μ | 21μ 38μ 71 |
| Abnormal | Viscosity @ 40°C | | |
| Abnomal Base Abnomal Severe Base Abnomal Display 1 | 7 | N 0.96 Bbssormal | |
| Base | Abnormal | © 0.72 + | |
| Severe P 0.00 | | ===================================== | |
| ₹ _{0.00} ↓ | | <u>₹</u> 0.24 | |
| 7 | <u> </u> | 2 V V V V V V V V V V V V V V V V V V V | |
| /51 | Aug15/22 | Aug15/22 - | |



Certificate L2367

Laboratory Sample No.

Lab Number

Unique Number

: KCP48304 : 05628959 : 10113480

Bottom

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received

: 29 Aug 2022 Diagnosed : 02 Sep 2022 Diagnostician : Doug Bogart

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) KAESER COMPRESSOR

511 SIGMA DRIVE FREDERICKSBURG, VA USA 22408

Contact: Warranty Department

warranty.us@kaeser.com T: (540)898-5500

F: (540)898-5520

Report Id: KAEFRE [WUSCAR] 05628959 (Generated: 09/02/2022 15:38:04)

Contact/Location: Warranty Department - KAEFRE

no image

no image