


# PROBLEM SUMMARY

Sample Rating Trend

ISO




Machine Id  
**KAESER SFC1105 5945066 (S/N 1045)**  
Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) S-460 (--- QTS)**

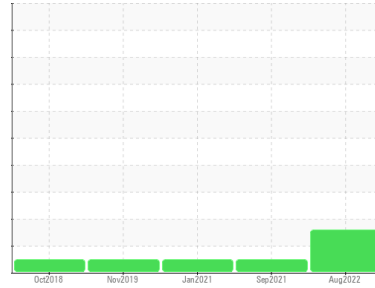

## COMPONENT CONDITION SUMMARY

### ▲ Particle Trend

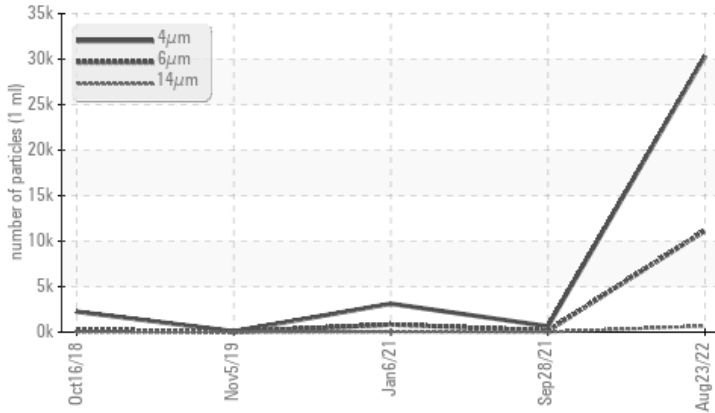

## RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	NORMAL	NORMAL
Particles >6µm	ASTM D7647	>1300	▲ <b>11156</b>	154	835
Particles >14µm	ASTM D7647	>160	▲ <b>677</b>	6	39
Particles >21µm	ASTM D7647	>40	▲ <b>60</b>	0	9
Oil Cleanliness	ISO 4406 (c)	>--/17/14	▲ <b>22/21/17</b>	14/10	17/12

Customer Id: ALLDOV  
Sample No.: KC95233  
Lab Number: 05629603  
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Doug Bogart +1 (800)237-1369 x4016  
[dougb@wearcheckusa.com](mailto:dougb@wearcheckusa.com)

To change component or sample information:  
Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

### 28 Sep 2021 Diag: Jonathan Hester

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 06 Jan 2021 Diag: Angela Borella

NORMAL



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 05 Nov 2019 Diag: Jonathan Hester

NORMAL




Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



Machine Id  
**KAESER SFC1105 5945066 (S/N 1045)**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) S-460 (--- QTS)**

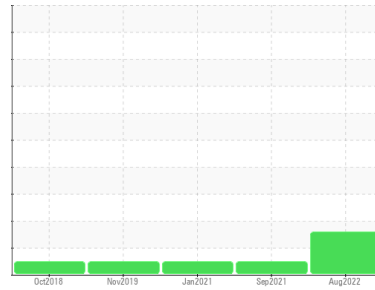

## DIAGNOSIS

### ▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### ▲ Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history 1	history 2
Sample Number			<b>KC95233</b>	KC99453	KC82952
Sample Date			<b>23 Aug 2022</b>	28 Sep 2021	06 Jan 2021
Machine Age	hrs		<b>40865</b>	33561	27285
Oil Age	hrs		<b>5346</b>	6276	8600
Oil Changed			<b>Not Changed</b>	Not Changed	Changed
Sample Status			<b>ABNORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history 1	history 2
Iron	ppm ASTM D5185m	>50	<b>0</b>	0	0
Chromium	ppm ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm ASTM D5185m	>2	<b>0</b>	<1	0
Aluminum	ppm ASTM D5185m	>10	<b>0</b>	<1	0
Lead	ppm ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm ASTM D5185m	>50	<b>9</b>	11	7
Tin	ppm ASTM D5185m	>10	<b>0</b>	0	0
Antimony	ppm ASTM D5185m		<b>---</b>	0	0
Vanadium	ppm ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm ASTM D5185m		<b>0</b>	<1	0

## ADDITIVES

	method	limit/base	current	history 1	history 2
Boron	ppm ASTM D5185m		<b>0</b>	<1	0
Barium	ppm ASTM D5185m	90	<b>&lt;1</b>	0	0
Molybdenum	ppm ASTM D5185m		<b>0</b>	0	0
Manganese	ppm ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm ASTM D5185m	90	<b>0</b>	<1	0
Calcium	ppm ASTM D5185m	2	<b>0</b>	0	0
Phosphorus	ppm ASTM D5185m		<b>0</b>	<1	4
Zinc	ppm ASTM D5185m		<b>0</b>	0	0

## CONTAMINANTS

	method	limit/base	current	history 1	history 2
Silicon	ppm ASTM D5185m	>25	<b>&lt;1</b>	1	<1
Sodium	ppm ASTM D5185m		<b>0</b>	<1	0
Potassium	ppm ASTM D5185m	>20	<b>0</b>	0	0
Water	% ASTM D6304	>0.05	<b>0.007</b>	0.007	0.003
ppm Water	ppm ASTM D6304	>500	<b>70.6</b>	72.8	31.9


## FLUID CLEANLINESS

	method	limit/base	current	history 1	history 2
Particles >4µm	ASTM D7647		<b>30350</b>	645	3123
Particles >6µm	ASTM D7647	>1300	▲ <b>11156</b>	154	835
Particles >14µm	ASTM D7647	>160	▲ <b>677</b>	6	39
Particles >21µm	ASTM D7647	>40	▲ <b>60</b>	0	9
Particles >38µm	ASTM D7647	>10	<b>3</b>	0	2
Particles >71µm	ASTM D7647	>3	<b>1</b>	0	1
Oil Cleanliness	ISO 4406 (c)	>--/17/14	▲ <b>22/21/17</b>	14/10	17/12

## FLUID DEGRADATION

	method	limit/base	current	history 1	history 2
Acid Number (AN)	mg KOH/g ASTM D8045	0.4	<b>0.40</b>	0.418	0.443


# OIL ANALYSIS REPORT

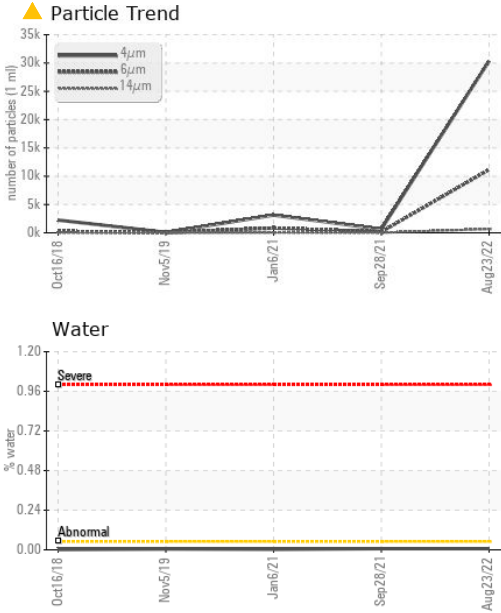



VISUAL	method	limit/base	current	history 1	history 2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history 1	history 2
Visc @ 40°C	cSt	ASTM D445 46	44.5	44.3	43.6

SAMPLE IMAGES	method	limit/base	current	history 1	history 2
---------------	--------	------------	---------	-----------	-----------

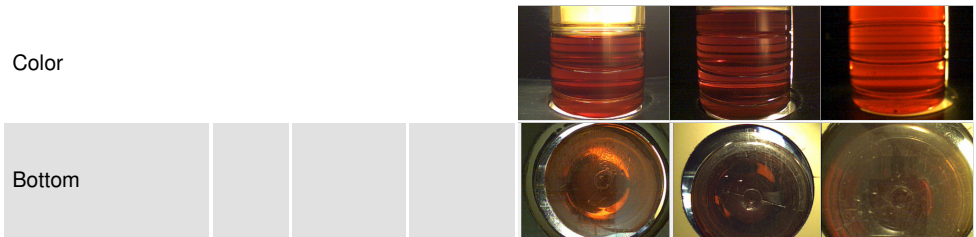

## GRAPHS

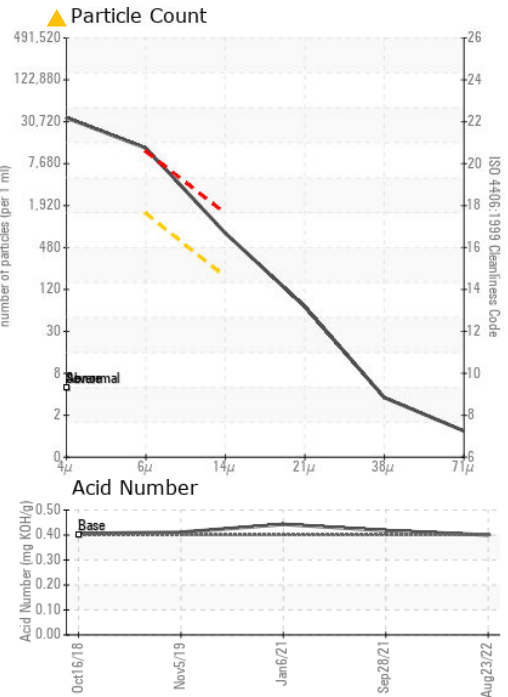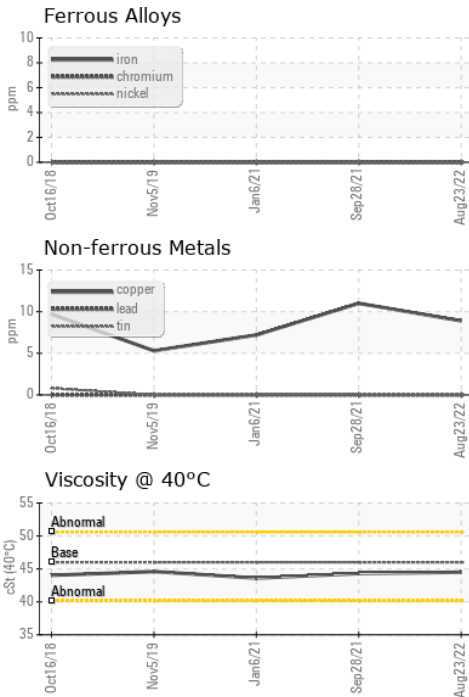

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC95233 **Received** : 29 Aug 2022  
**Lab Number** : 05629603 **Diagnosed** : 30 Aug 2022  
**Unique Number** : 10114124 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**ALLIED MACHINE**  
 485 W 3RD ST  
 DOVER, OH  
 USA 44662  
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: