KAESER COMPRESSORS®
Built for a lifetime.

PROBLEM SUMMARY

Sample Rating Trend

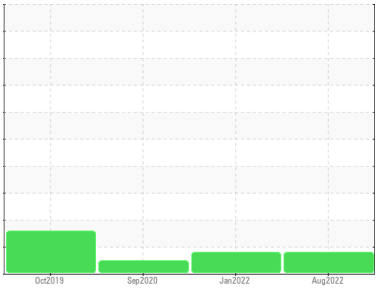

ISO

Machine Id
KAESER BSD 50 6523422 (S/N 1939)
Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

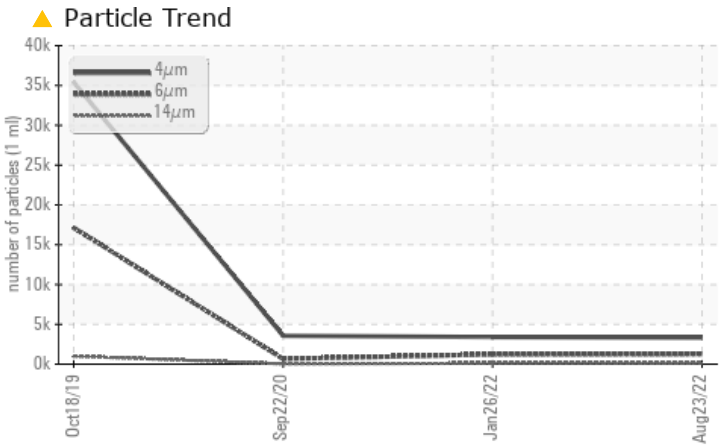

RECOMMENDATION

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

				ATTENTION	ATTENTION	NORMAL
Sample Status				**ATTENTION**	ATTENTION	NORMAL
Particles >14µm		ASTM D7647	>80	▲ **110**	▲ 113	32
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ **19/17/14**	▲ 17/14	17/12

Customer Id: NORCOT
Sample No.: KCP50562
Lab Number: 05629638
Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldridge +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

26 Jan 2022 Diag: Don Baldridge

ISO

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

22 Sep 2020 Diag: Angela Borella

NORMAL

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid.

view report

18 Oct 2019 Diag: Jonathan Hester

ISO

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

KAESER COMPRESSORS
Built for a lifetime.

OIL ANALYSIS REPORT

Sample Rating Trend

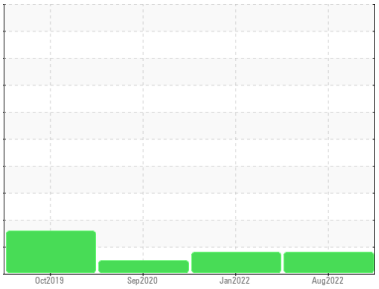

ISO

Machine Id
KAESER BSD 50 6523422 (S/N 1939)
Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation
No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
There is a moderate amount of particulates present in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION	method	limit/base	current	history 1	history 2
Sample Number			**KCP50562**	KCP35091	KCP30338
Sample Date			**23 Aug 2022**	26 Jan 2022	22 Sep 2020
Machine Age	hrs		**11735**	9356	5621
Oil Age	hrs		**2379**	3592	2887
Oil Changed			**Changed**	Changed	Changed
Sample Status			**ATTENTION**	ATTENTION	NORMAL

WEAR METALS		method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m	>50	**<1**	<1	<1
Chromium	ppm	ASTM D5185m	>10	**0**	0	0
Nickel	ppm	ASTM D5185m	>3	**0**	0	0
Titanium	ppm	ASTM D5185m	>3	**0**	0	0
Silver	ppm	ASTM D5185m	>2	**0**	0	<1
Aluminum	ppm	ASTM D5185m	>10	**2**	2	0
Lead	ppm	ASTM D5185m	>10	**0**	0	0
Copper	ppm	ASTM D5185m	>50	**11**	8	3
Tin	ppm	ASTM D5185m	>10	**0**	<1	<1
Antimony	ppm	ASTM D5185m		**---**	0	0
Vanadium	ppm	ASTM D5185m		**0**	0	0
Cadmium	ppm	ASTM D5185m		**0**	0	<1

ADDITIVES		method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m	0	**0**	<1	<1
Barium	ppm	ASTM D5185m	90	**<1**	0	8
Molybdenum	ppm	ASTM D5185m	0	**0**	0	0
Manganese	ppm	ASTM D5185m		**0**	0	<1
Magnesium	ppm	ASTM D5185m	100	**0**	2	42
Calcium	ppm	ASTM D5185m	0	**0**	0	<1
Phosphorus	ppm	ASTM D5185m	0	**1**	9	4
Zinc	ppm	ASTM D5185m	0	**<1**	0	3
Sulfur	ppm	ASTM D5185m	23500	**17908**	17026	17698

CONTAMINANTS		method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m	>25	**<1**	2	1
Sodium	ppm	ASTM D5185m		**1**	1	16
Potassium	ppm	ASTM D5185m	>20	**0**	<1	8
Water	%	ASTM D6304	>0.05	**0.013**	0.008	0.026
ppm Water	ppm	ASTM D6304	>500	**138.6**	85.9	269.3

FLUID CLEANLINESS		method	limit/base	current	history 1	history 2
Particles >4µm		ASTM D7647		**3330**	3402	3564
Particles >6µm		ASTM D7647	>1300	**1261**	1232	656
Particles >14µm		ASTM D7647	>80	▲ **110**	▲ 113	32
Particles >21µm		ASTM D7647	>20	**15**	▲ 27	9
Particles >38µm		ASTM D7647	>4	**1**	0	1
Particles >71µm		ASTM D7647	>3	**0**	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ **19/17/14**	▲ 17/14	17/12

FLUID DEGRADATION		method	limit/base	current	history 1	history 2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	**0.50**	0.43	0.402

KAESER COMPRESSORS®
Built for a lifetime.

OIL ANALYSIS REPORT

Particle Trend

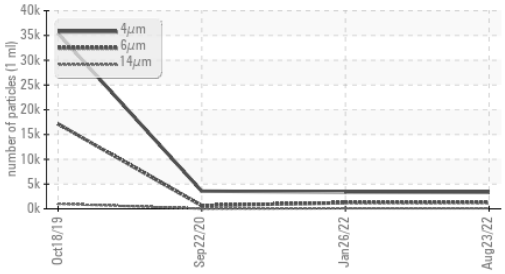

Water

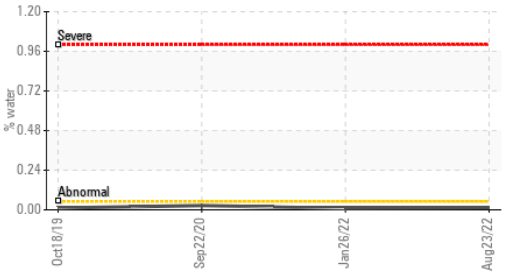

VISUAL		method	limit/base	current	history 1	history 2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history 1	history 2
Visc @ 40°C	cSt	ASTM D445	45	**50.3**	49.9	45.6

SAMPLE IMAGES	method	limit/base	current	history 1	history 2
Color					
Bottom			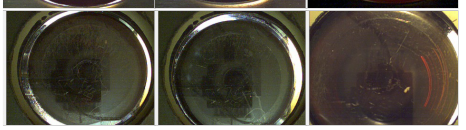		

GRAPHS

Ferrous Alloys

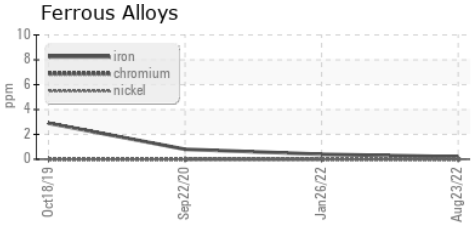

Non-ferrous Metals

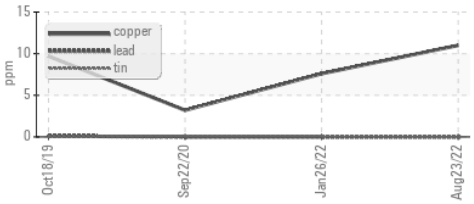

Viscosity @ 40°C

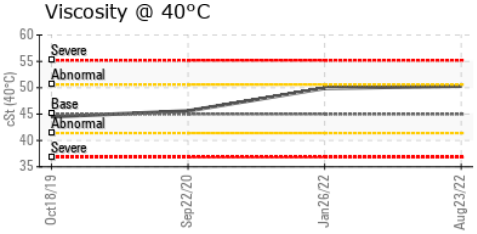

Particle Count

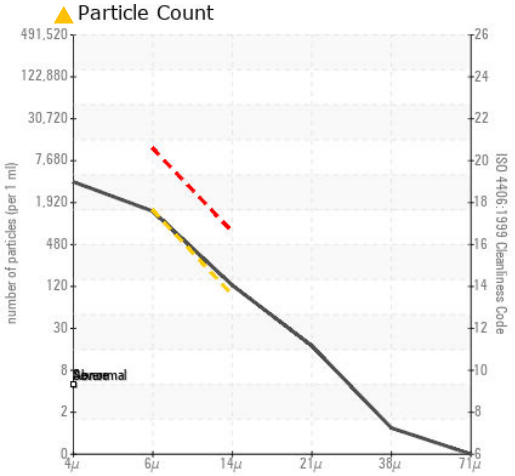

Acid Number

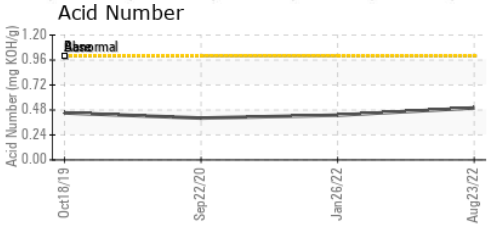

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP50562 **Received** : 29 Aug 2022
Lab Number : 05629638 **Diagnosed** : 31 Aug 2022
Unique Number : 10114159 **Diagnostician** : Don Baldridge
Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

NORTH STAR SHEETS
7550 91ST ST S
COTTAGE GROVE, MN
USA 55016
Contact: Service Manager
T:
F: