


# KAESER 6516378

COMPRESSORS Built for a lifetime.

Compressor Fluid KAESER SIGMA (OEM) M-460 (--- GAL)

## COMPONENT CONDITION SUMMARY

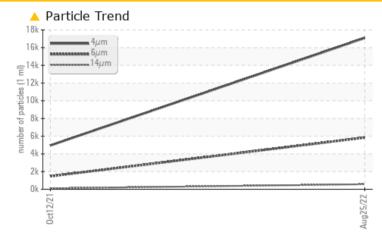

#### RECOMMENDATION

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

# PROBLEMATIC TEST RESULTS

	-00210				
Sample Status			ABNORMAL	ATTENTION	
Particles >6µm	ASTM D7647	>1300	<u> </u>	<b>1</b> 467	
Particles >14µm	ASTM D7647	>80	🔺 566	<b>1</b> 00	
Particles >21µm	ASTM D7647	>20	<u> </u>	18	
Particles >38µm	ASTM D7647	>4	<u> </u>	0	
Oil Cleanliness	ISO 4406 (c)	>/17/13	<u> </u>	<b>1</b> 8/14	


Customer Id: AMATRAOAK4 Sample No.: KCP44127 Sample No.: KCP44127 Stab Number: 05633649 State Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 dougb@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

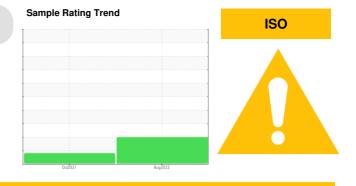

RECOMMENDED	ACTIONS			
Action	Status	Date	Done By	Description
Change Fluid			?	Oil and filter change at the time of sampling has been noted.
Change Filter			?	Oil and filter change at the time of sampling has been noted.

# HISTORICAL DIAGNOSIS



## 12 Oct 2021 Diag: Doug Bogart

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





# **OIL ANALYSIS REPORT**

#### Machine Id **KAESER 6516378** Component

#### Compressor Fluid KAESER SIGMA (OEM) M-460 (--- GAL)

#### DIAGNOSIS

#### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

## Wear


All component wear rates are normal.

#### Contamination

There is a high amount of particulates present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

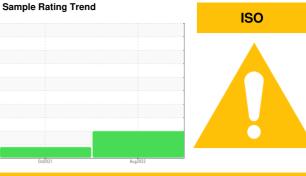

SAMPLE INFORM	ATION	method	limit/base	current	history 1	history 2
Sample Number				KCP44127	KCP36560	
Sample Date				25 Aug 2022	12 Oct 2021	
Machine Age	hrs			0	12960	
Oil Age	hrs			0	0	
Oil Changed				Changed	Changed	
Sample Status				ABNORMAL	ATTENTION	
WEAR METALS		method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	<1	<1	
Aluminum	ppm	ASTM D5185m	>10	<1	<1	
Lead	ppm	ASTM D5185m	>10	<1	0	
Copper	ppm	ASTM D5185m	>50	2	1	
Tin	ppm	ASTM D5185m	>10	<1	<1	
Antimony	ppm	ASTM D5185m			0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m	0	0	17	
Barium	ppm	ASTM D5185m	90	20	12	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	100	58	80	
Calcium	ppm	ASTM D5185m	0	1	2	
Phosphorus	ppm	ASTM D5185m	0	4	5	
Zinc	ppm	ASTM D5185m	0	6	<1	
Sulfur	ppm	ASTM D5185m	23500	20294	18149	
CONTAMINANTS		method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m	>25	1	2	
Sodium	ppm	ASTM D5185m		16	18	
Potassium	ppm	ASTM D5185m	>20	3	2	
Water	%	ASTM D6304	>0.05	0.011	0.010	
ppm Water	ppm	ASTM D6304	>500	118.3	107.3	
FLUID CLEANLIN	IESS	method	limit/base	current	history 1	history 2
Particles >4µm		ASTM D7647		17091	4952	
Particles >6µm		ASTM D7647	>1300	<u> </u>	<b>1</b> 467	
Particles >14µm		ASTM D7647	>80	<b>6</b> 566	<u> </u>	
Particles >21µm		ASTM D7647	>20	🔺 106	18	
Particles >38µm		ASTM D7647	>4	<mark>/</mark> 7	0	
Particles >71µm		ASTM D7647	>3	1	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<b>A</b> 21/20/16	▲ 18/14	
FLUID DEGRADA	TION	method	limit/base	current	history 1	history 2

Acid Number (AN)

mg KOH/g ASTM D8045 1.0

0.34 0.359 Contact/Location: Service Manager - AMATRAOAK4

```
Page 3 of 4
```


----



Built for a lifetime.

# **OIL ANALYSIS REPORT**

VISUAL

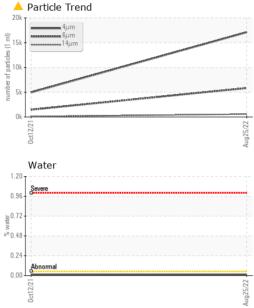

	VISUAL		method	limit/base	current	history 1	history 2
	White Metal	scalar	*Visual	NONE	NONE	NONE	
	Yellow Metal	scalar	*Visual	NONE	NONE	NONE	
	Precipitate	scalar	*Visual	NONE	NONE	NONE	
	Silt	scalar	*Visual	NONE	NONE	NONE	
	Debris	scalar	*Visual	NONE	LIGHT	NONE	
	Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	
22							
Aug25/22	Appearance	scalar	*Visual	NORML	NORML	NORML	
AL	Odor	scalar	*Visual	NORML	NORML	NORML	
	Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	
	Free Water	scalar	*Visual		NEG	NEG	
	FLUID PROPERT	TIES	method	limit/base	current	history 1	history 2
	Visc @ 40°C	cSt	ASTM D445	45	49.5	48.4	
	SAMPLE IMAGE	S	method	limit/base	current	history 1	history 2
Aug25/22	Color						no image
	Bottom				$\bigcirc$		no image
	GRAPHS						
	Ferrous Alloys			401 500	Particle Count		
	10 iron ]			491,520			T26
	6			122,880	-		-24
	E 6						
	2			30,720			-22
				7,680			-20
	2/21,				1.		
	0ct12/2			Aug25/22 s (per 1 ml	· /		-20 -18 -18 -19
	Non-ferrous Meta	ls		v sajoje 480		X	16
	<sup>10</sup> T			of par			
	8 - copper			Aug25/22. Aug25/22. 150 Aug25/22. 150 Aug26/22. 150 Aug26/		1 1	-14
	C			E 30		/	-12
				30			
	2			8	<b>Ber</b> eemal		10
	0						
	0ct12/21			Aug25/22			18
	0			Aug 0		1	
	Viscosity @ 40°C			2	<sup>µ 6µ</sup> Acid Number	14μ 21μ	38µ 71µ
	60 Severe			1.20	т		
-	55 Severe			0.120 0.96 0.97 0.97 0.00 0.72 0.48 0.48 0.02 0.02	<b>Base</b> rmal		
Ē	50 - Abnormal			٤ 0.72			
Jour	45 - Base			· 문 0.48			
(JeUV) +30	Abhornai			<sup>2</sup> 0.24			
000 yr 100	40 - Abnormal			¥ 0.00			
100 V) 100	35 Severe			0.00	5		
0, MAR	35 Severe			0.00	ct12/21-		
Laboratory Sample No. Lab Number Unique Number Test Package	: WearCheck USA - 5 : KCP44127 : 05633649	Received Diagnose Diagnost	d : 02 : ed : 06 : iician : Dou	Aug25/22	0ct12/21	1555 N (	MAZON OAK CHRISMAN R TRACY, C USA 953( ervice Manag

method limit/base

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: Service Manager - AMATRAOAK4

history 1

current

history 2

F: